


SPRINKLER SERVICE

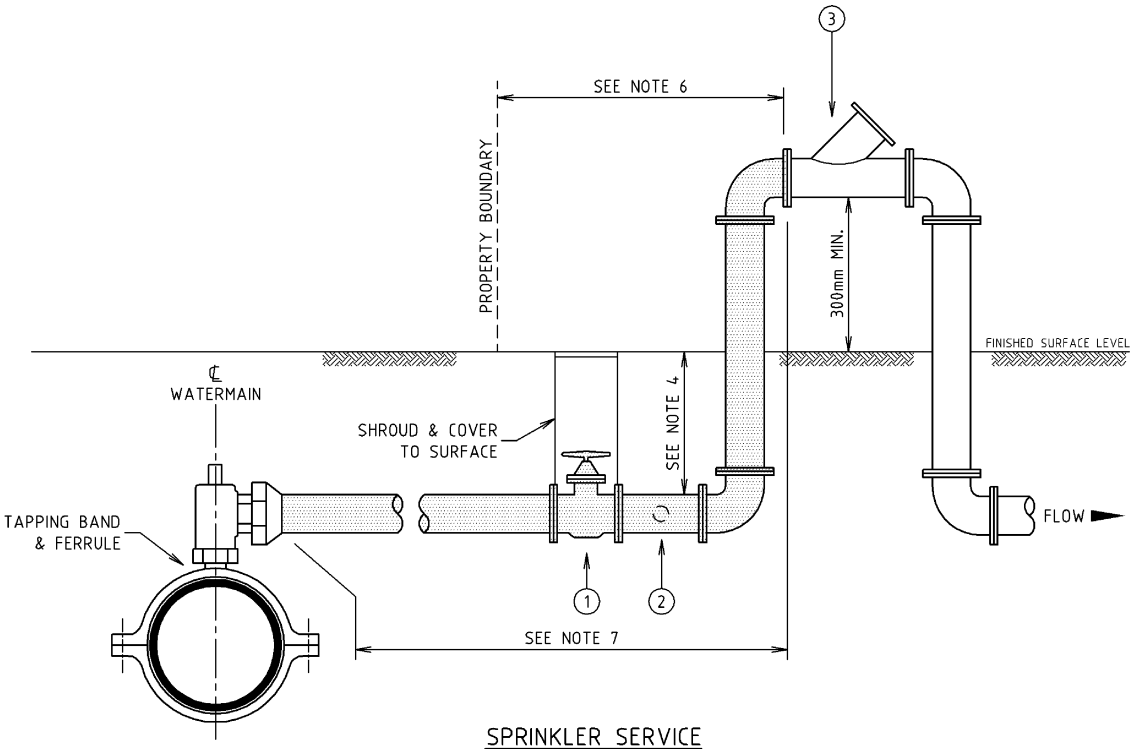


GENERAL SERVICE

20/25mm GENERAL SERVICE SHOWN
FOR 32-50mm GENERAL SERVICE REFER A3-34375

NOTES:

1. All dimensions are in millimetres.
2. Pipe material and assembly to conform to AS 3500.1.
3. Meter assembly shall be horizontal.
4. Minimum pipe cover to conform to AS 3500.1 (Clause 5.10 & 5.11).
5. All flanges to conform to AS 4087.
6. Location shall conform to AS 3500.1 (Clause 12.0).
7. All plumbing shaded ▭ shall be installed with male iron connection prior to tapping & meter installation.
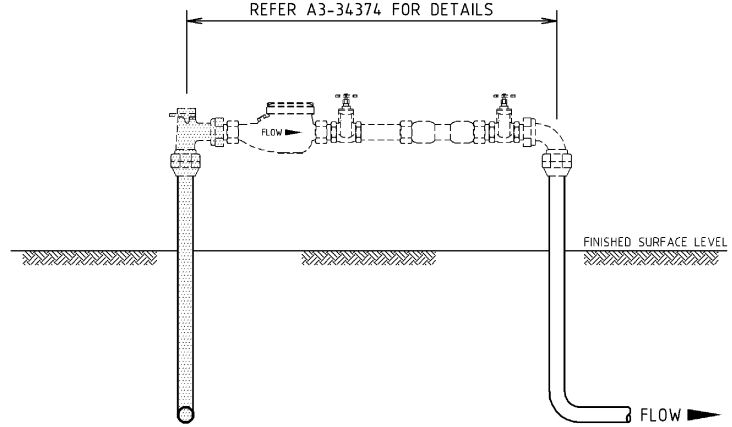
## MATERIAL SCHEDULE

| ITEM | DESCRIPTION |
|---|---|
| 1 | GATE VALVE TO CONFORM TO AS 3500.1 (CLAUSE 12.0) |
| 2 | TEE TO GENERAL SERVICE |
| 3 | SINGLE CHECK VALVE |

For low hazard backflow prevention areas only

**DO NOT SCALE**

REVISIONS

| No. | DATE | DESCRIPTION | APP'D |
|---|---|---|---|
| | | | |


13A Church Street
Traralgon, Victoria, 3844.
Ph. (03) 5174 7583
Fax (03) 5174 0011

Digital Mapping ◦
Design Drafting ◦
Water Industry Services ◦
Large Format Plotting ◦


CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: / /
DRAWN: 3/7/06 JMB
CHECKED: / /

GIPPSLAND WATER

DRAWING No. A3-34376 REV. 0

# TYPICAL ARRANGEMENT

WATER METER & BACKFLOW PREVENTION DEVICE
ASSEMBLY REQUIREMENTS
DOMESTIC FIRE SPRINKLER & GENERAL SERVICE