


TYPICAL PROPERTY SERVICE DETAIL

NOT TO SCALE

NOTES:

- Ball valve 'A' is the service connection ball valve, which is to be left in the closed position after construction with the handle to the top, the sealing plug installed, the valve protection cover placed over the valve and backfilled.
- Male thread on all fittings must be wrapped in PTFE (Teflon) tape.
- Property service pipe must be embedded in washed free flowing sand (min. 100mm underlay and side support, overlay to within 100mm of the finished surface level).
- Where copper service pipe is used, an insulation coupling must be provided between ball valve 'B' and the service line.
- Detectable marking tape to be included along the entire property service length as per WSA 03-2011 (MRWA Edition), Section 5.4.16.1
- Marking stake to be installed above the cover protection of valve 'A', with the marker tape wrapped around stake.

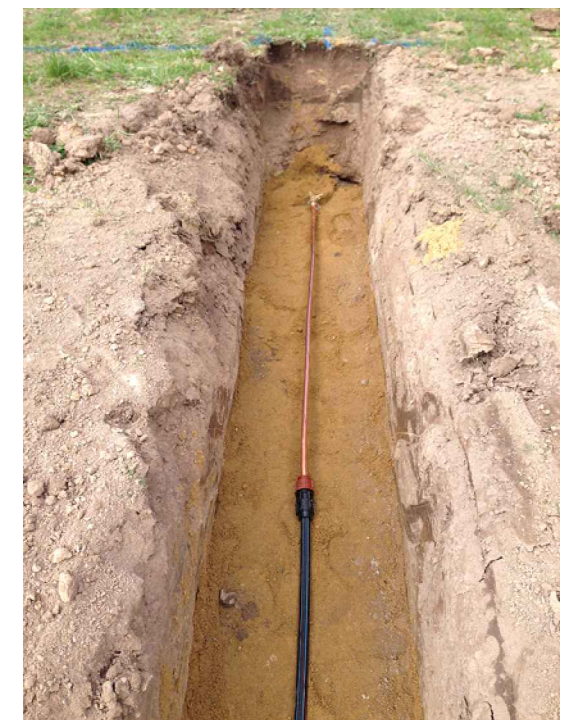

PHOTOS OF TYPICAL SERVICE INSTALLATION

				DO NOT SCALE		GIPPSLAND WATER DRAWING STATUS		TYPICAL DRAWING ONLY		GIPPSLAND WATER FACILITY CODE	
				CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.				GIPPSLAND WATER		DRAWING No. A3-59295	
				DESIGNED: 10/8/15 GBS						REV. B	
				DRAWN: 10/8/15 JMB							
				CHECKED: 10/8/15 GBS							
				DESIGNED BY:							
				PLAN NO.		TITLE					
				REFERENCE							
				DESIGNED BY:							
				APP'D							
				No.		DATE		DESCRIPTION			
				A		10/8/15		ISSUED AS TYPICAL DRAWING		GBS	
				B		15/10/15		TYPING ERRORS FIXED		GBS	