


PLATE IN CUBICLE
FOR MOUNTING FUSES


FUSES


OUTLINE OF
DOOR OPENING

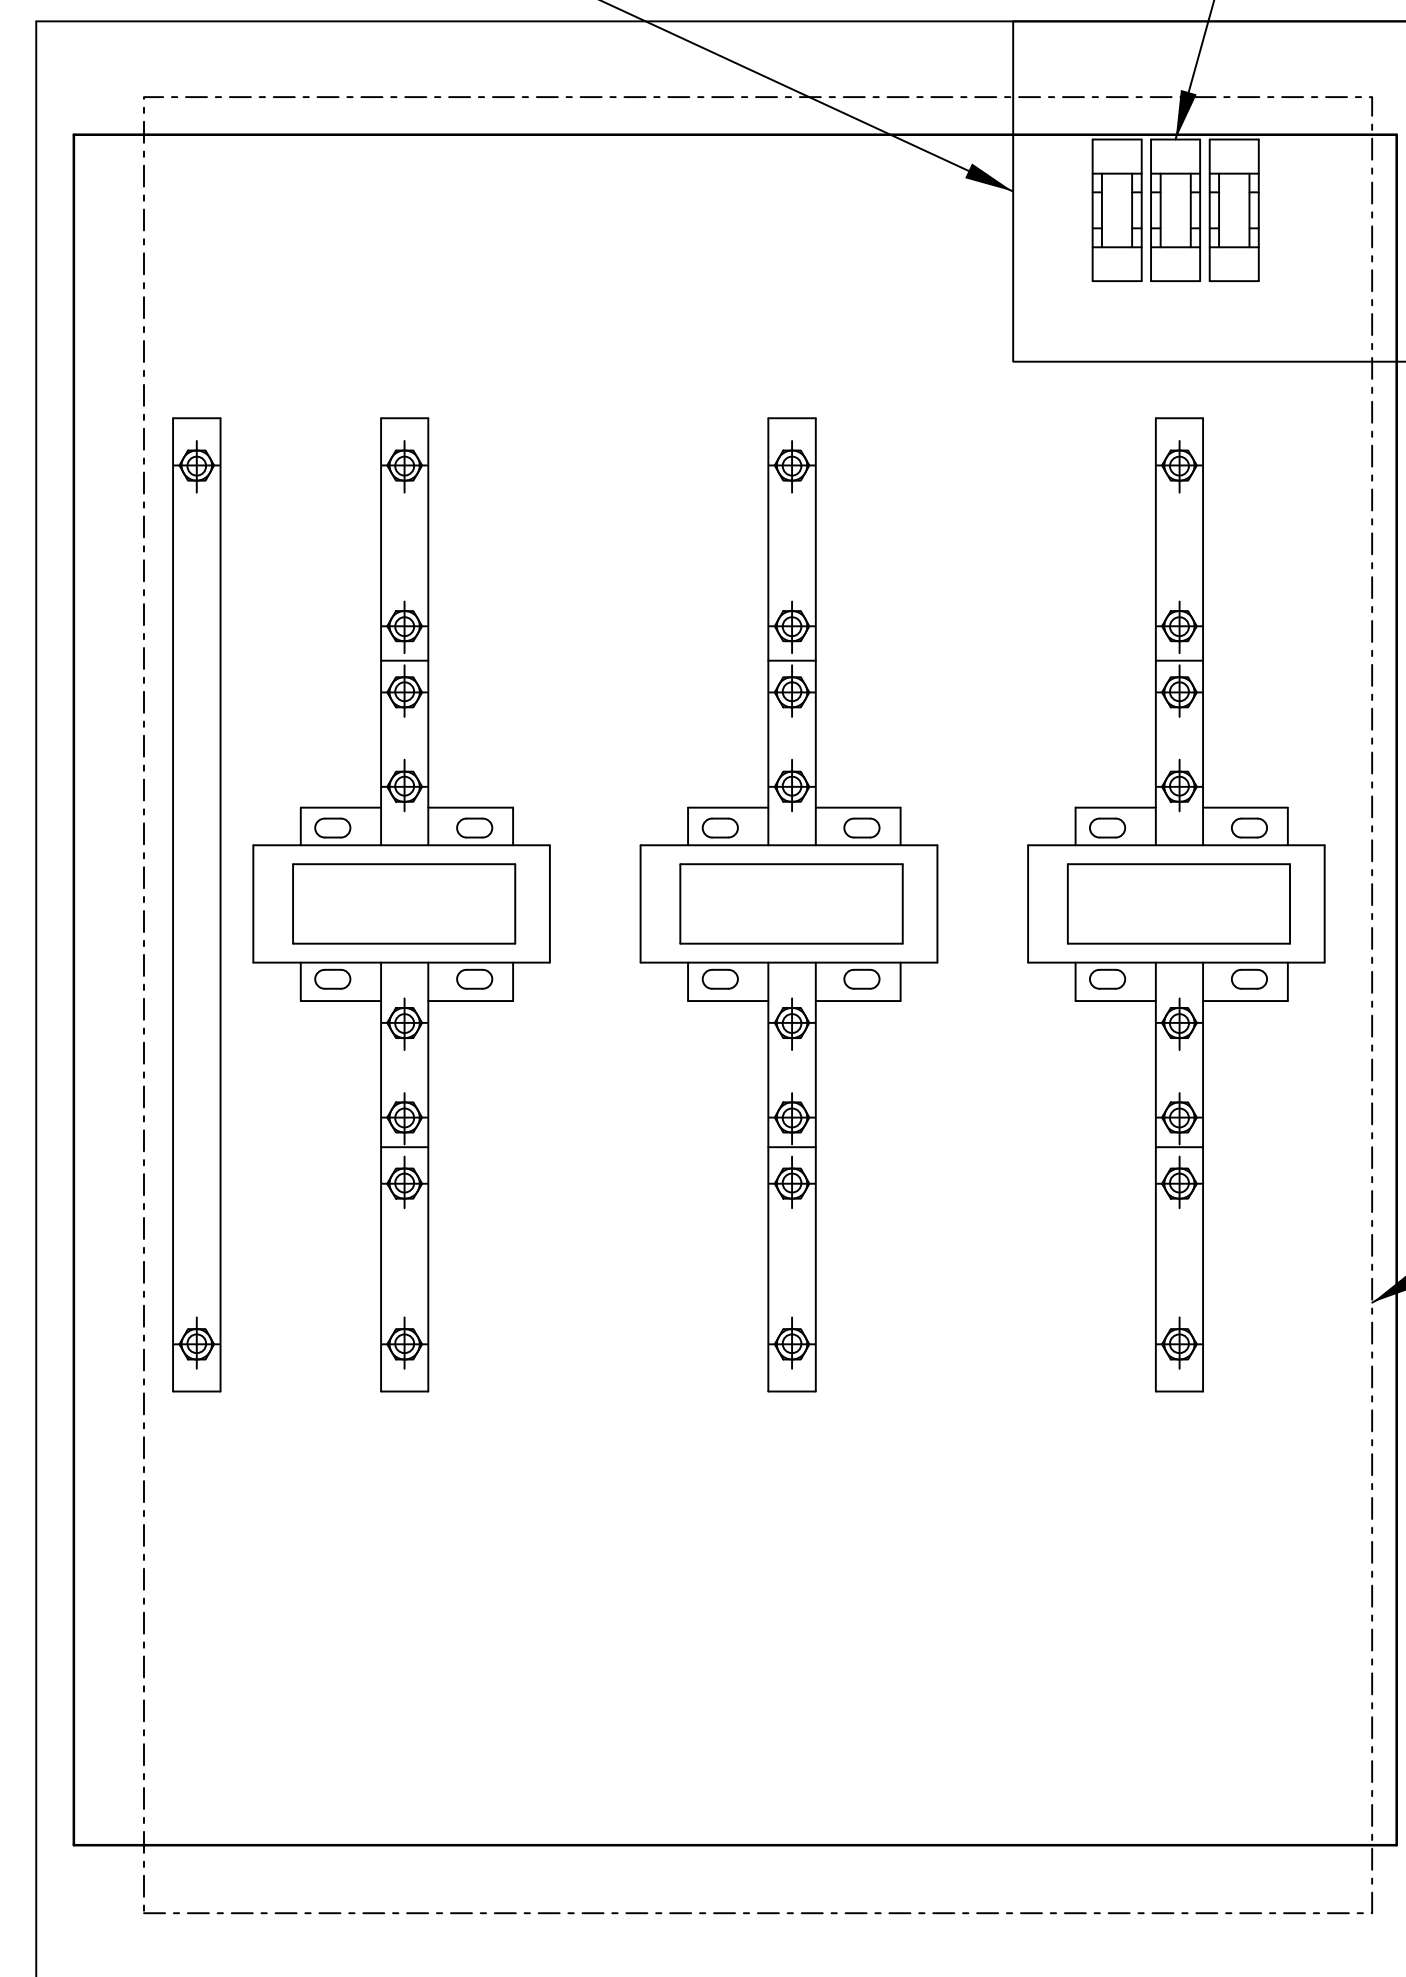

160A CT CHAMBER

- BUSBAR: 1 - 25mm X 10mm Cu BUSBAR PER PHASE
- CT'S: ESAA TYPE S
- FUSES: 3 - 32A FUSE HOLDER c/w 32A FUSE LINK

												DO NOT SCALE		GIPPSLAND WATER DRAWING STATUS		STANDARD DRAWING		GIPPSLAND WATER FACILITY CODE XXCPXX			
																GIPPSLAND WATER		DRAWING No. A1-52800		REV. 1	
																STANDARD SEWERAGE PUMP STATION		PUMP STATION 30kW TO 160kW (VSD) - CT METERED			
																		SUPPLY CUBICLE			
																		160A CT GEAR TRAY LAYOUT			

REVISIONS				REFERENCES				DESIGNED BY:				
1	7/9/20	UPDATED DRAWING SHEETS.										
0	24/9/12	INITIAL ISSUE.										
No.	DATE	DESCRIPTION		APP'D	PLAN No.	TITLE						
					A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX						