



MAIN DISTRIBUTION
COMPARTMENT

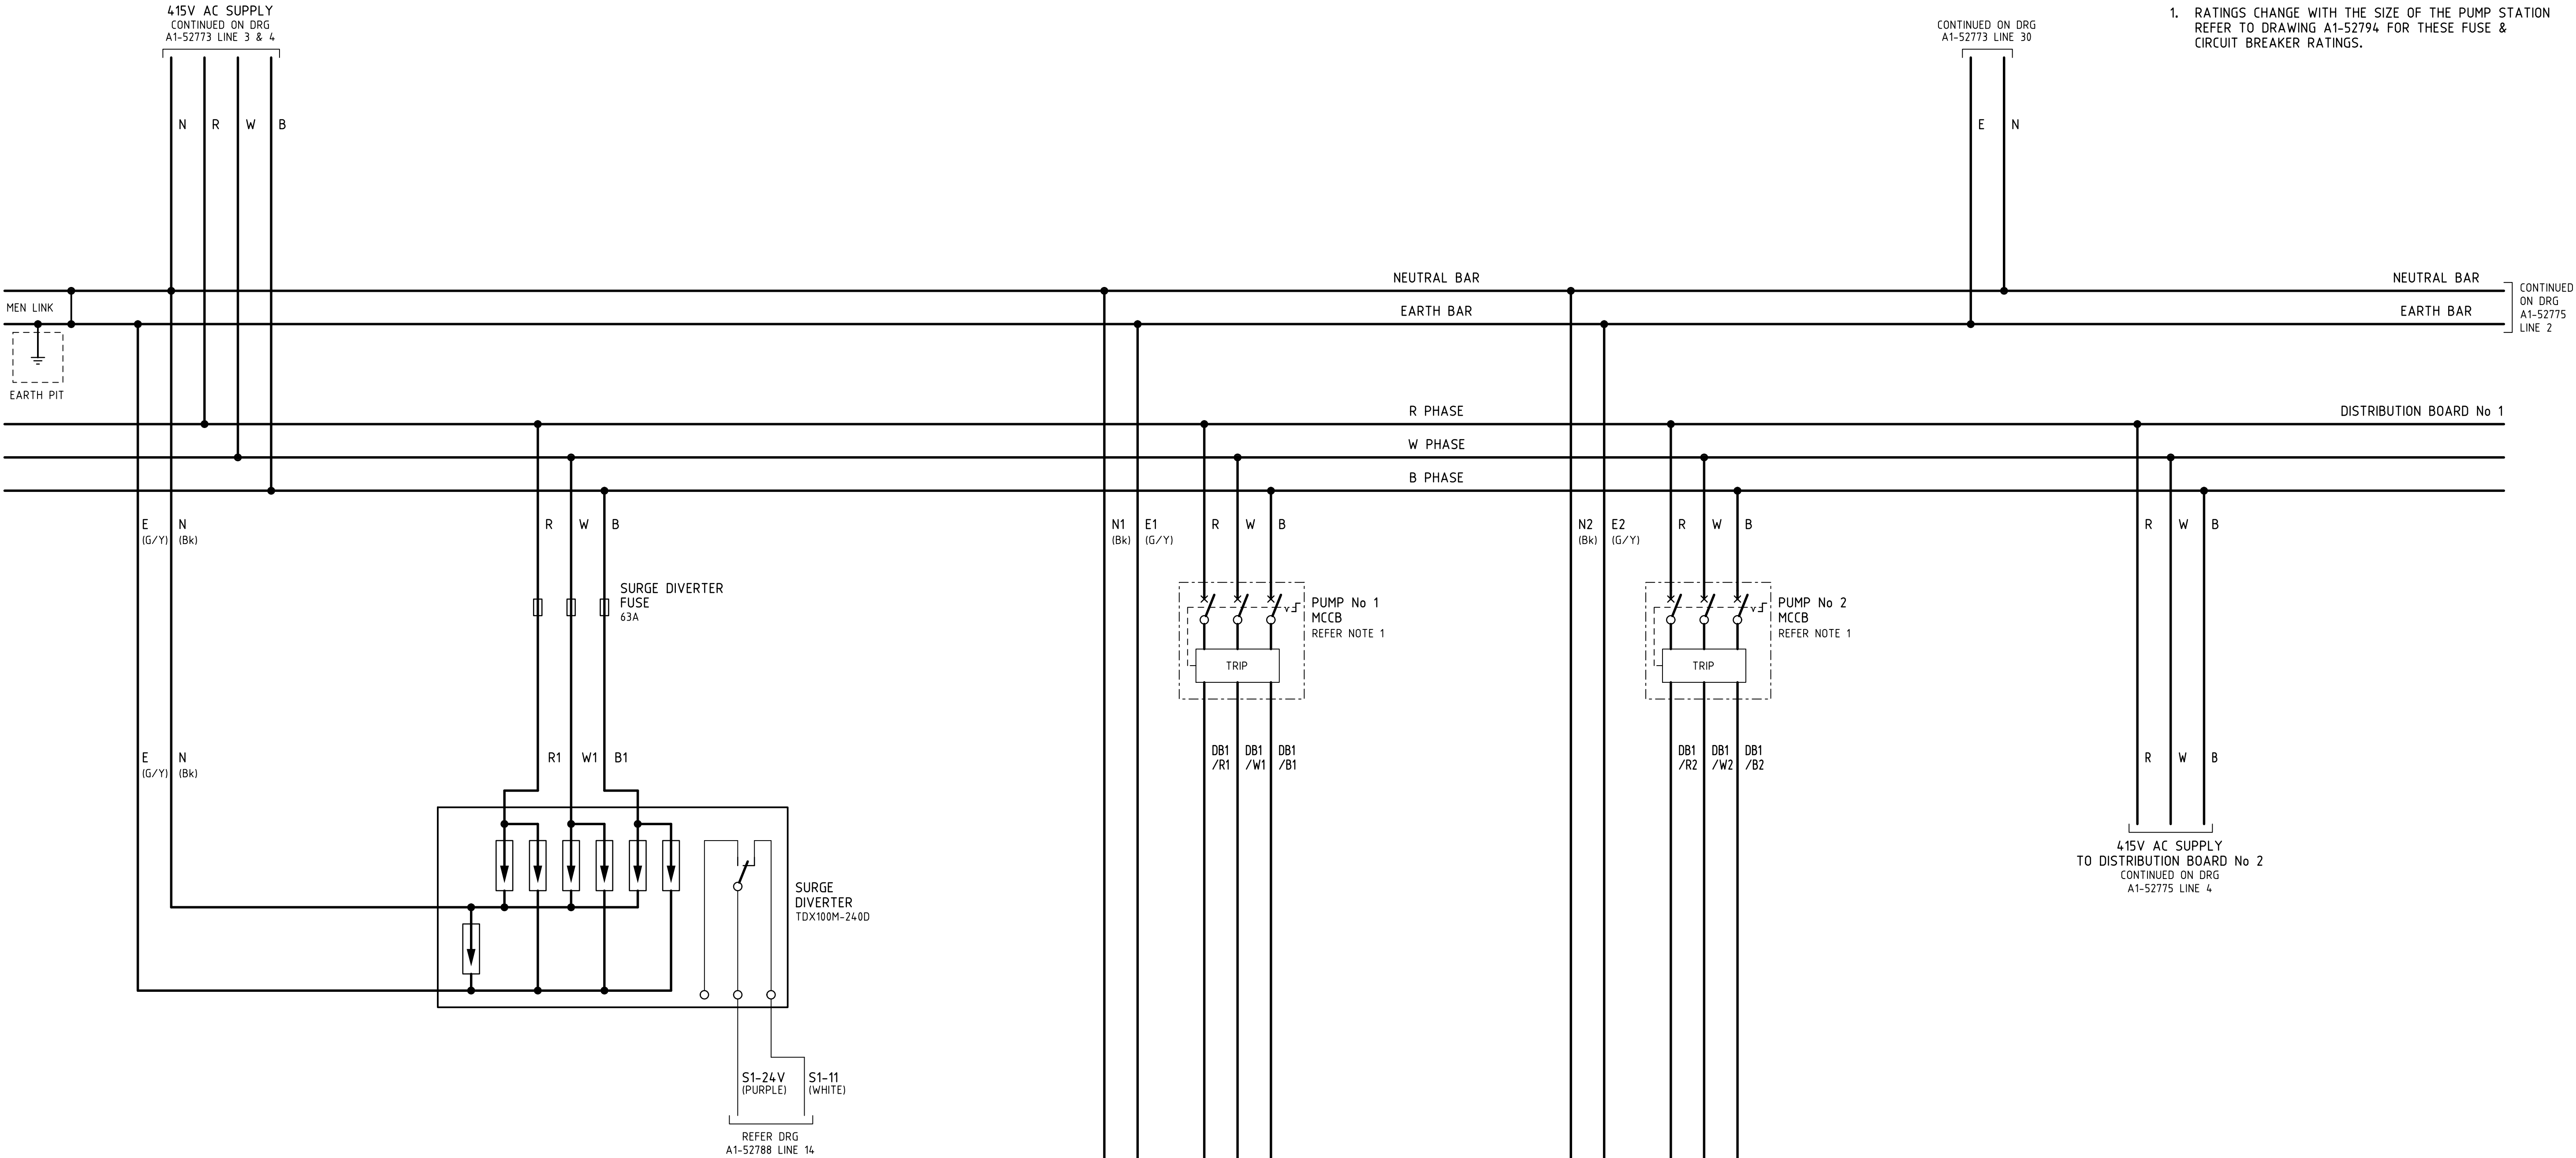

NOTES:

1. RATINGS CHANGE WITH THE SIZE OF THE PUMP STATION
REFER TO DRAWING A1-52794 FOR THESE FUSE &
CIRCUIT BREAKER RATINGS.

VSD & PHF
COMPARTMENTS

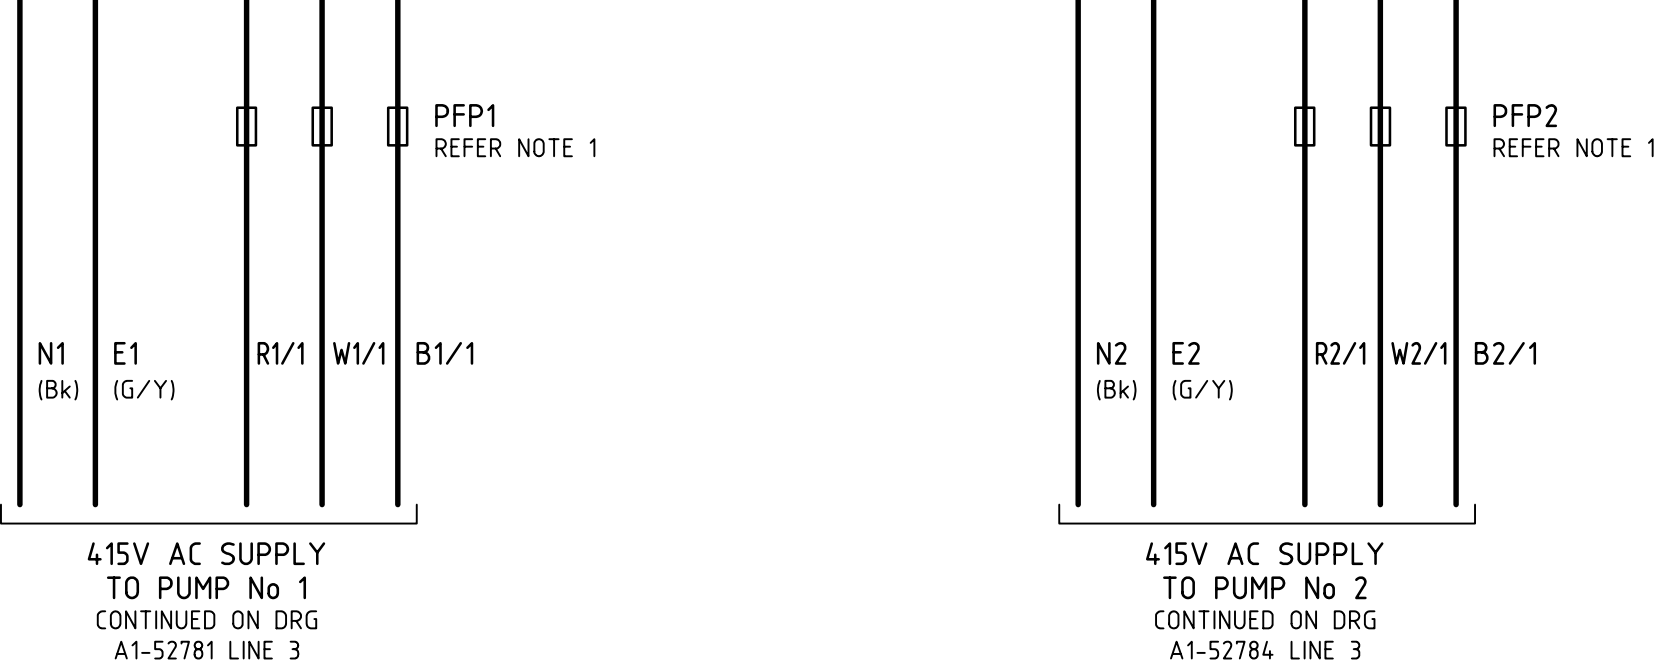

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38

REVISONS	5	21/5/21	REMOVED FAULT CURRENT LIMITER FUSES.	P.S.	REFERENCES		
	4	7/9/20	UPDATED DRAWING SHEETS.	P.S.			
	3	25/10/13	REVISED NOTE 1 DETAILS.	P.J.			
	2	9/10/13	REVISED DRAWING.	M.B.			
	1	18/3/13	ADDED EARTH TO EARTH BAR.	P.J.			
	0	24/9/12	INITIAL ISSUE.	P.J.			
No.	DATE	DESCRIPTION			APP'D	PLAN No.	TITLE

DESIGNED BY:



DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 25/01/2018 - STD DRG
DRAWN: 25/01/2018 - OPT/CT
CHECKED: 25/01/2018 - P STEWART

GIPPSLAND WATER

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
MAIN DISTBN COMPT - POWER & CONTROL SUPPLIES
ELECTRICAL SCHEMATIC DIAGRAM - SHEET 2 OF 3

GIPPSLAND WATER FACILITY CODE
XXCPXX

DRAWING No. A1-52774
REV. 5