

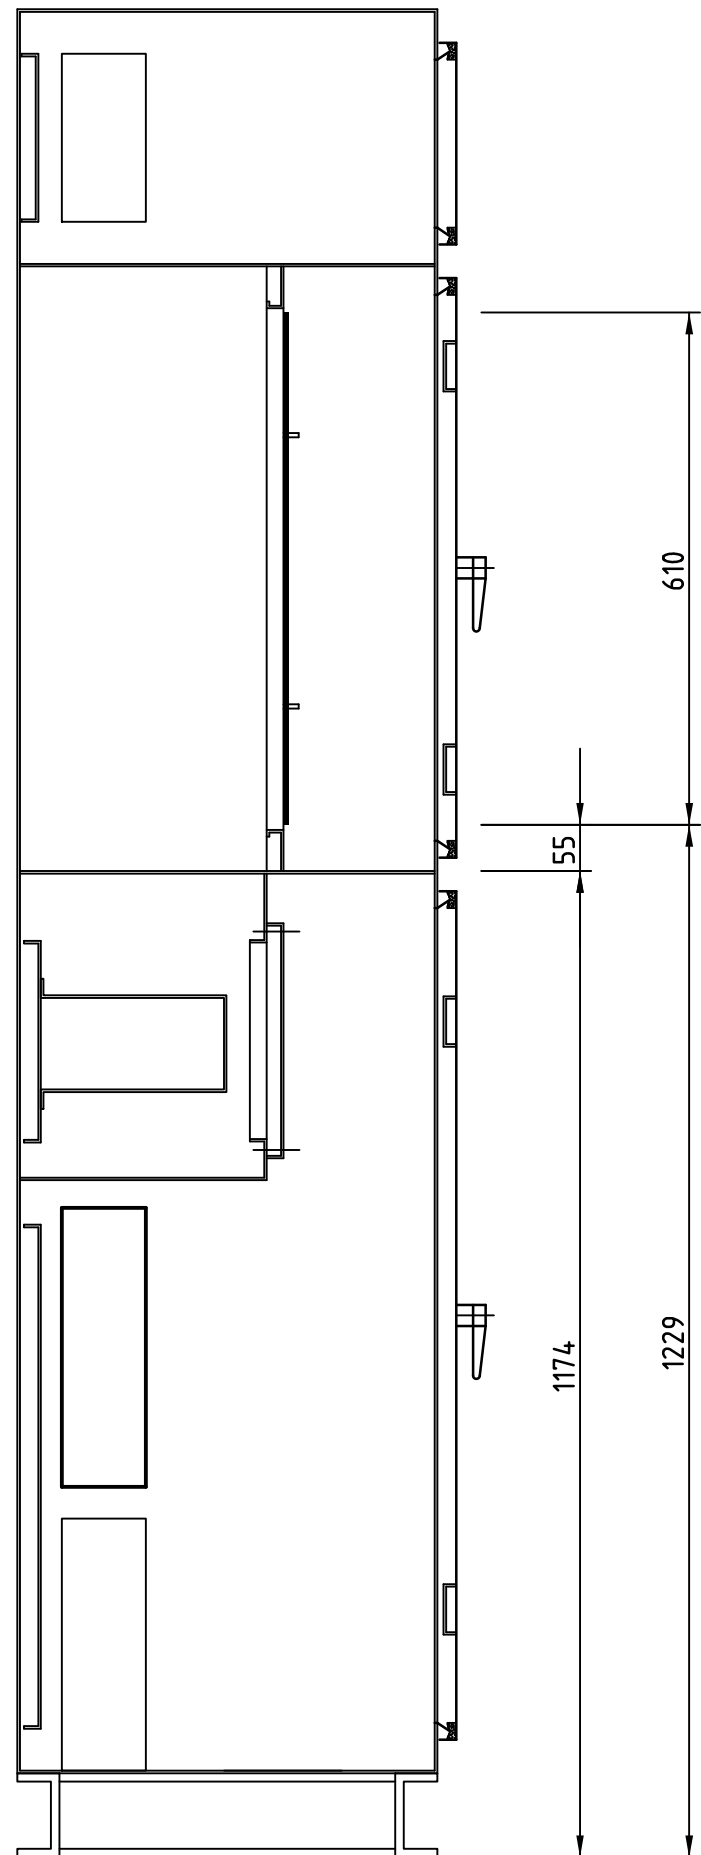
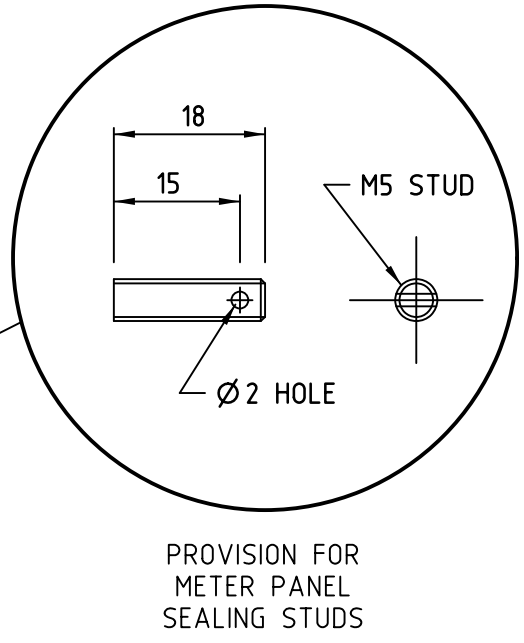
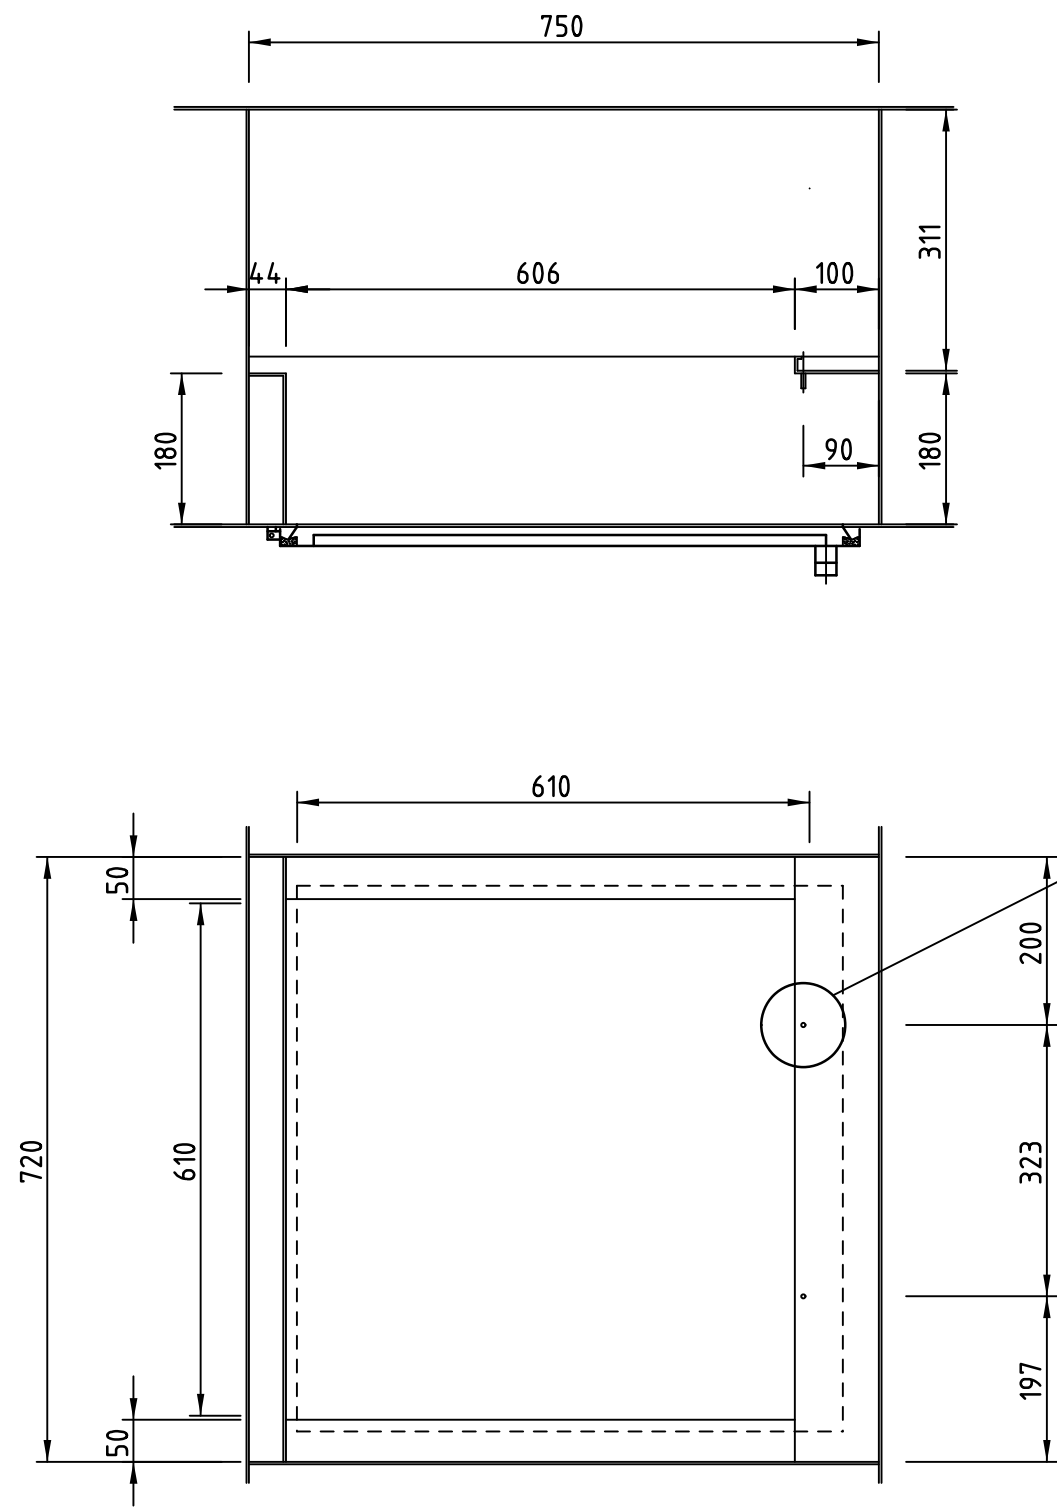


METERING COMPARTMENT DETAILS

SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.
CUBICLE IP RATING: IP55
VENTILATION REQUIREMENTS FOR METERING COMPARTMENT:
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF PROTECTION OF IP23.

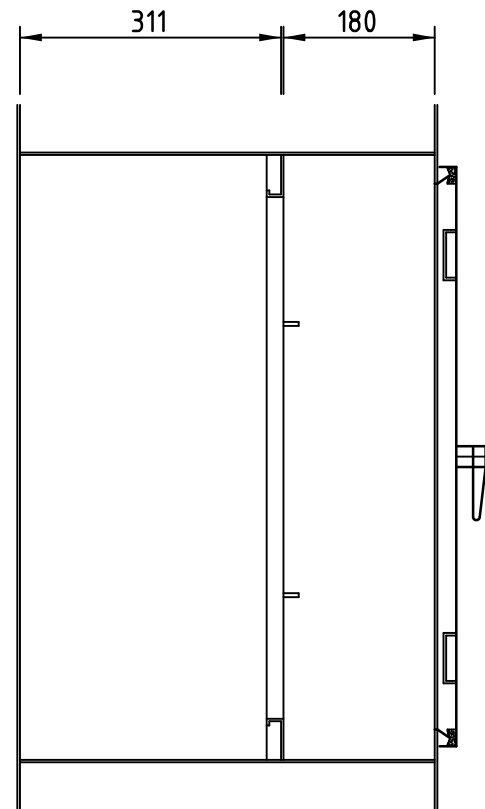

BASE OF METER PANEL
FLOOR OF METER PANEL COMPARTMENT

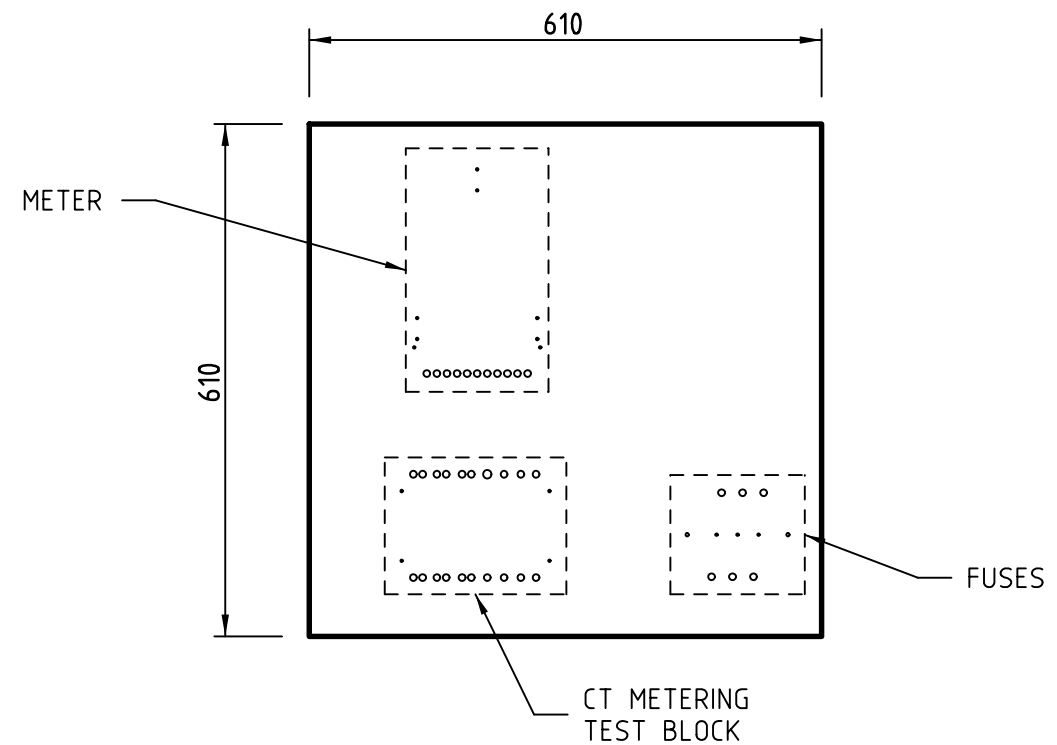

METERING
FOR GEAR TRAY CONFIGURATION
REFER SIR-2014
FIGURE 8.11-G

REV. NO.	DATE	DESCRIPTION	APP'D	P.S.	P.J.	REFERENCES	PLAN No.	TITLE
1	7/9/20	UPDATED DRAWING SHEETS.		P.S.				
0	24/9/12	INITIAL ISSUE.		P.J.				

DESIGNED BY:

OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

GIPPSLAND WATER
DRAWING STATUS

STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE
XXCPXX

DRAWING No.
A1-52798

REV.
1

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 25/01/2018 - STD DRG
DRAWN: 25/01/2018 - OPT/CT
CHECKED: 25/01/2018 - P STEWART

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
SUPPLY CUBICLE
METERING COMPARTMENT DETAILS