




SECTION "B-B"

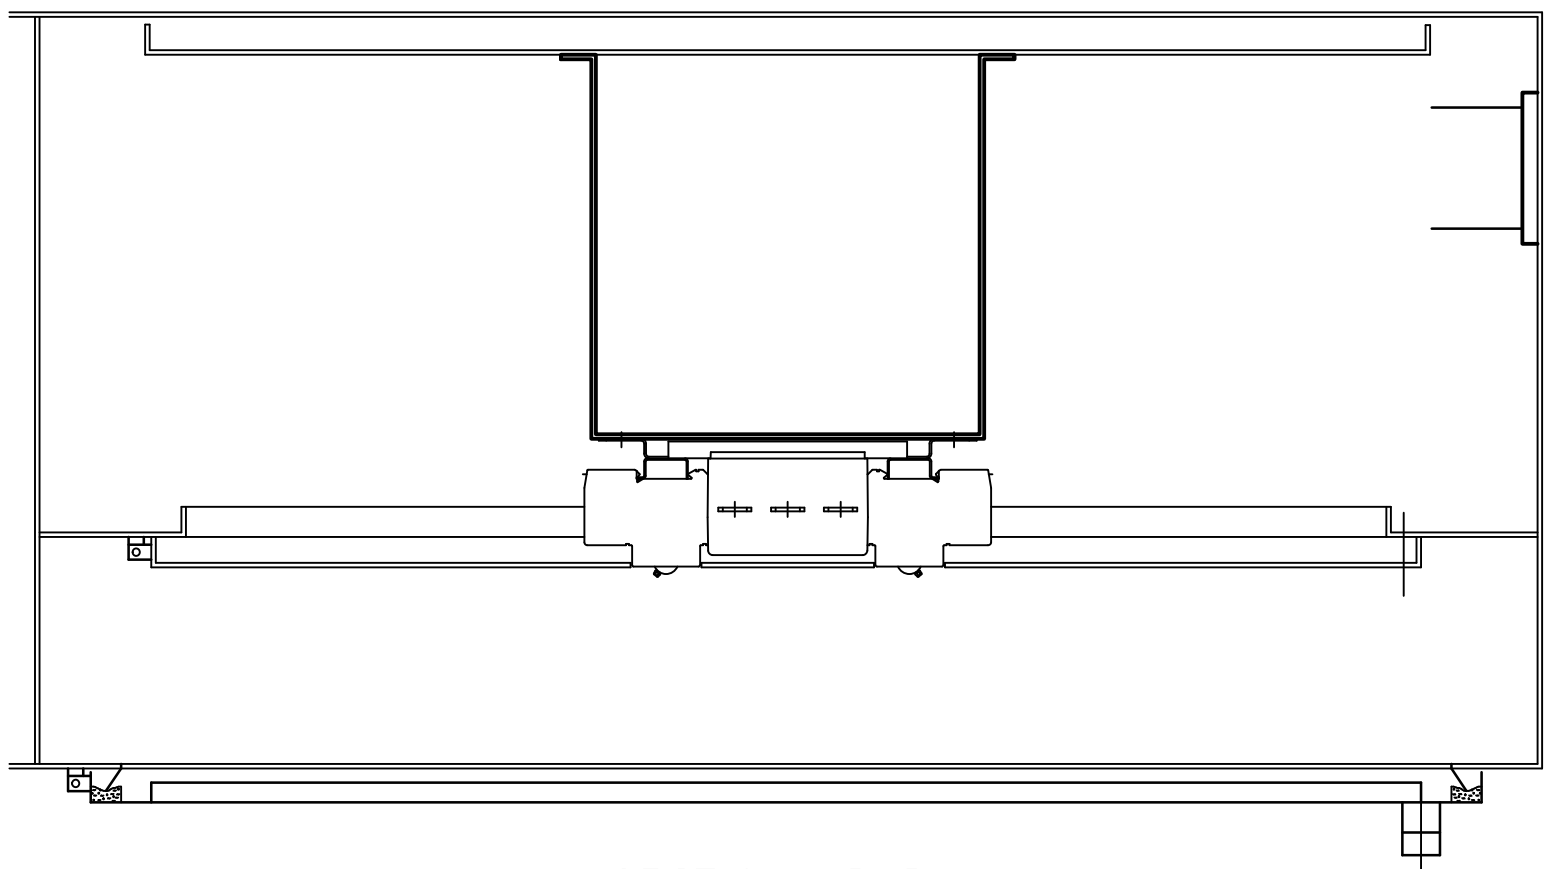


SECTION "D-D"

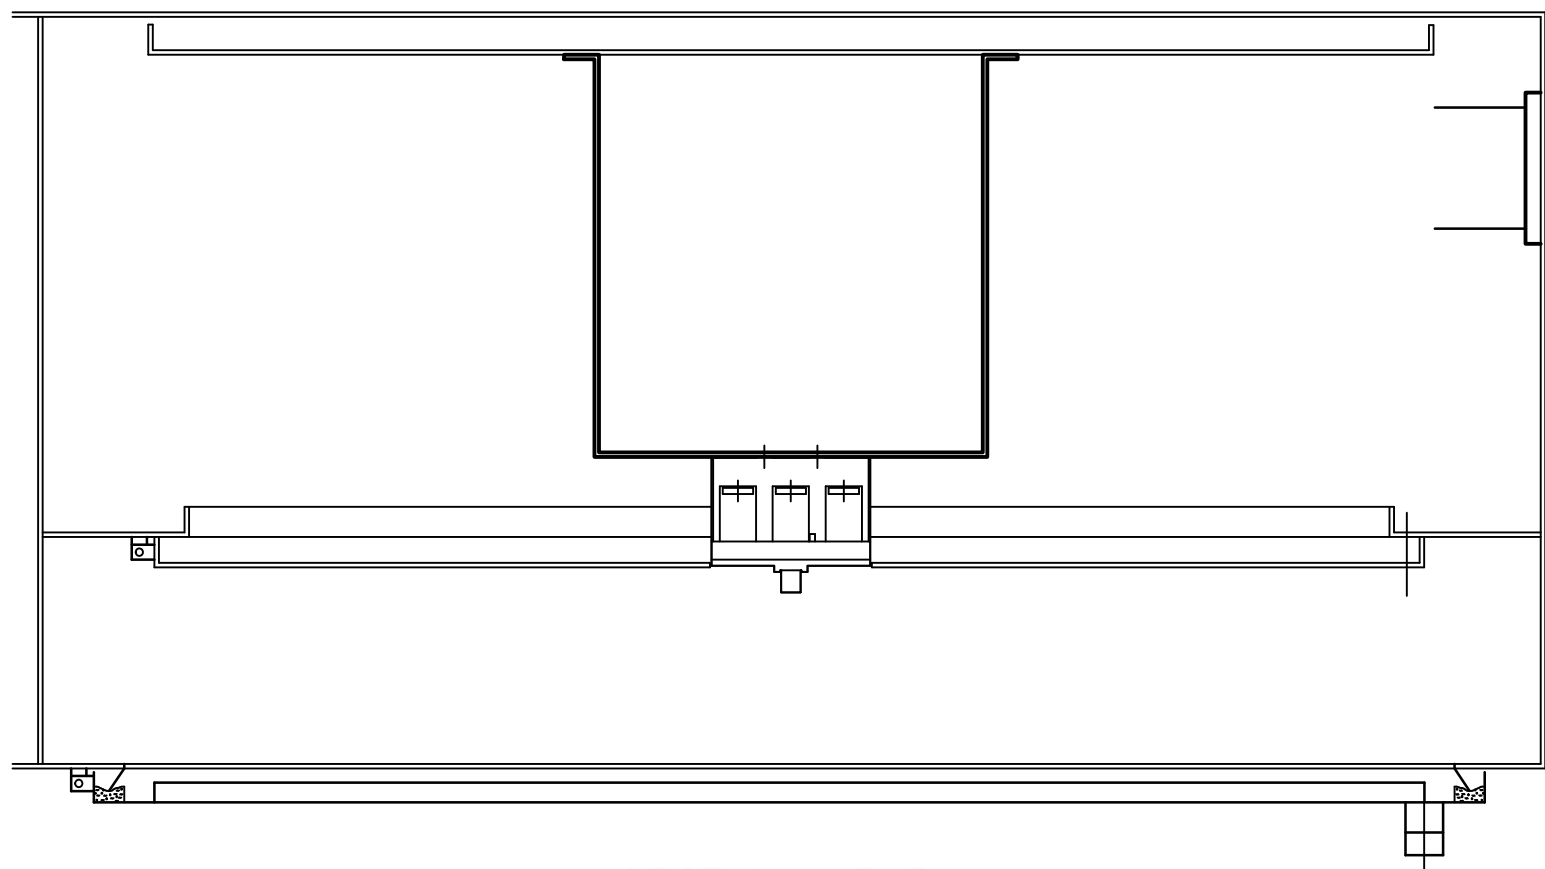


SECTION "E-E"

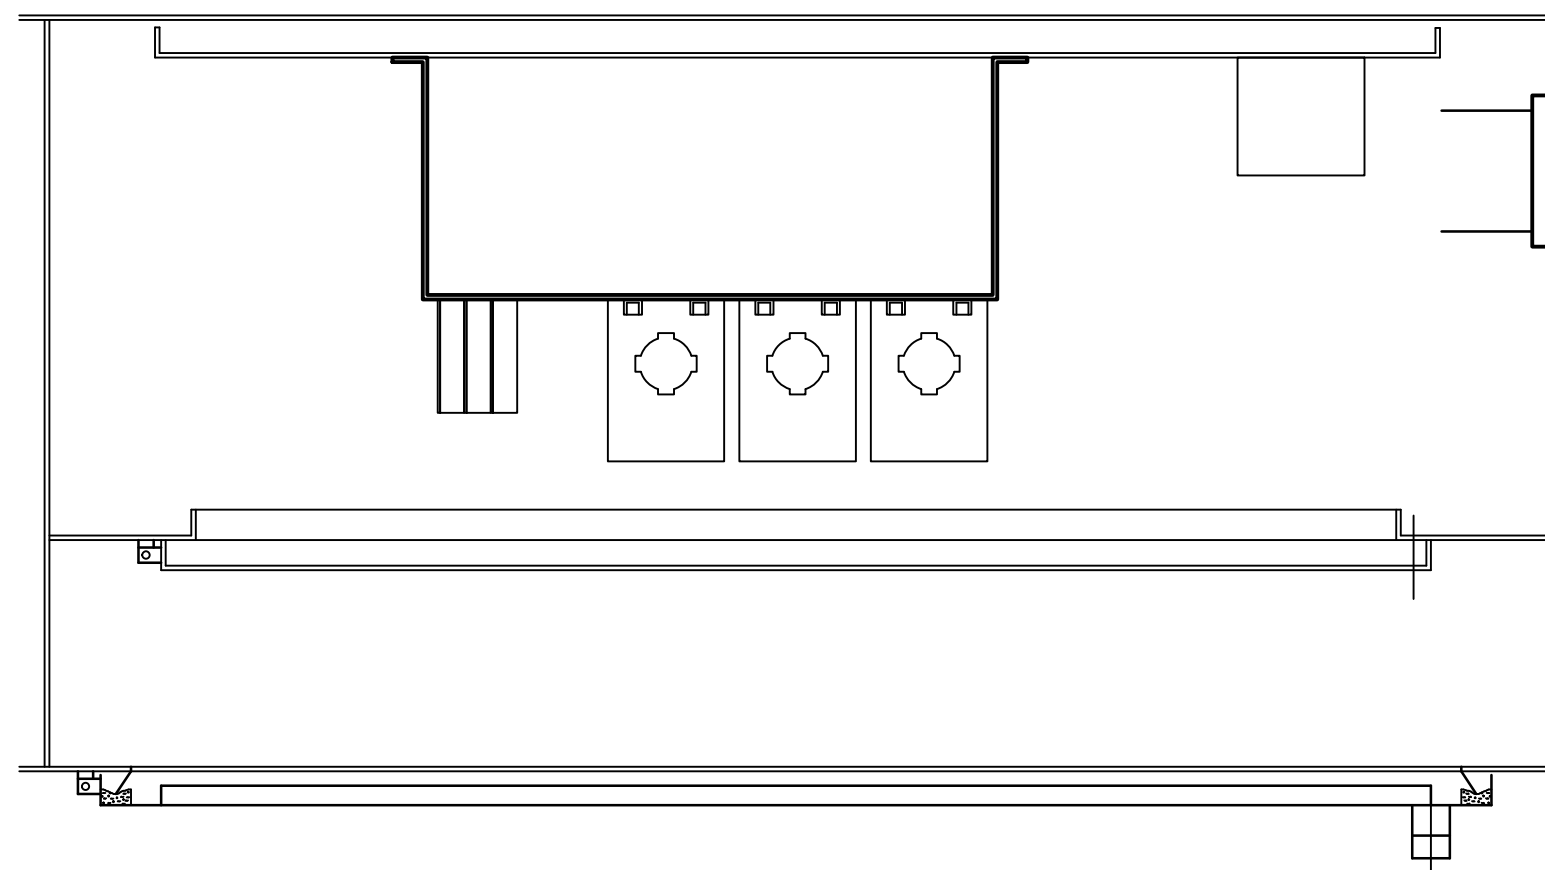


SECTION "C-C"

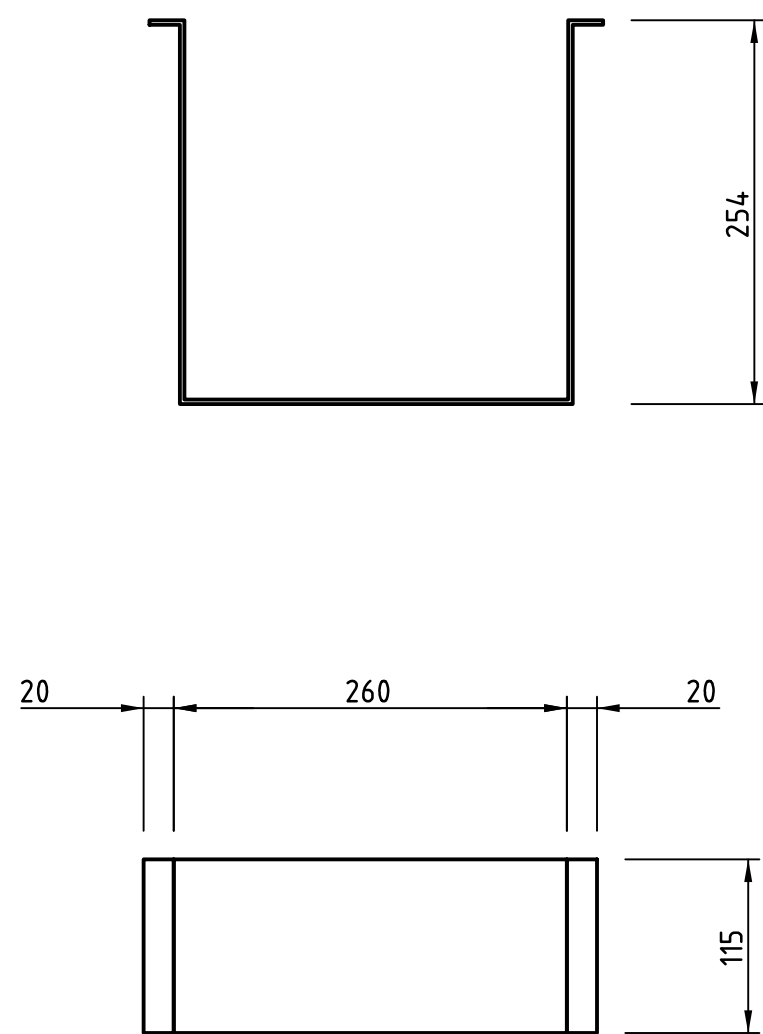


MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 1 TOP HAT DETAILS

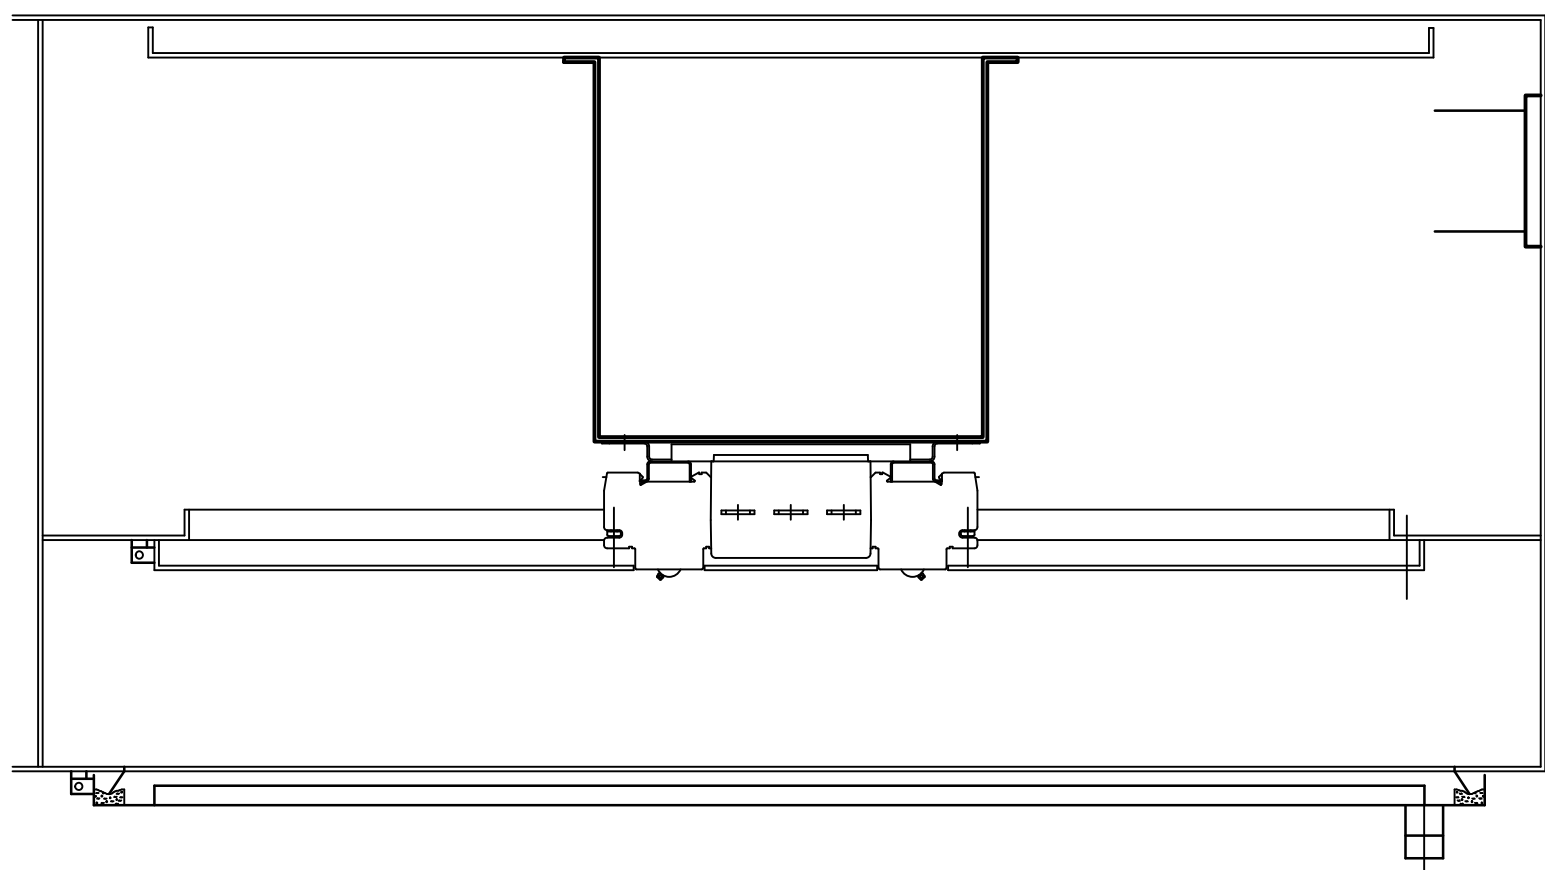


SECTION "F-F"

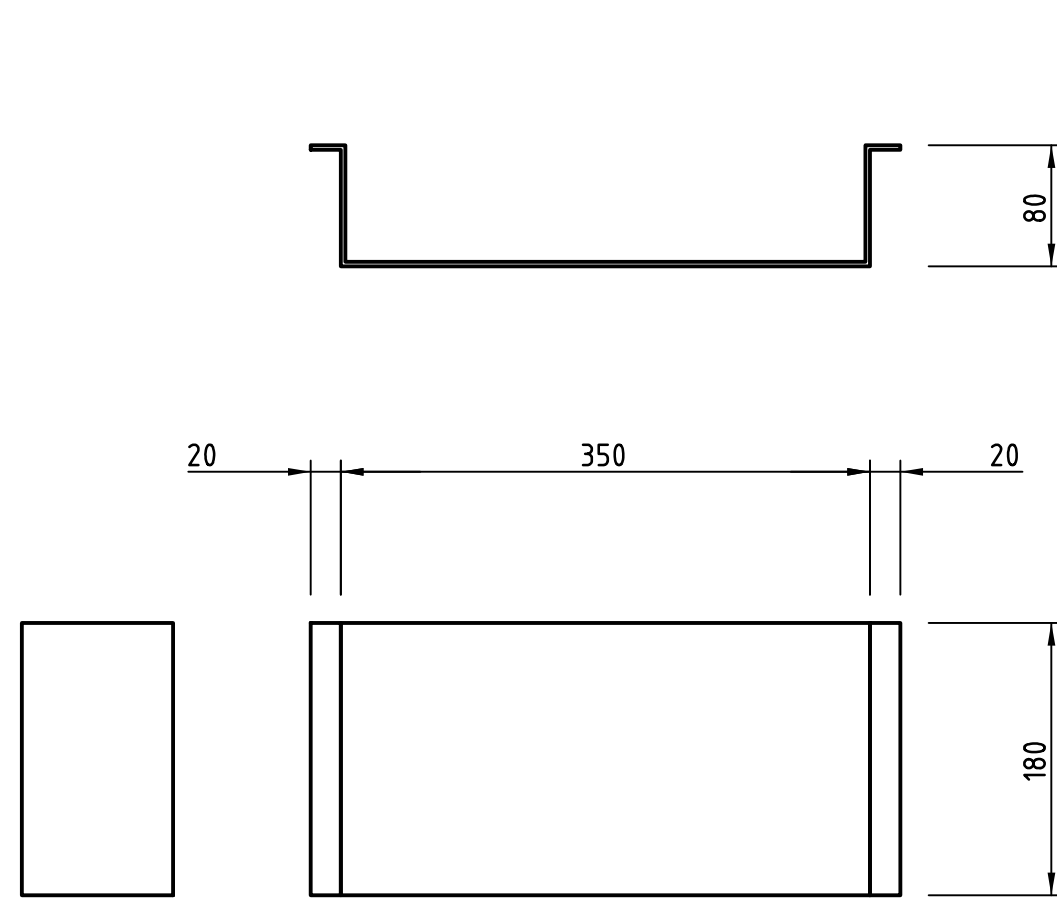


MAIN DISTRIBUTION COMPARTMENT -
CHANGEOVER SWITCH TOP HAT DETAILS

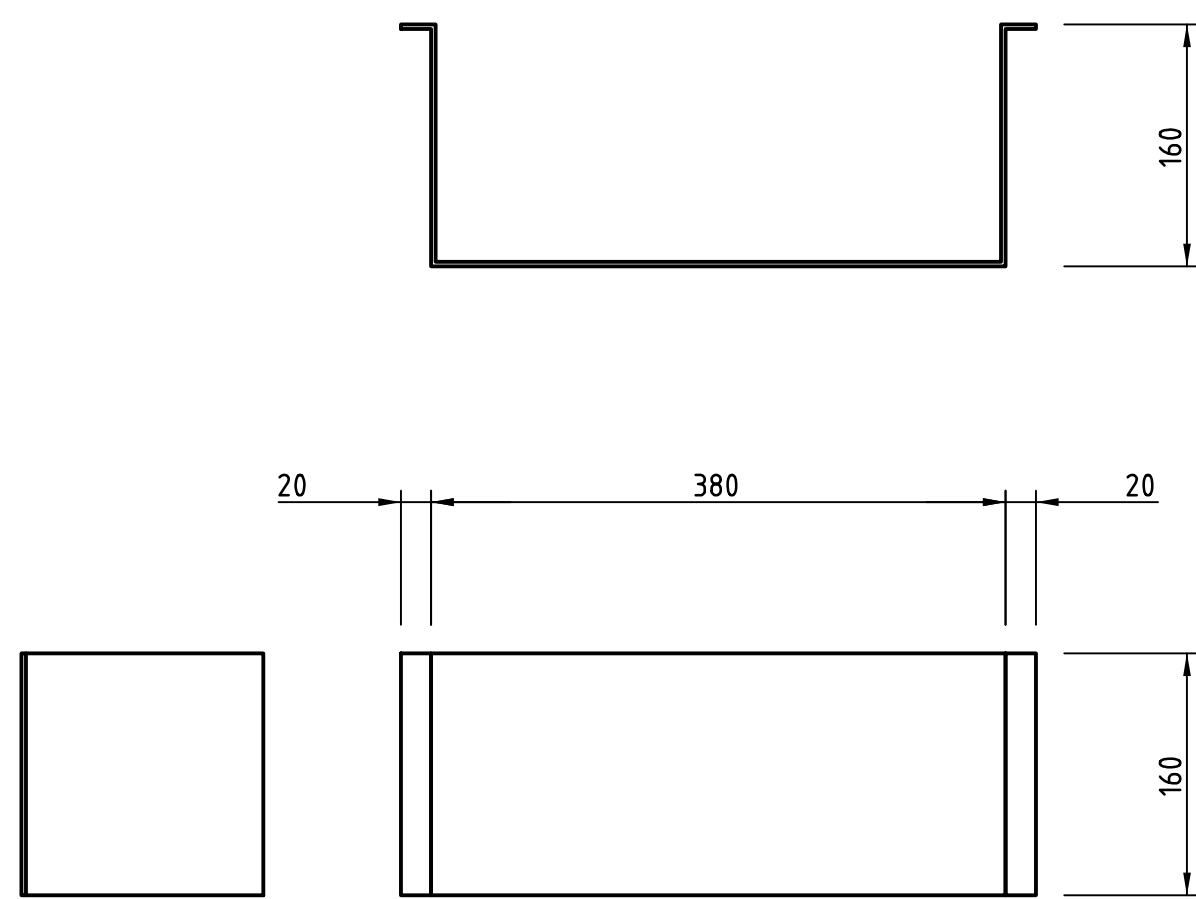

MAIN DISTRIBUTION COMPARTMENT -
CT TOP HAT DETAILS

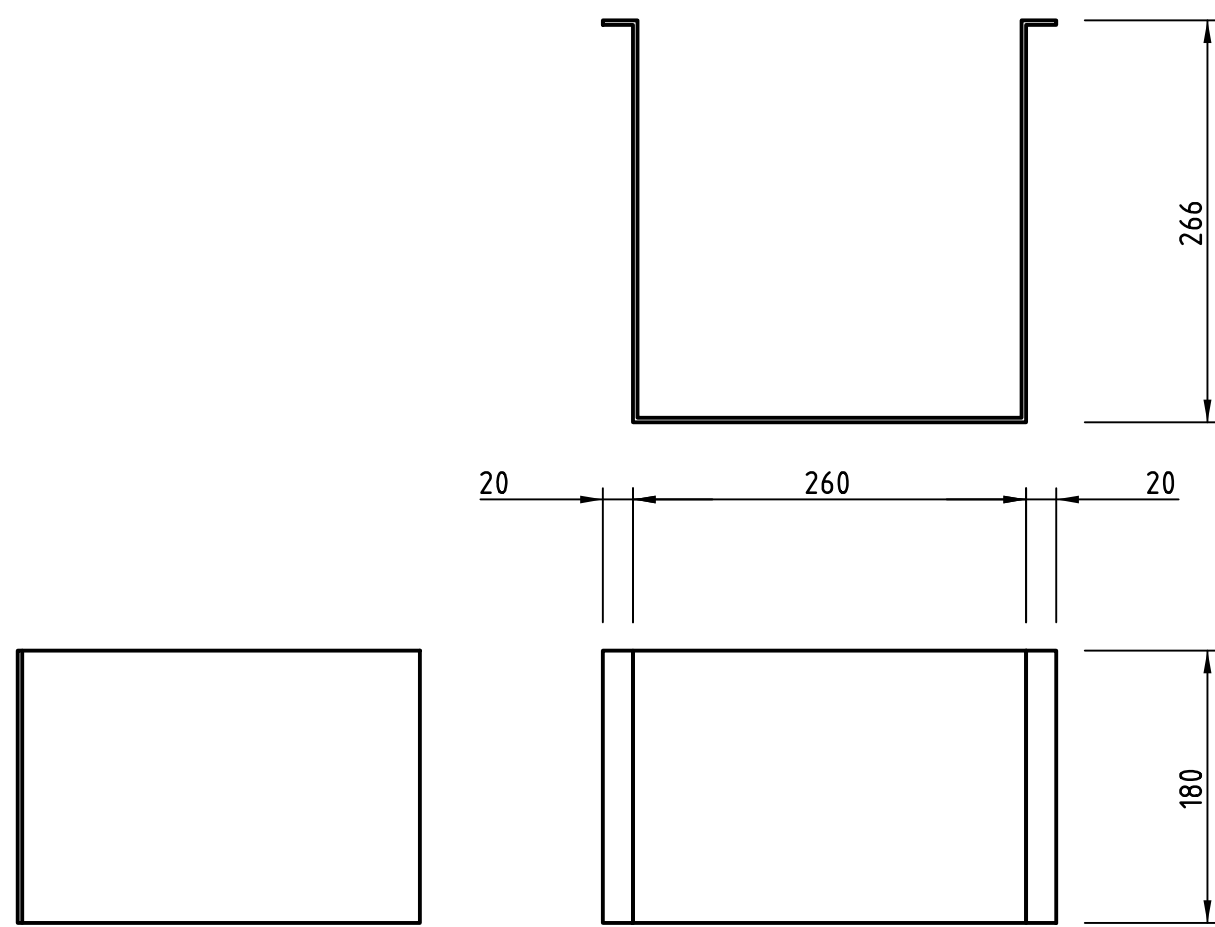

MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 2 MAIN SWITCH TOP HAT DETAILS

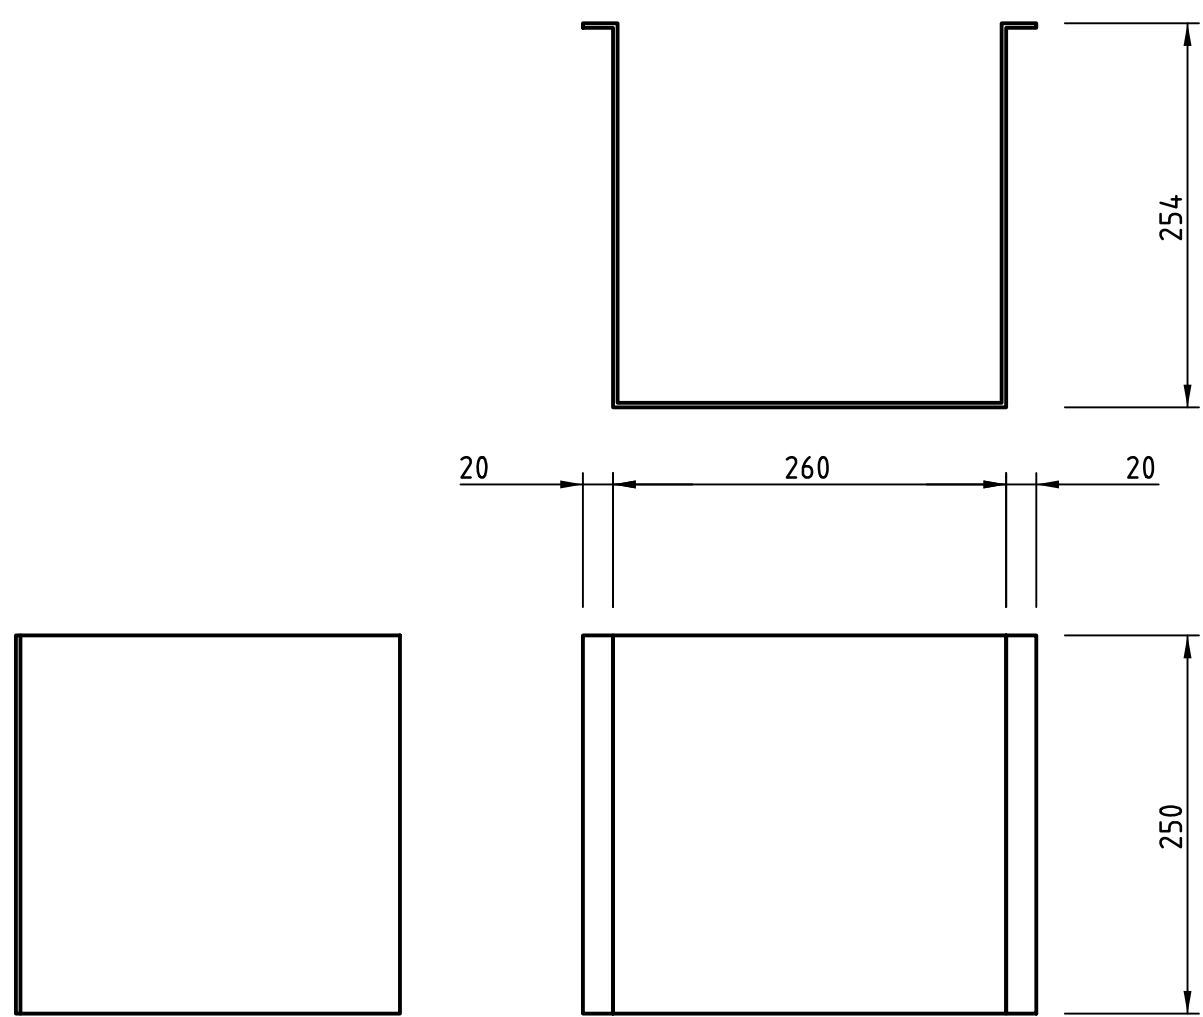


MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 2 TOP HAT DETAILS

REVISONS				REFERENCES		
	No.	DATE	DESCRIPTION		PLAN No.	TITLE
	3	18/5/21	SCOMEC SWITCH CHANGED TO 4 POLE.			
	2	7/9/20	UPDATED DRAWING SHEETS.			
	1	9/10/13	REVISED DRAWING.			
	0	24/9/12	INITIAL ISSUE.			

DESIGNED BY:



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX		
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		GIPPSLAND WATER		DRAWING No. A1-52808	REV. 3
		STANDARD SEWERAGE PUMP STATION PUMP STATION 30kw TO 160kw (VSD) - CT METERED SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY & ESCUTCHEON DOOR LAYOUT - 37kw - SHEET 3 OF 3			
DESIGNED: 25/01/2018 - STD DRG					
DRAWN: 25/01/2018 - OPT/CT					
CHECKED: 25/01/2018 - P STEWART					