


"B"
A1-52814

"C"
A1-52814


"D"
A1-52814

"E"
A1-52814

"F"
A1-52814

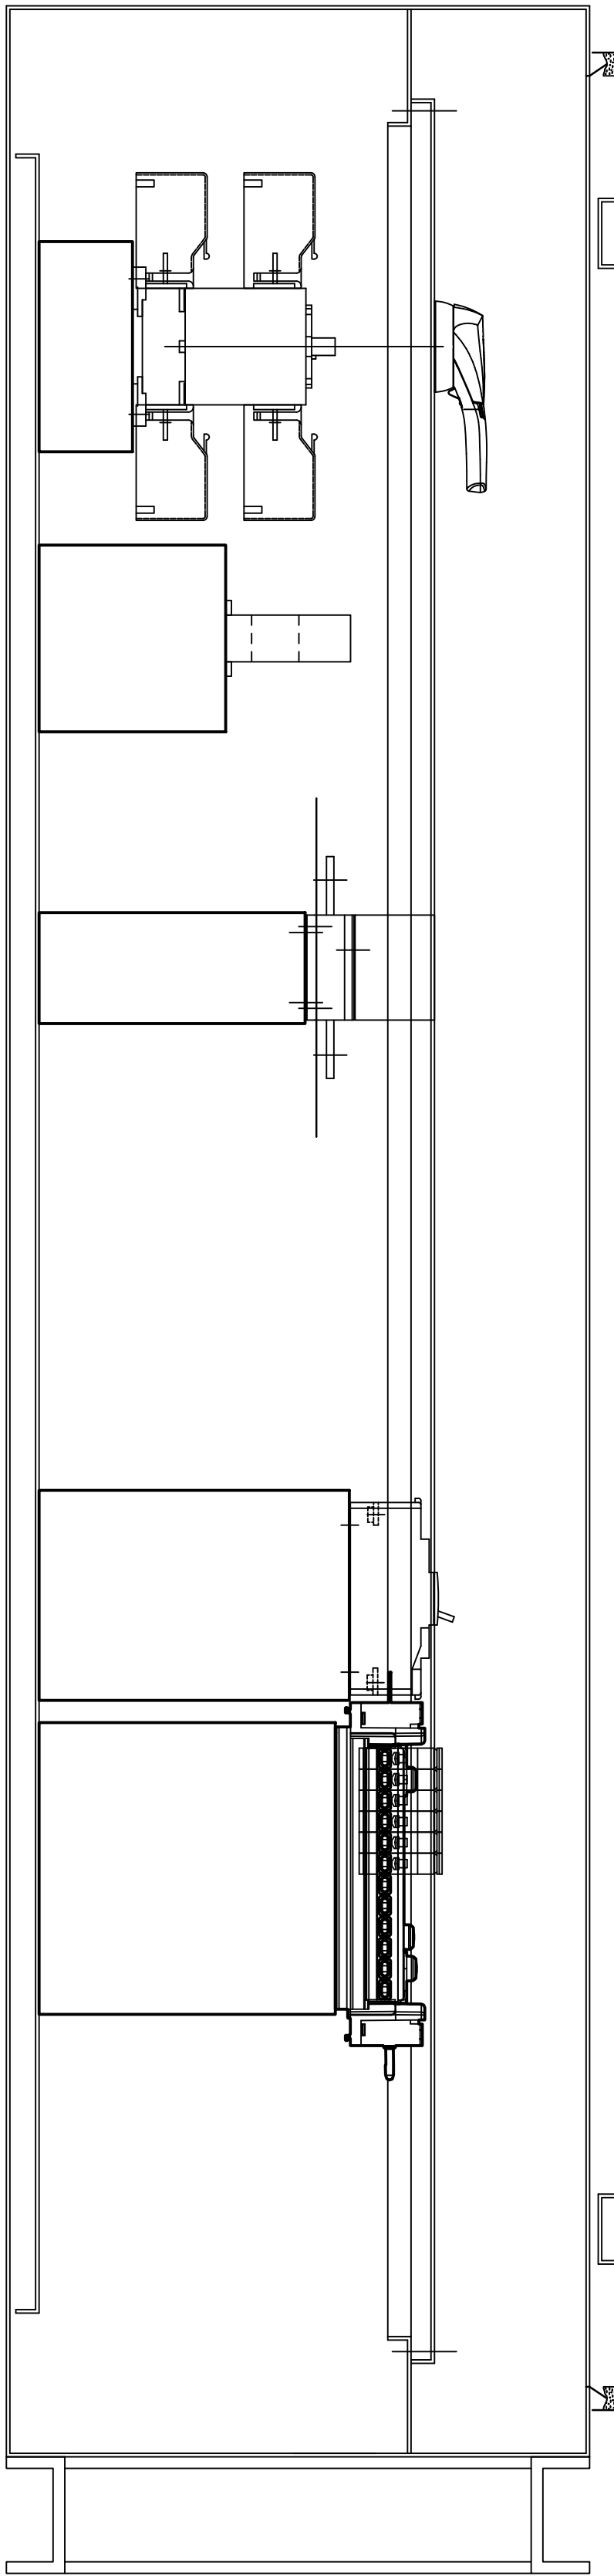

SECTION "A-A"

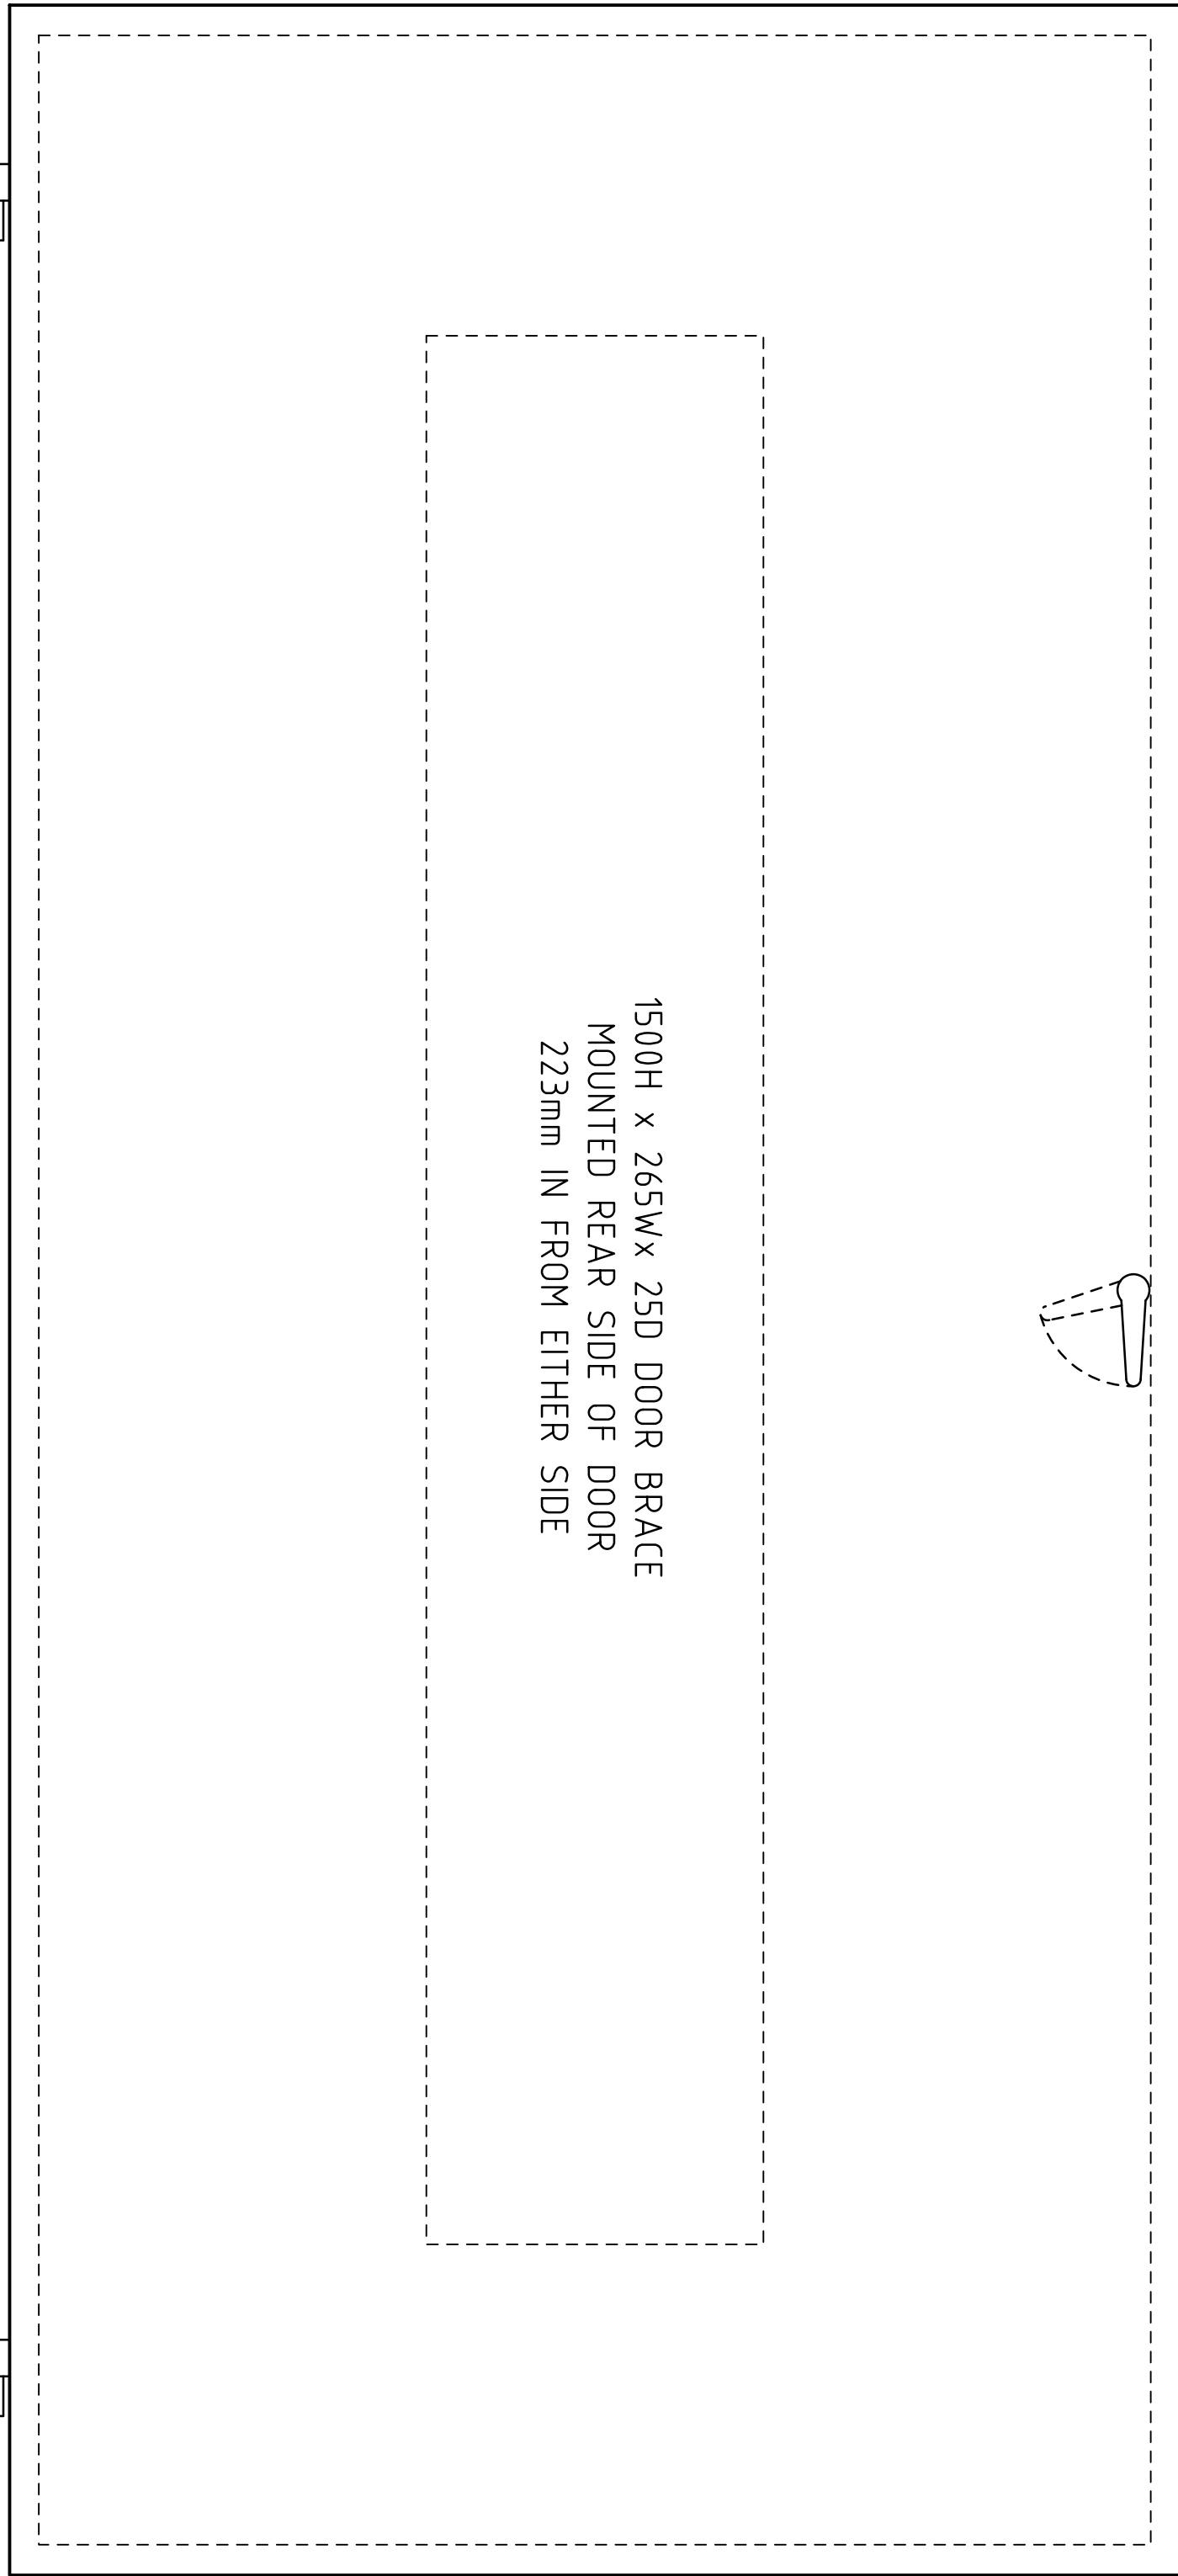

No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
3	18/5/21	SCOMEC SWITCH CHANGED TO 4 POLE.	P.S.			
2	7/9/20	UPDATED DRAWING SHEETS.	P.S.			
1	9/10/13	REVISED DRAWING.	M.B.			
0	24/9/12	INITIAL ISSUE.	P.J.			

DESIGNED BY:



DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 25/01/2018 - STD DRG
DRAWN: 25/01/2018 - OPT/CT
CHECKED: 25/01/2018 - P STEWART

GIPPSLAND WATER

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY
& ESCUTCHEON DOOR LAYOUT - 55kW - SHEET 2 OF 3

GIPPSLAND WATER FACILITY CODE
XXCPXX

DRAWING No.
A1-52813

REV.
3