


NOTE:
DO NOT PAINT OR POWDER COAT
THE VSD/PHF GEAR TRAY

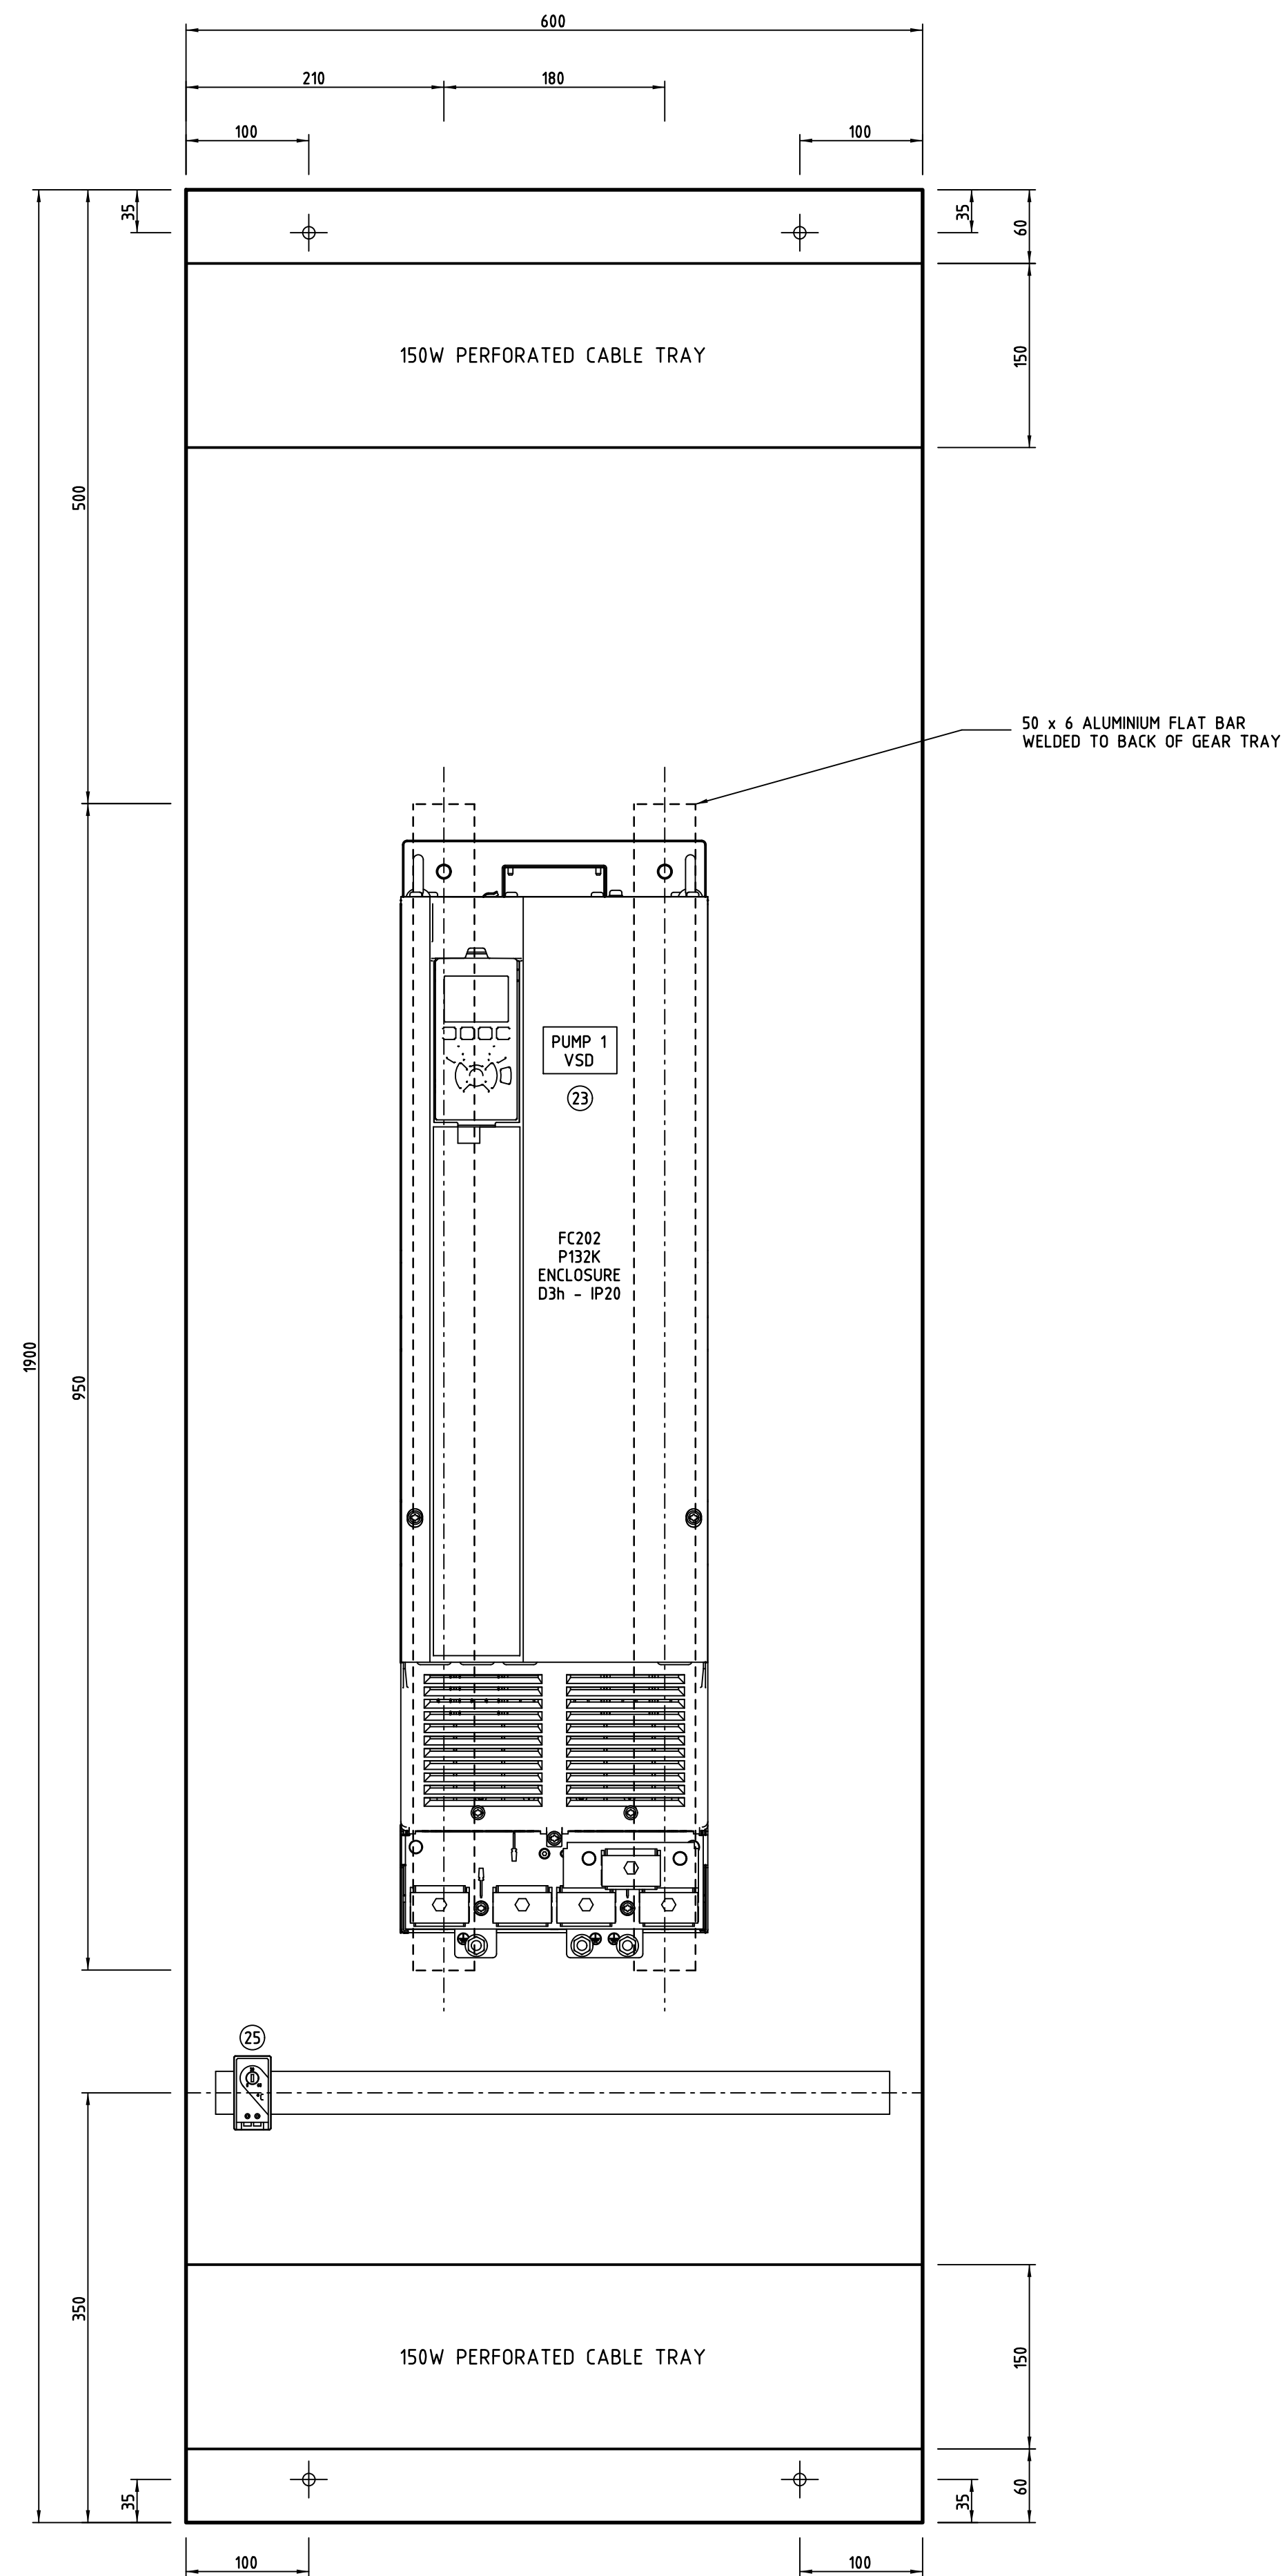

REVISIONS

No.	DATE	DESCRIPTION	APP'D
3	10/10/21	ADDED VSD GEAR TRAY.	P.S.
2	7/9/20	UPDATED DRAWING SHEETS.	P.S.
1	9/10/13	REVISED DRAWING.	M.B.
0	24/9/12	INITIAL ISSUE.	P.J.

REFERENCES	PLAN No.	TITLE
A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX	

DESIGNED BY:



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		DRAWING No. A1-52838 REV. 3	
DESIGNED: 25/01/2018 - STD DRG		STANDARD SEWERAGE PUMP STATION PUMP STATION 30kW TO 160kW (VSD) - CT METERED VSD P132K & AHF 130B1215 (251A) GEAR TRAY LAYOUT	
DRAWN: 25/01/2018 - OPT/CT			
CHECKED: 25/01/2018 - P STEWART			