


NOTE:
DO NOT PAINT OR POWDER COAT
THE VSD/PHF GEAR TRAY

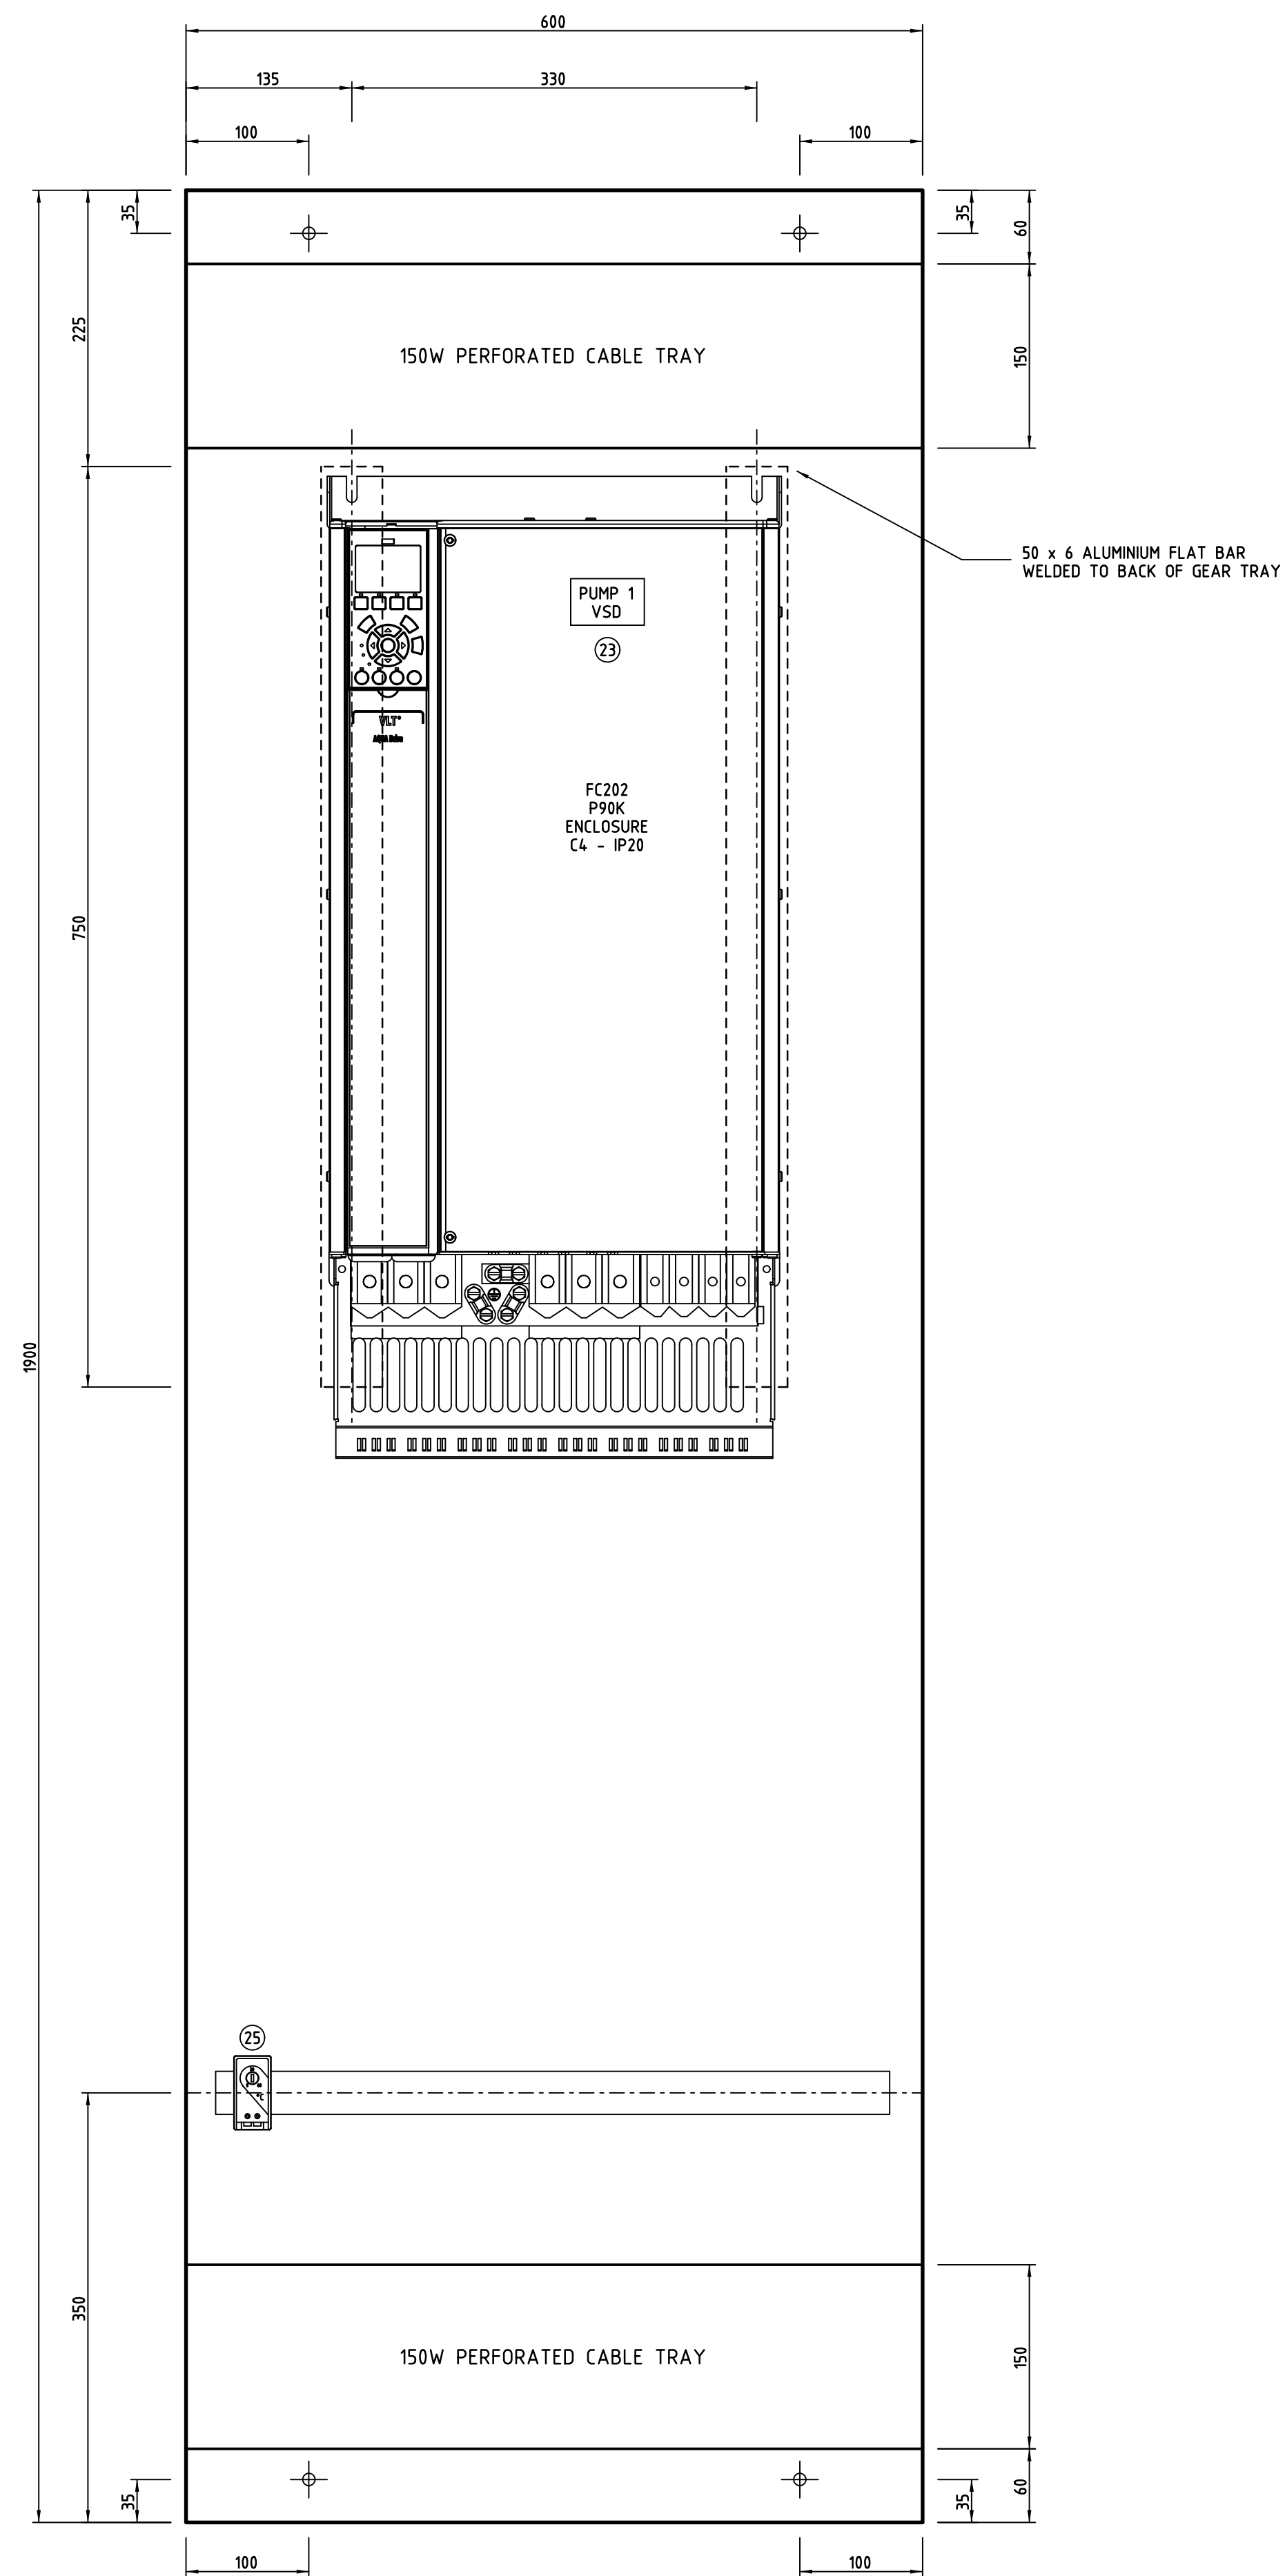

REVISIONS

No.	DATE	DESCRIPTION	APP'D
3	10/10/21	REVISED DRAWING TITLE.	P.S.
2	7/9/20	UPDATED DRAWING SHEETS.	P.S.
1	9/10/13	REVISED DRAWING.	M.B.
0	24/9/12	INITIAL ISSUE.	P.J.

REFERENCES

PLAN No.	TITLE
A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX

DESIGNED BY:



DO NOT SCALE

GIPPSLAND WATER
DRAWING STATUS

STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE


XXCPXX

DRAWING No.

A1-52833

REV.

3

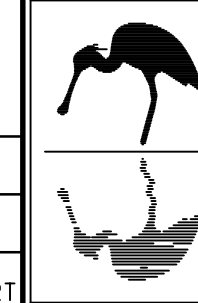

GIPPSLAND WATER

STANDARD SEWAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
VSD P90K & AHF 130B1213 (171A)
GEAR TRAY LAYOUT