
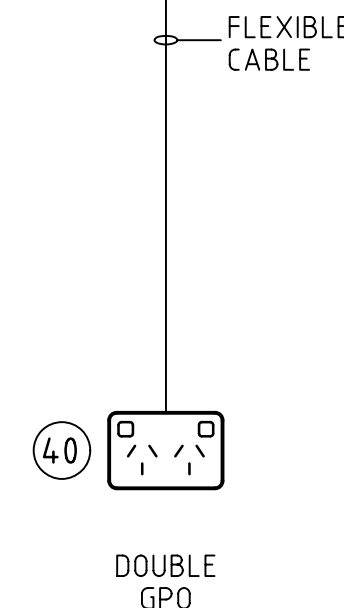



CONTINUED  
ON DRG  
A1-47776  
LINE 21

415V 3Ø

COMPARTMENT  
W2  
11-22-5  
RCD  
16A 6kV  
5

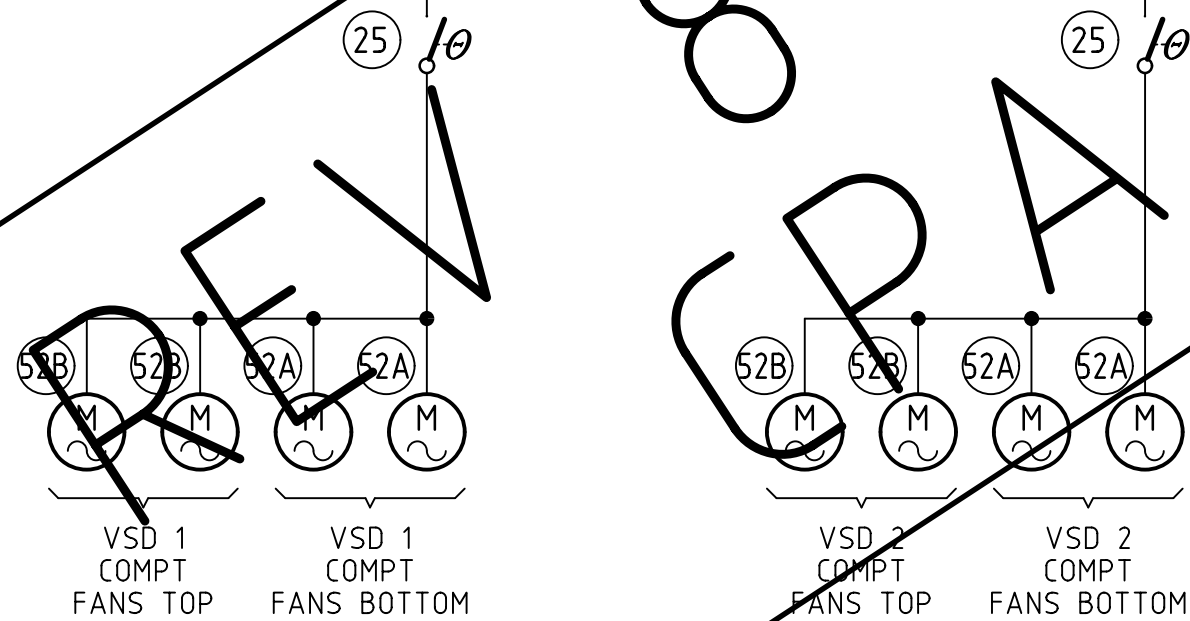

VSD & PHF COMPARTMENT

TELEMETRY COMPARTMENT

ESCUTCHEON PANEL

CONTROL & DISTRIBUTION COMPARTMENT

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31

REVISIONS

7	4/06/15	DELETED COMPARTMENT LIGHTS.	M.S.
6	8/10/13	REVISED DRAWING.	M.B.
5	15/5/12	ADDED VSD COMPT FANS	CW P.J.
4	26/11/10	REVISED PARTS NUMBERS.	P.J.
3	26/9/10	REVISED AS PER CLIENTS COMMENTS	CEDcsi
2	26/8/10	FINAL REVISED AS PER CLIENTS COMMENTS	CEDcsi
No.	DATE	DESCRIPTION	APP'D

REFERENCES

A1-47775	STANDARD SPS - PUMP STATION 7.5kW TO 22kW (VSD) - I & C - DRAWING INDEX
PLAN No.	TITLE

DESIGNED BY:

DO NOT SCALE

GIPPSLAND WATER  
DRAWING STATUS


STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE

-

CERTIFICATION OF  
COMPLIANCE WITH  
GIPPSLAND WATER'S  
DESIGN & DRAFTING  
REQUIREMENTS.

DESIGNED:  
/ / -  
DRAWN:  
19/07/2010 - CEDcsi  
CHECKED:  
/ / -

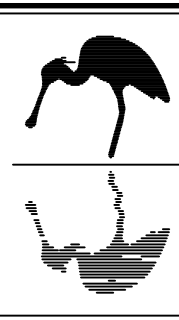

GIPPSLAND WATER

DRAWING No. A1-47777 REV. 8

STANDARD SEWERAGE PUMP STATION  
PUMP STATION 7.5kW TO 22kW (VSD)  
POWER & CONTROL SUPPLIES  
SINGLE LINE DIAGRAM - SHEET 2 OF 2