

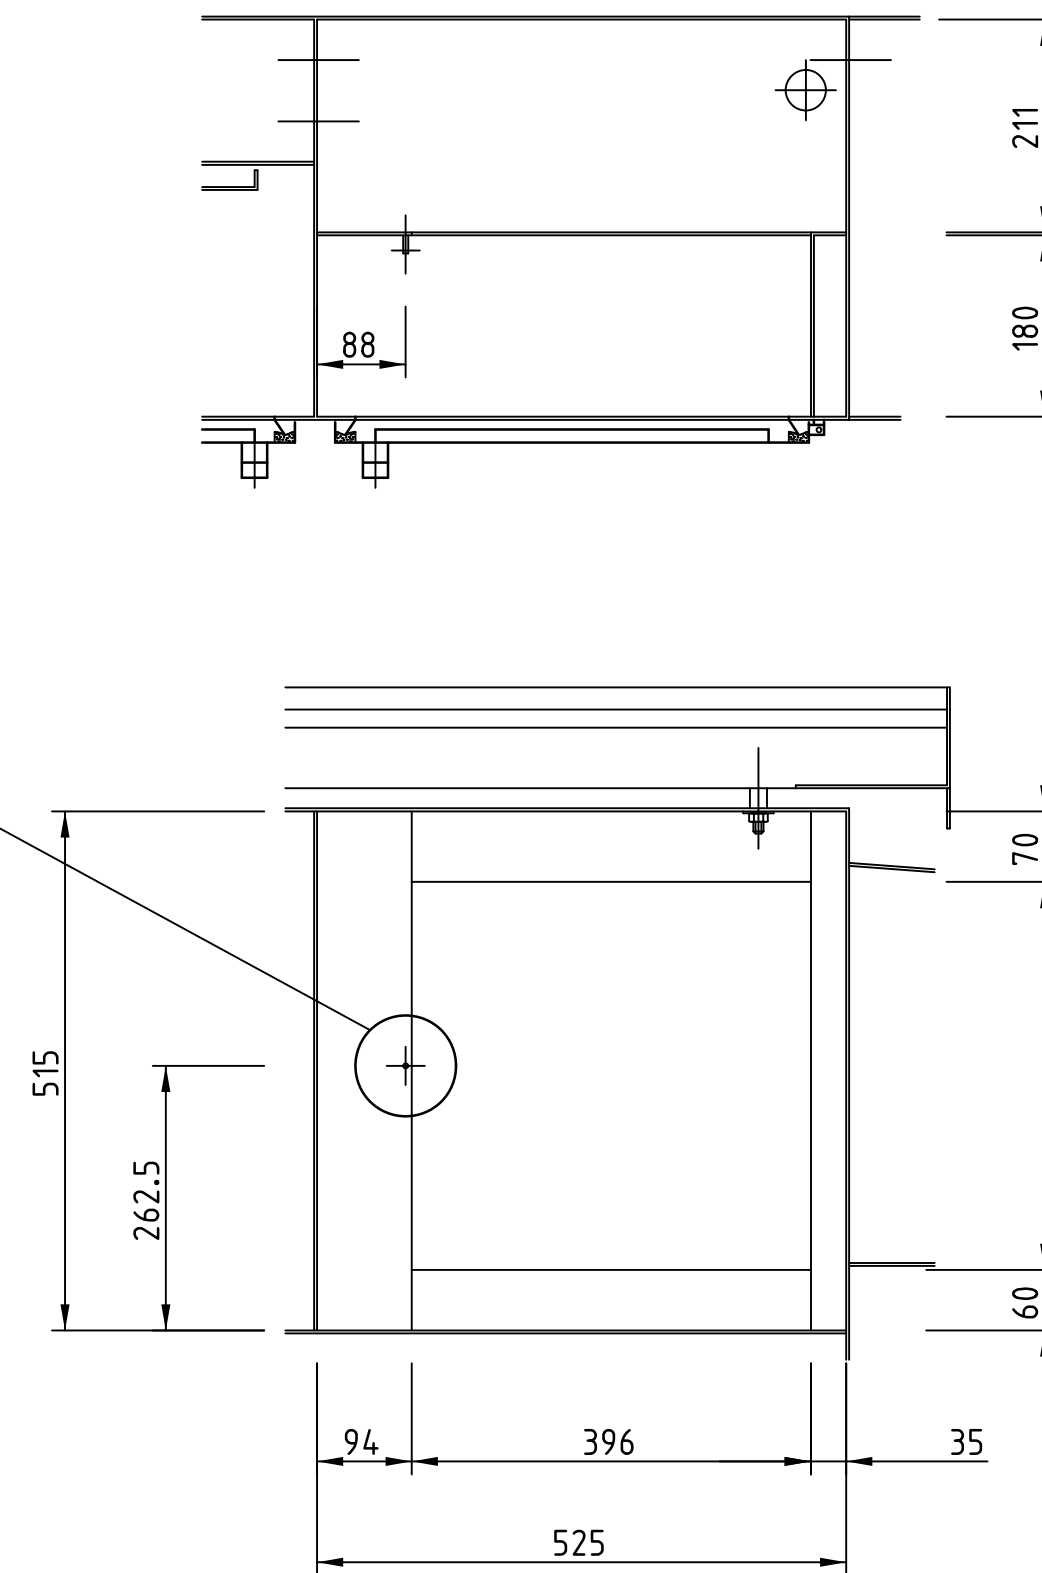
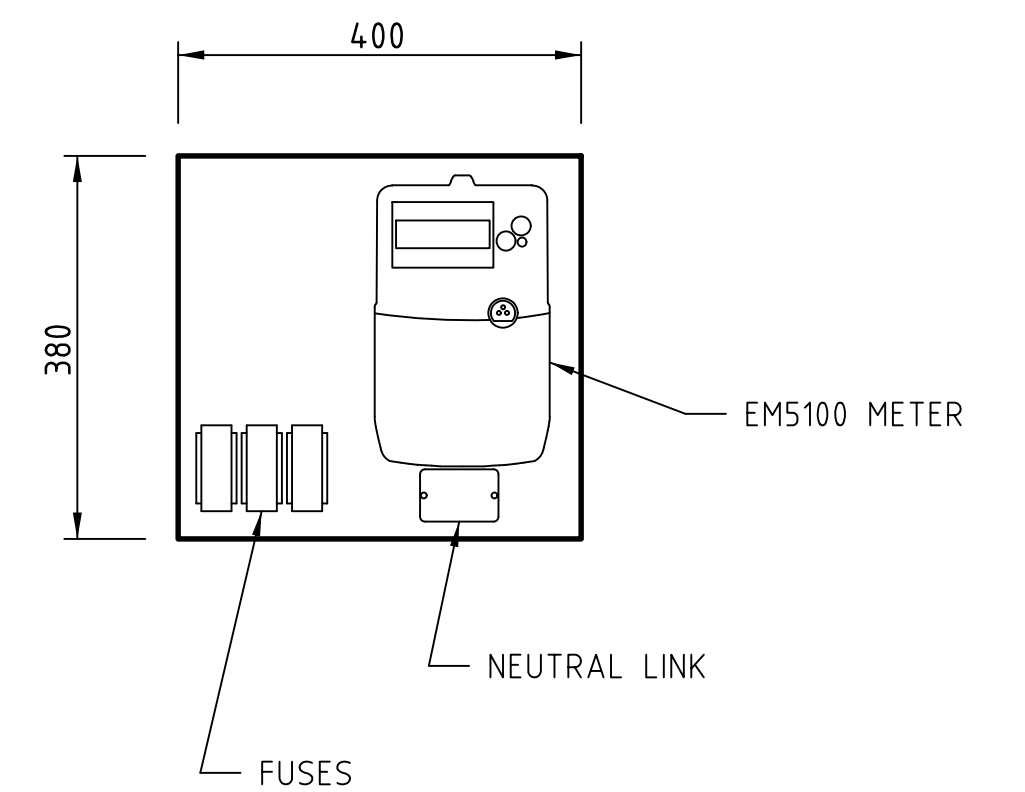
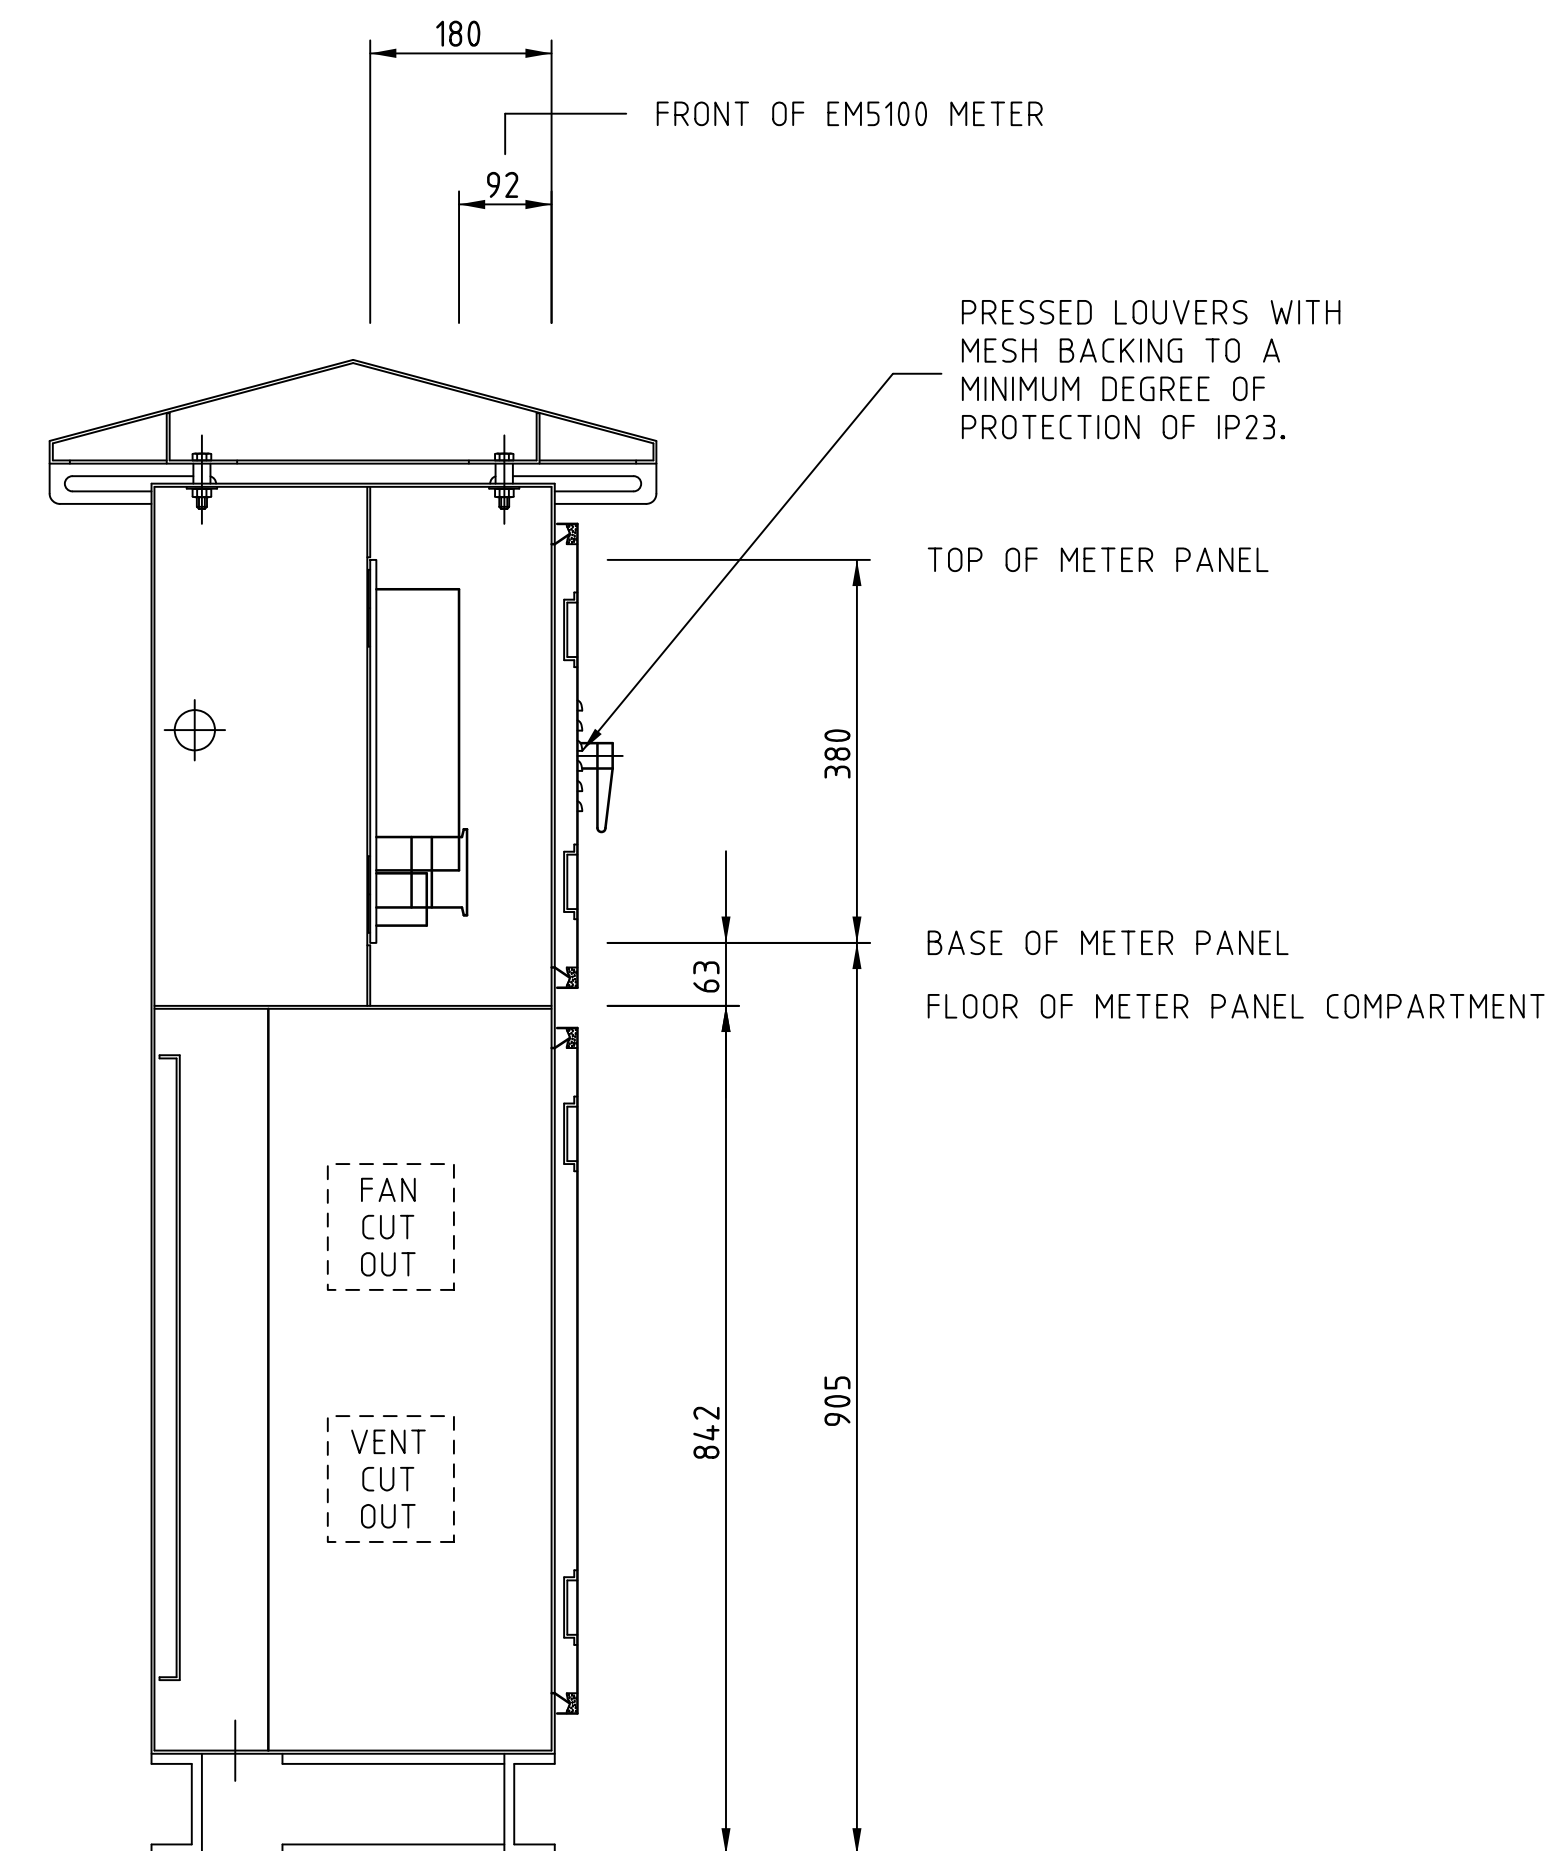


PROVISION FOR  
METER PANEL  
SEALING STUD

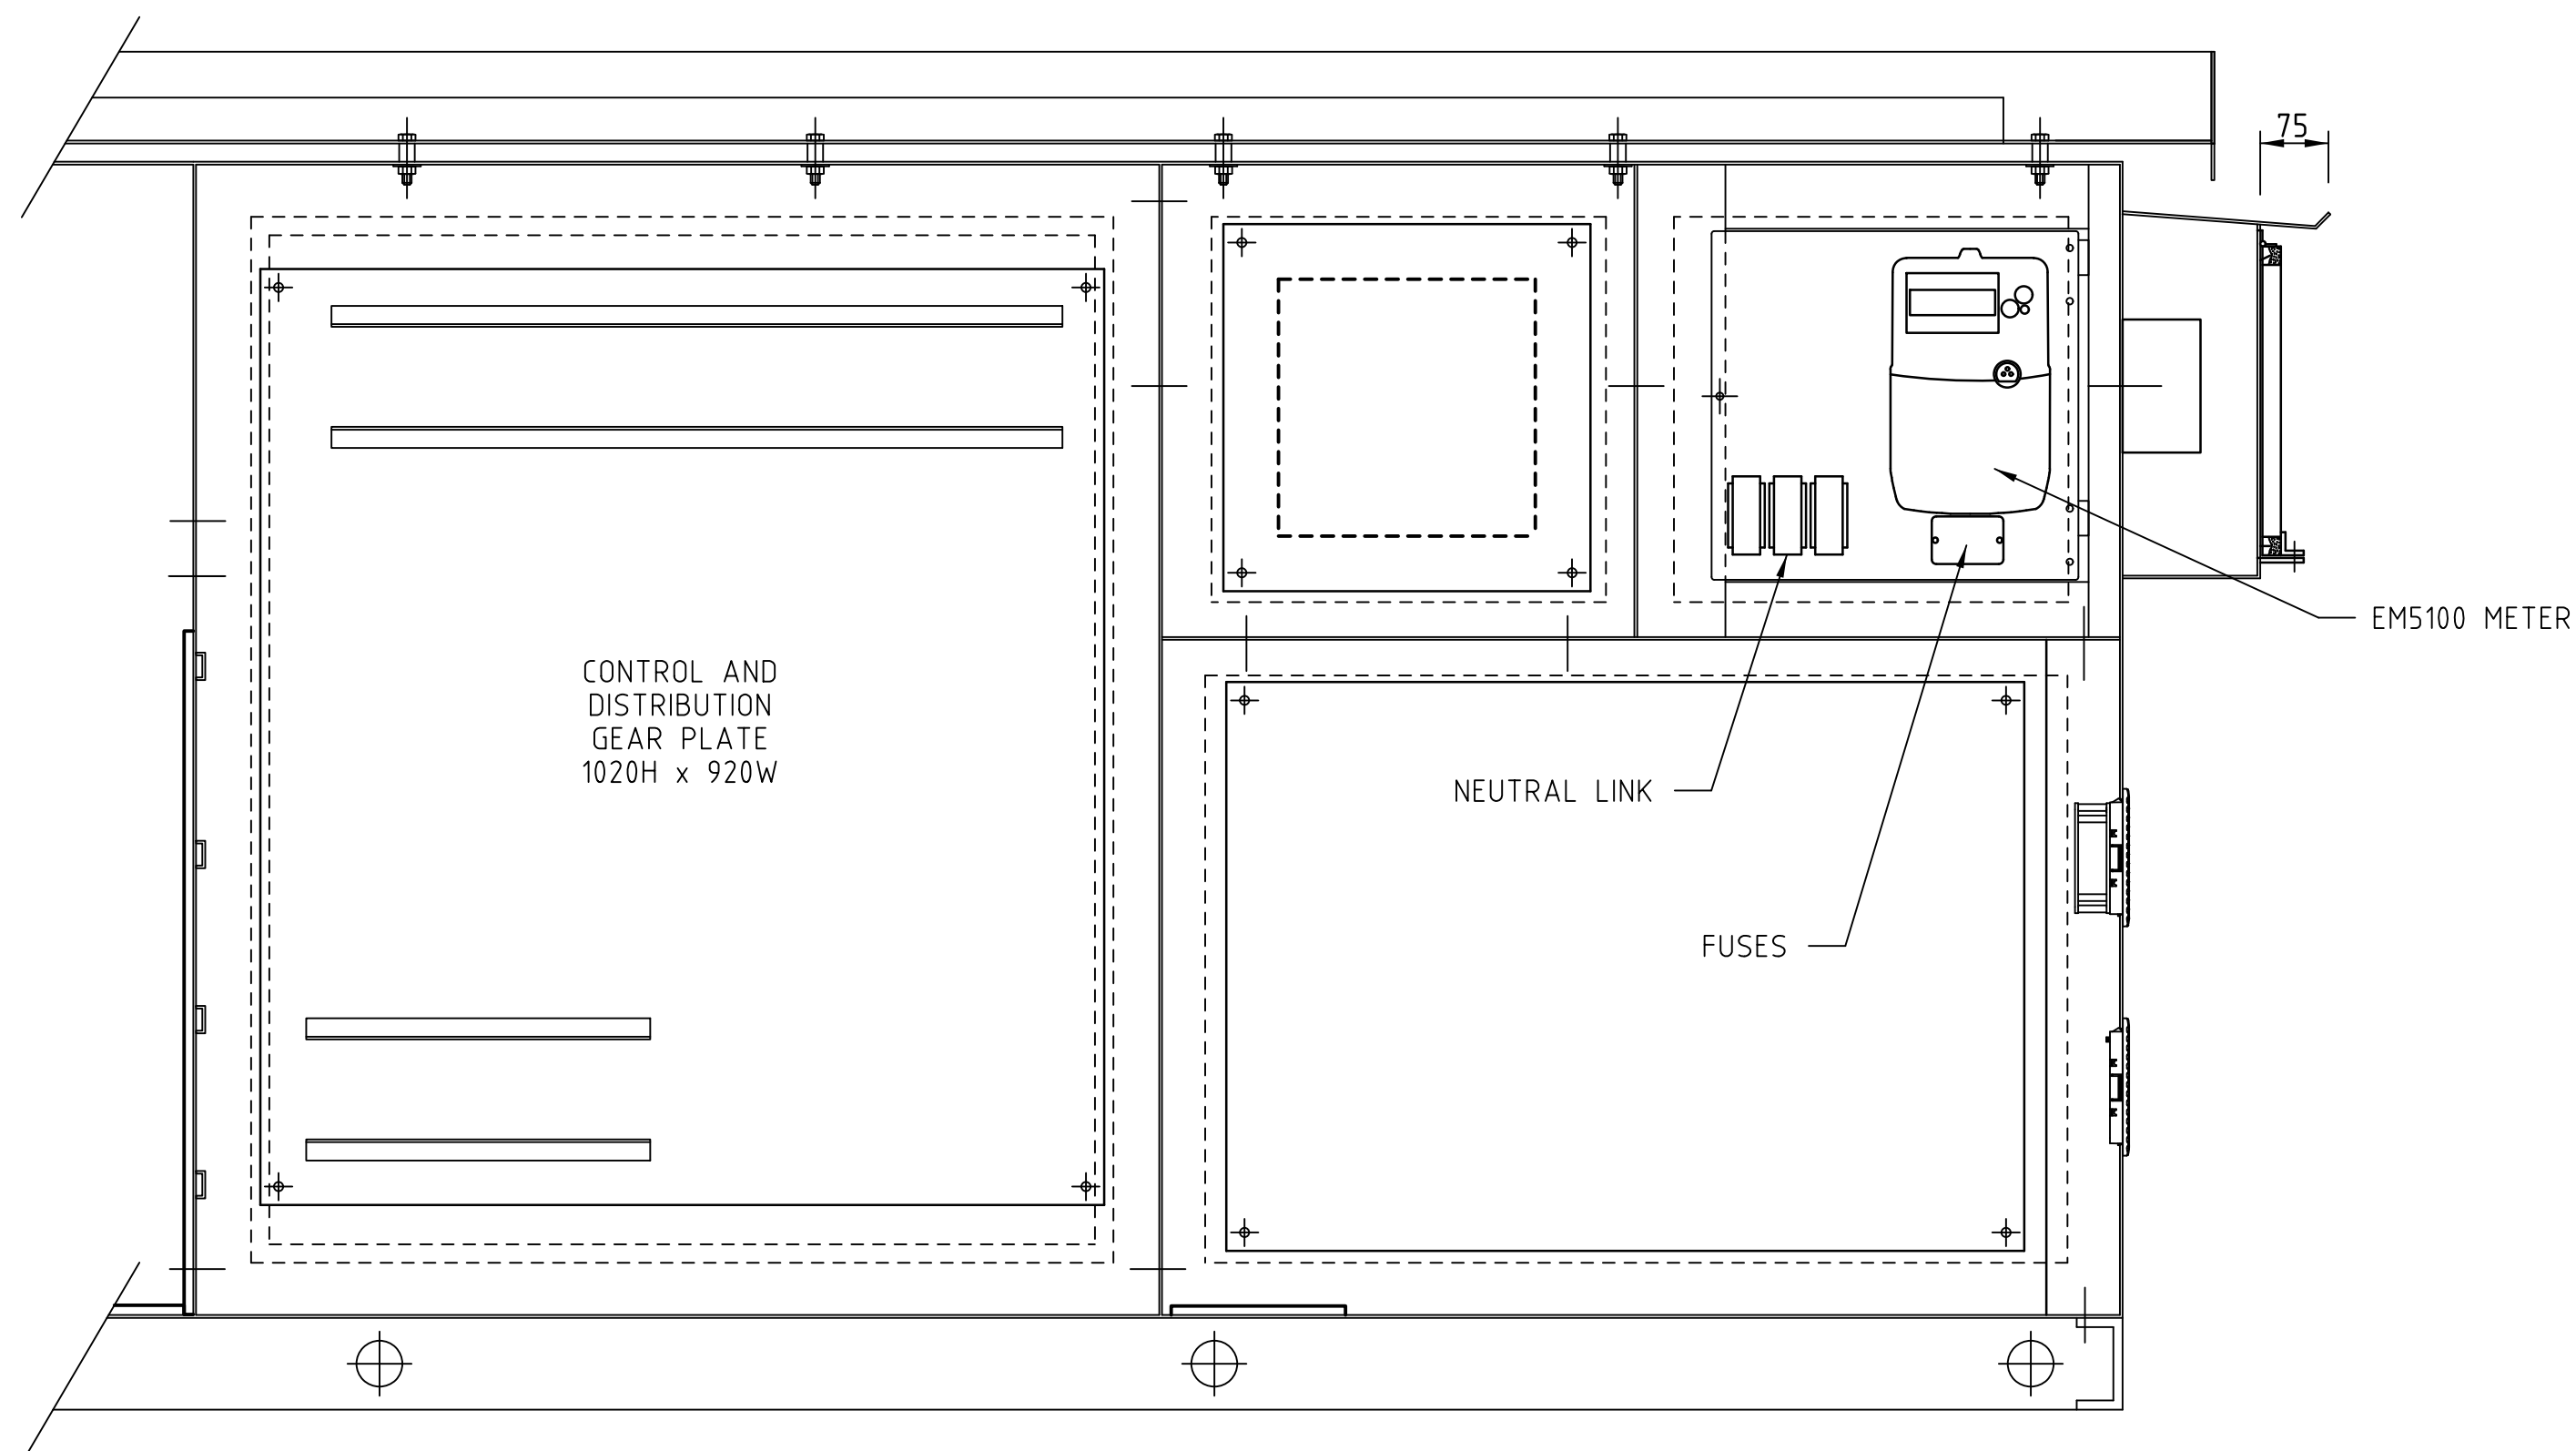

## METERING COMPARTMENT DETAILS

SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.  
CUBICLE IP RATING: IP55  
VENTILATION REQUIREMENTS FOR METERING COMPARTMENT:  
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF  
PROTECTION OF IP23.

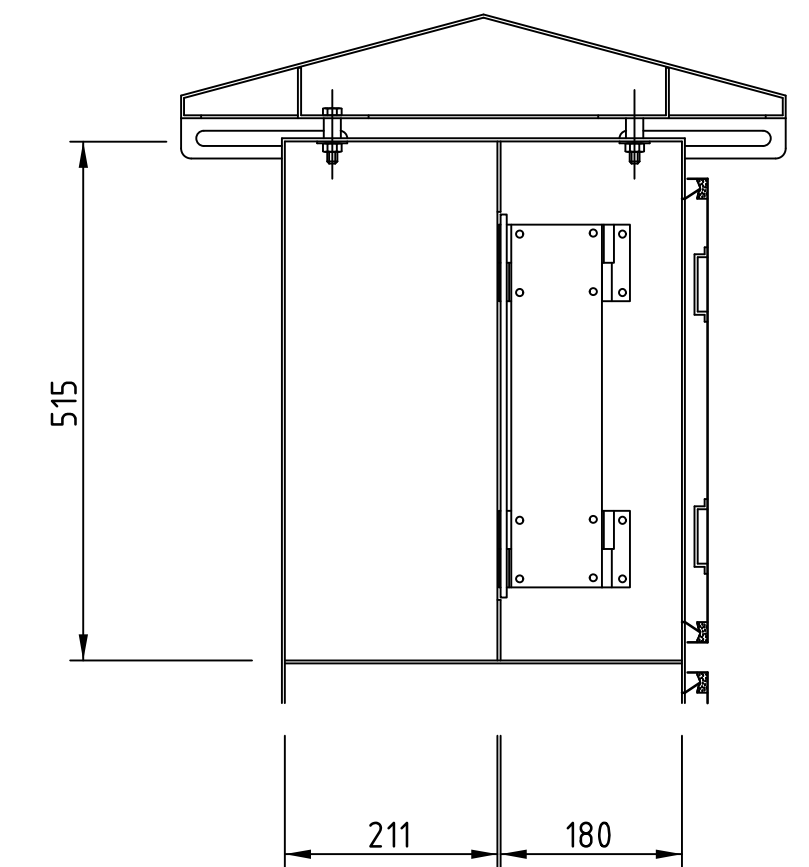


REVISIONS				REFERENCES			
	No.	DATE	DESCRIPTION		PLAN No.	TITLE	
7	29/3/21	ADDED TOP FOR DC CBS & RE-DRAWN IN DGN FORMAT.		P.S.	A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX	

DESIGNED BY:		



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		DRAWING No. A1-49213	
DESIGNED: 19/04/2010 - GW/STD		REV. 7	
DRAWN: 29/03/2021 - OPT/RJ			
CHECKED: 31/03/2021 - P STEWART			

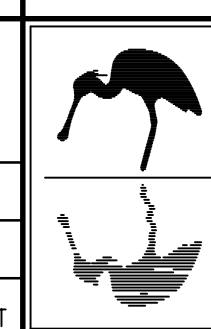

STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED SIDE BY SIDE - PUMP STATION CUBICLE METERING COMPARTMENT DETAILS	
--	--