



CONTROL AND  
DISTRIBUTION COMPT  
GEAR TRAY

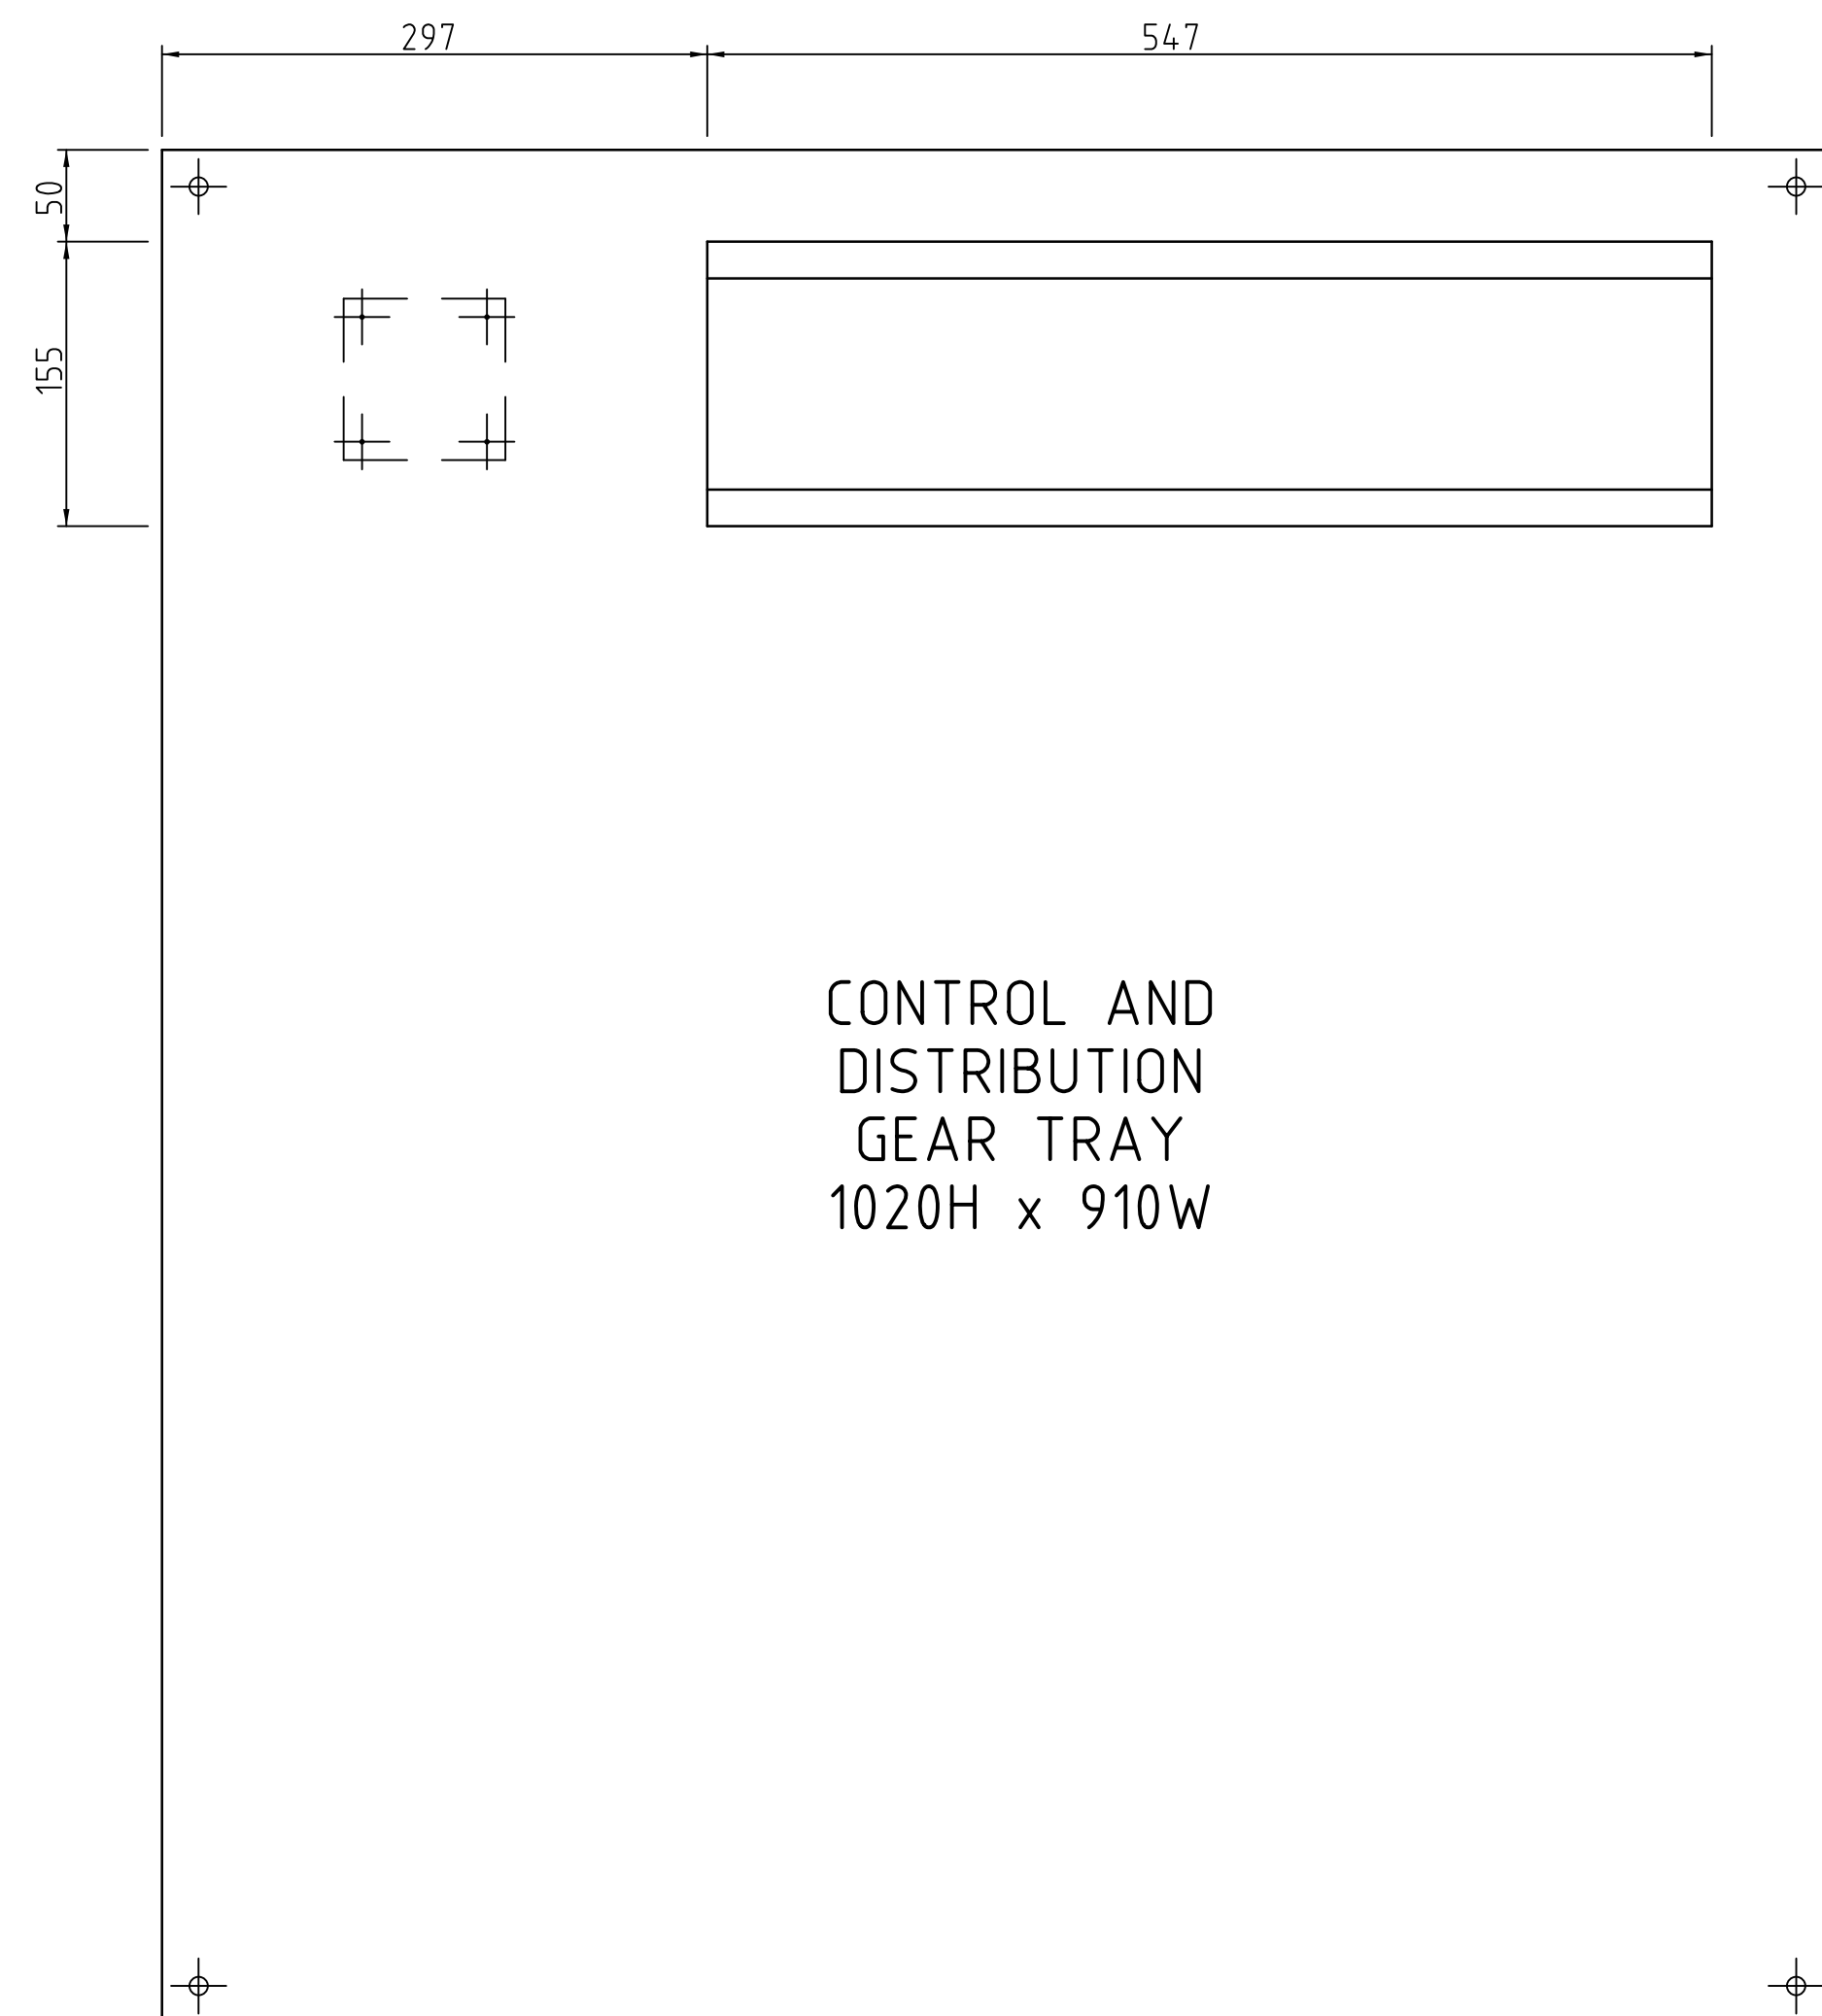

CONTROL AND  
DISTRIBUTION  
GEAR TRAY  
1020H x 910W

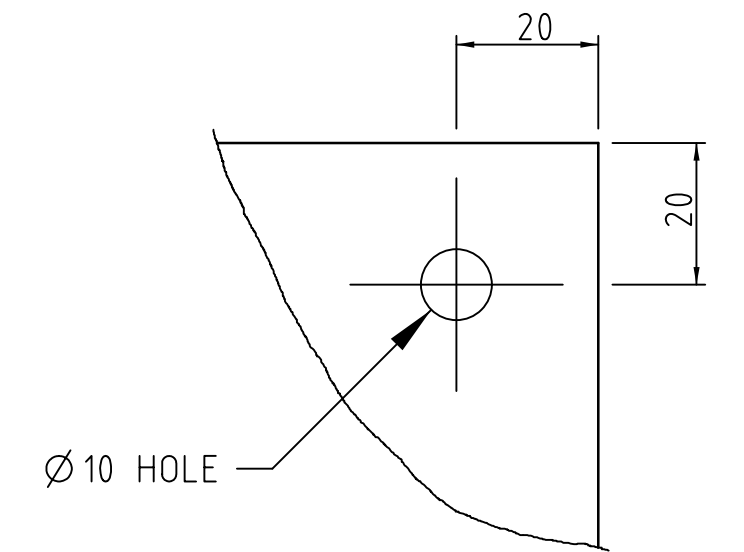


TYPICAL GEAR TRAY  
MOUNTING HOLES

GEAR TRAYS TO HAVE A  
MOUNTING HOLE IN EACH CORNER


NOTE: ALL GEAR TRAYS AND TOP HAT TO BE POWDER COATED WHITE



INSTRUMENT  
GEAR TRAY  
400H x 400W

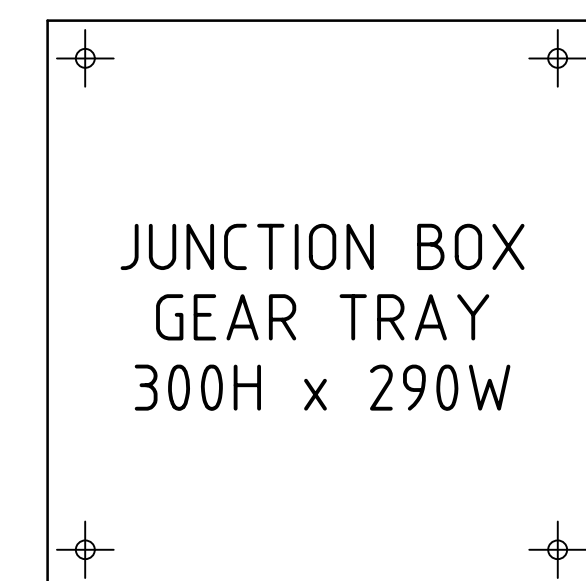

JUNCTION BOX  
GEAR TRAY  
300H x 290W

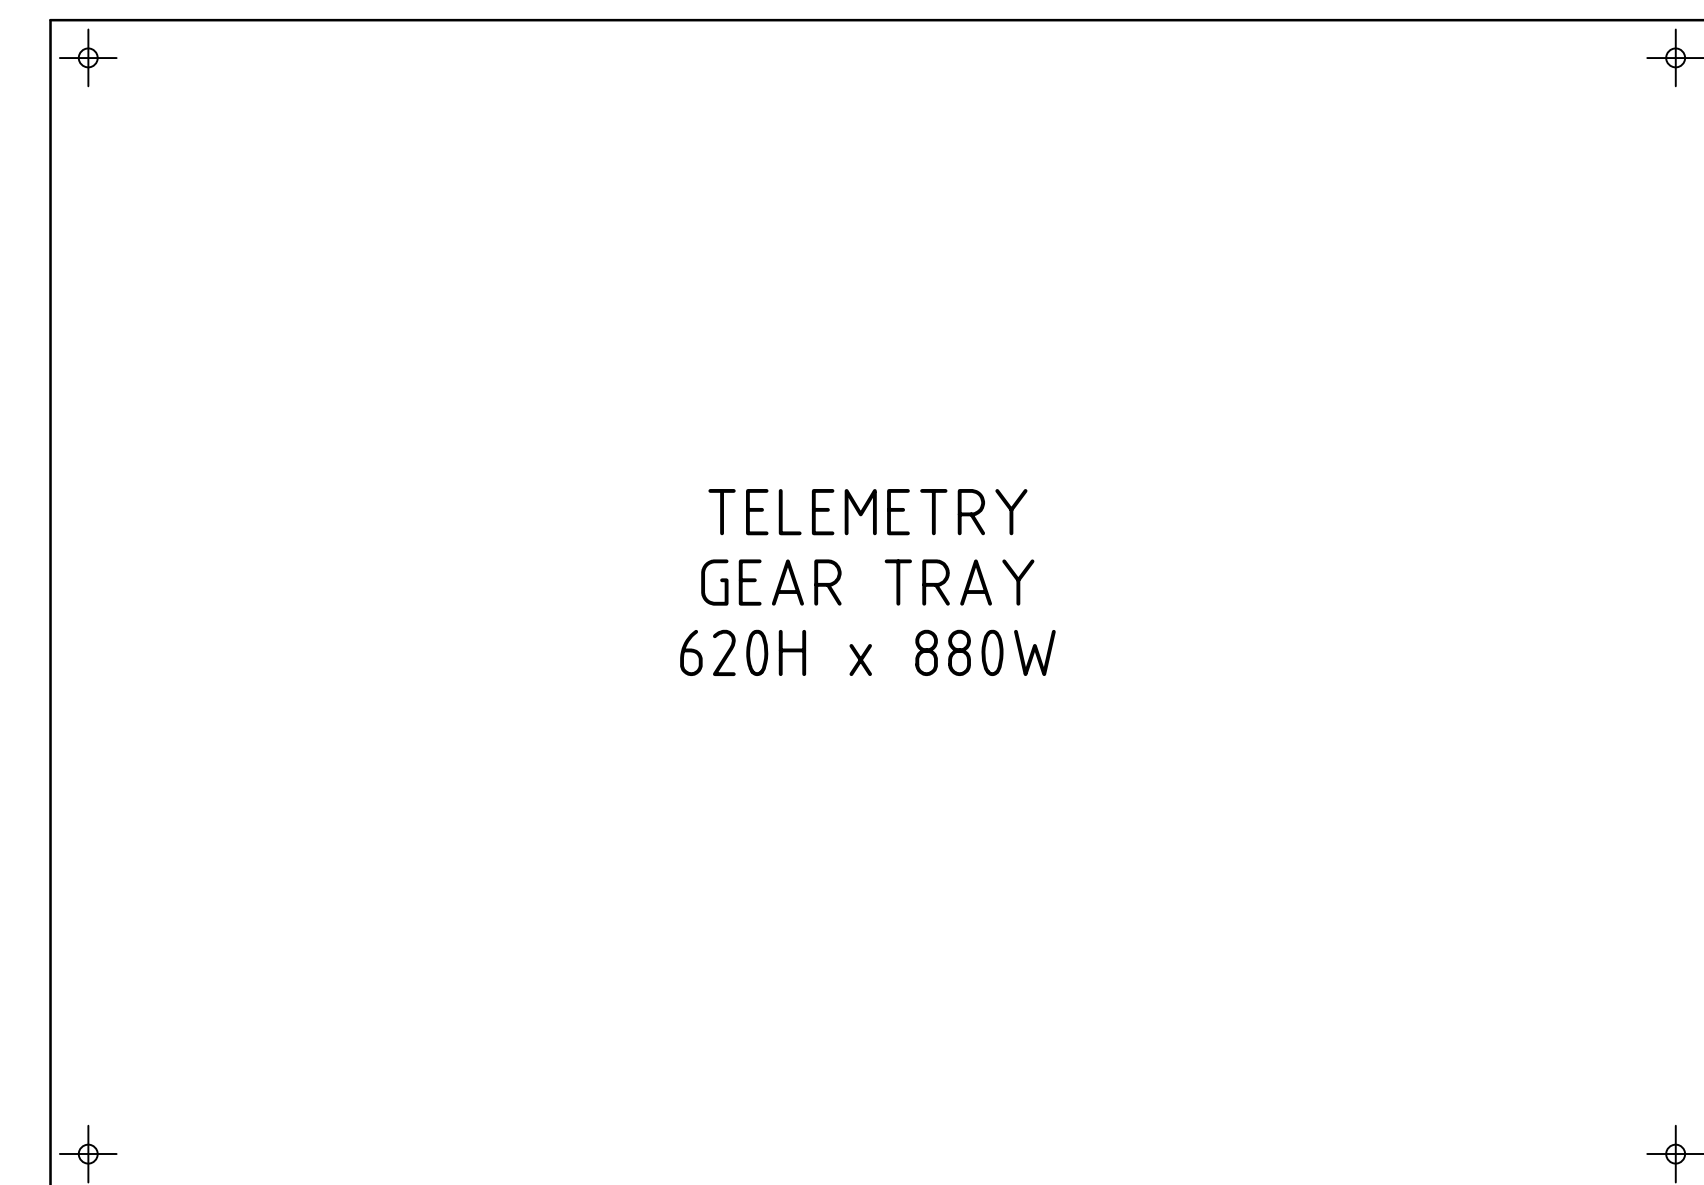

TELEMETRY  
GEAR TRAY  
620H x 880W


NOT TO SCALE

REVISIONS					REFERENCES		
1	20/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.		M.S.			
0	27/3/15	INITIAL ISSUE.		M.S.	A1-58850	STANDARD SPS - PUMP STATION 7.5kW TO 22kW (SOFT STARTER) - I & C - DRAWING INDEX	
No.	DATE	DESCRIPTION		APP'D	PLAN No.	TITLE	

DESIGNED BY:



OPTIMUM  
DRAFTING PTY LTD  
A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		DRAWING No. A1-58881	
DESIGNED: 25/03/2015 - M SENANAYAKE		REV. 1	
DRAWN: 27/03/2015 - OPT/MM			
CHECKED: 01/04/2015 - M SENANAYAKE			
 <p>STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (SOFT STARTER) PUMP STATION CUBICLE GEAR TRAY DRILLING DETAILS</p>			