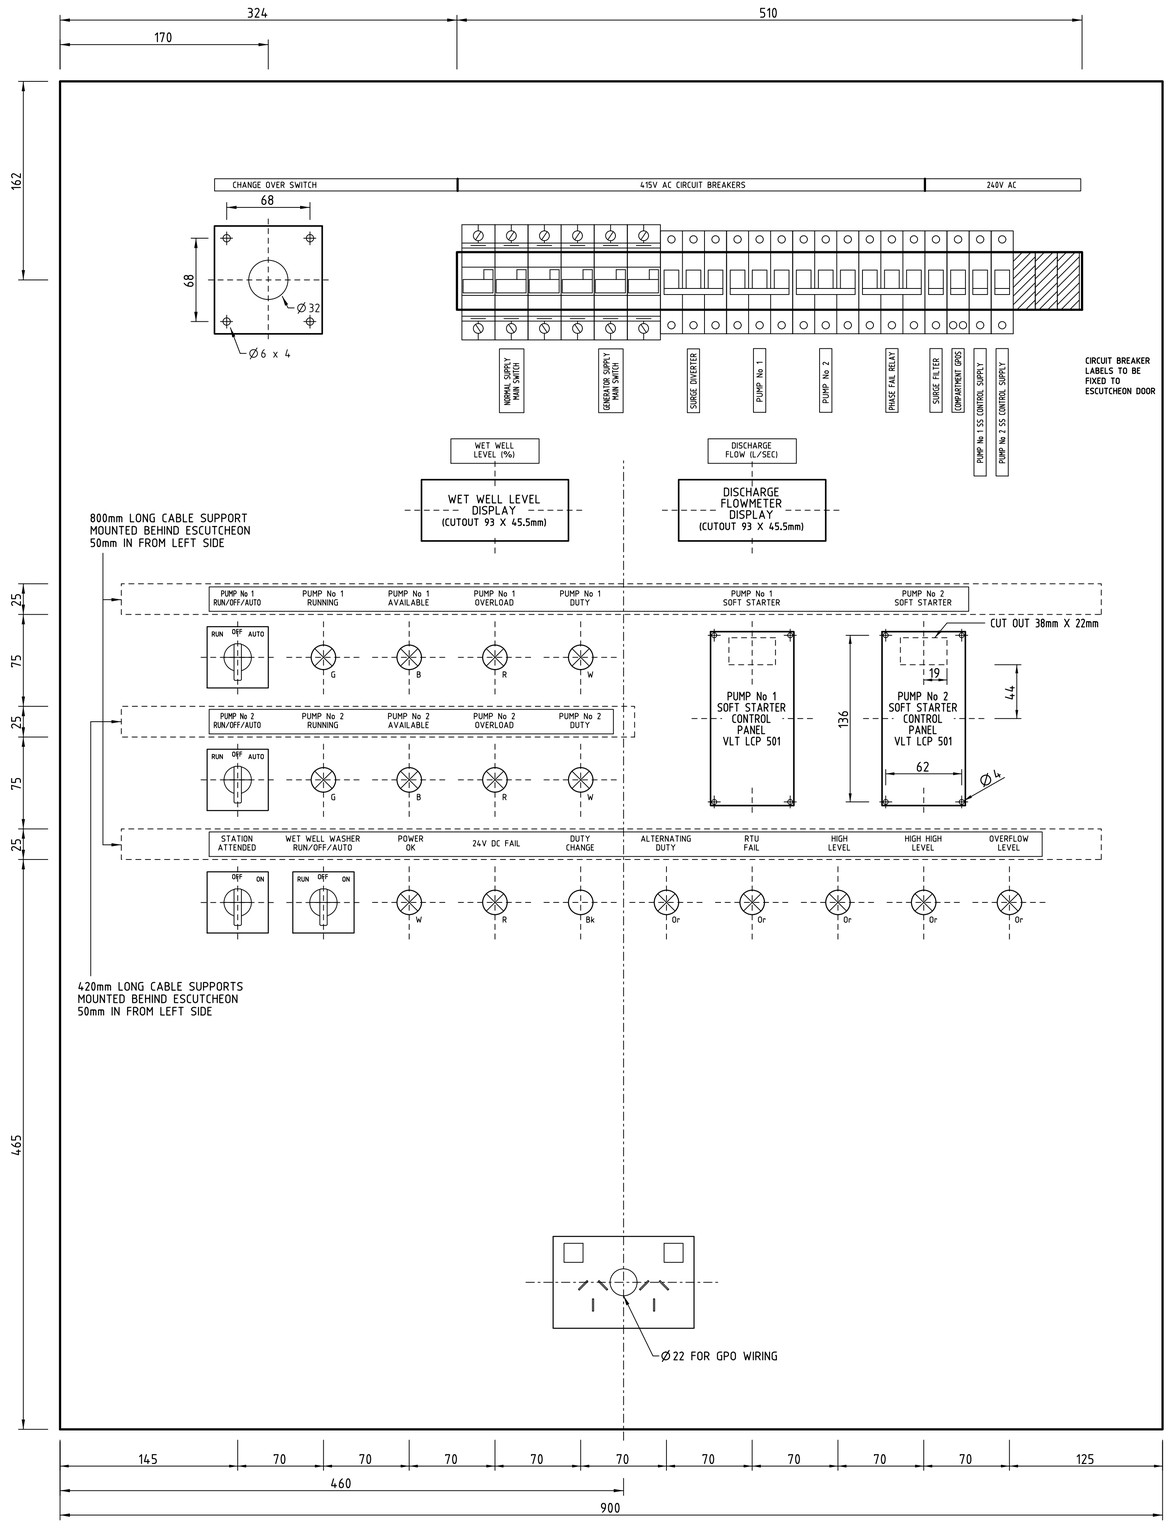

D7 INDICATION AND SWITCHES CUTOUT DETAILS



NOT TO SCALE

REVISIONS				
3	14/9/15	REVISED DISPLAY CUTOUT DIMENSIONS.	M.S.	
2	19/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.	M.S.	
1	21/5/15	REVISED PUMP CB TO REFLECT DIN-T6 SERIES.	M.S.	
0	27/3/15	INITIAL ISSUE.	M.S.	
No.	DATE	DESCRIPTION	APP'D	

REFERENCES	
A1-58850	STANDARD SPS - PUMP STATION 7.5kW TO 22kW (SOFT STARTER) - I & C - DRAWING INDEX
PLAN No.	TITLE

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 25/03/2015 - M SENANAYAKE
DRAWN: 27/03/2015 - OPT/MM
CHECKED: 01/04/2015 - M SENANAYAKE

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-58875 REV. 3

STANDARD SEWERAGE PUMP STATION
PUMP STATION 7.5kW TO 22kW (SOFT STARTER)
CONTROL & DISTRIBUTION COMPARTMENT
ESCUTCHEON DOOR LAYOUT