


CHANGE OVER SWITCH

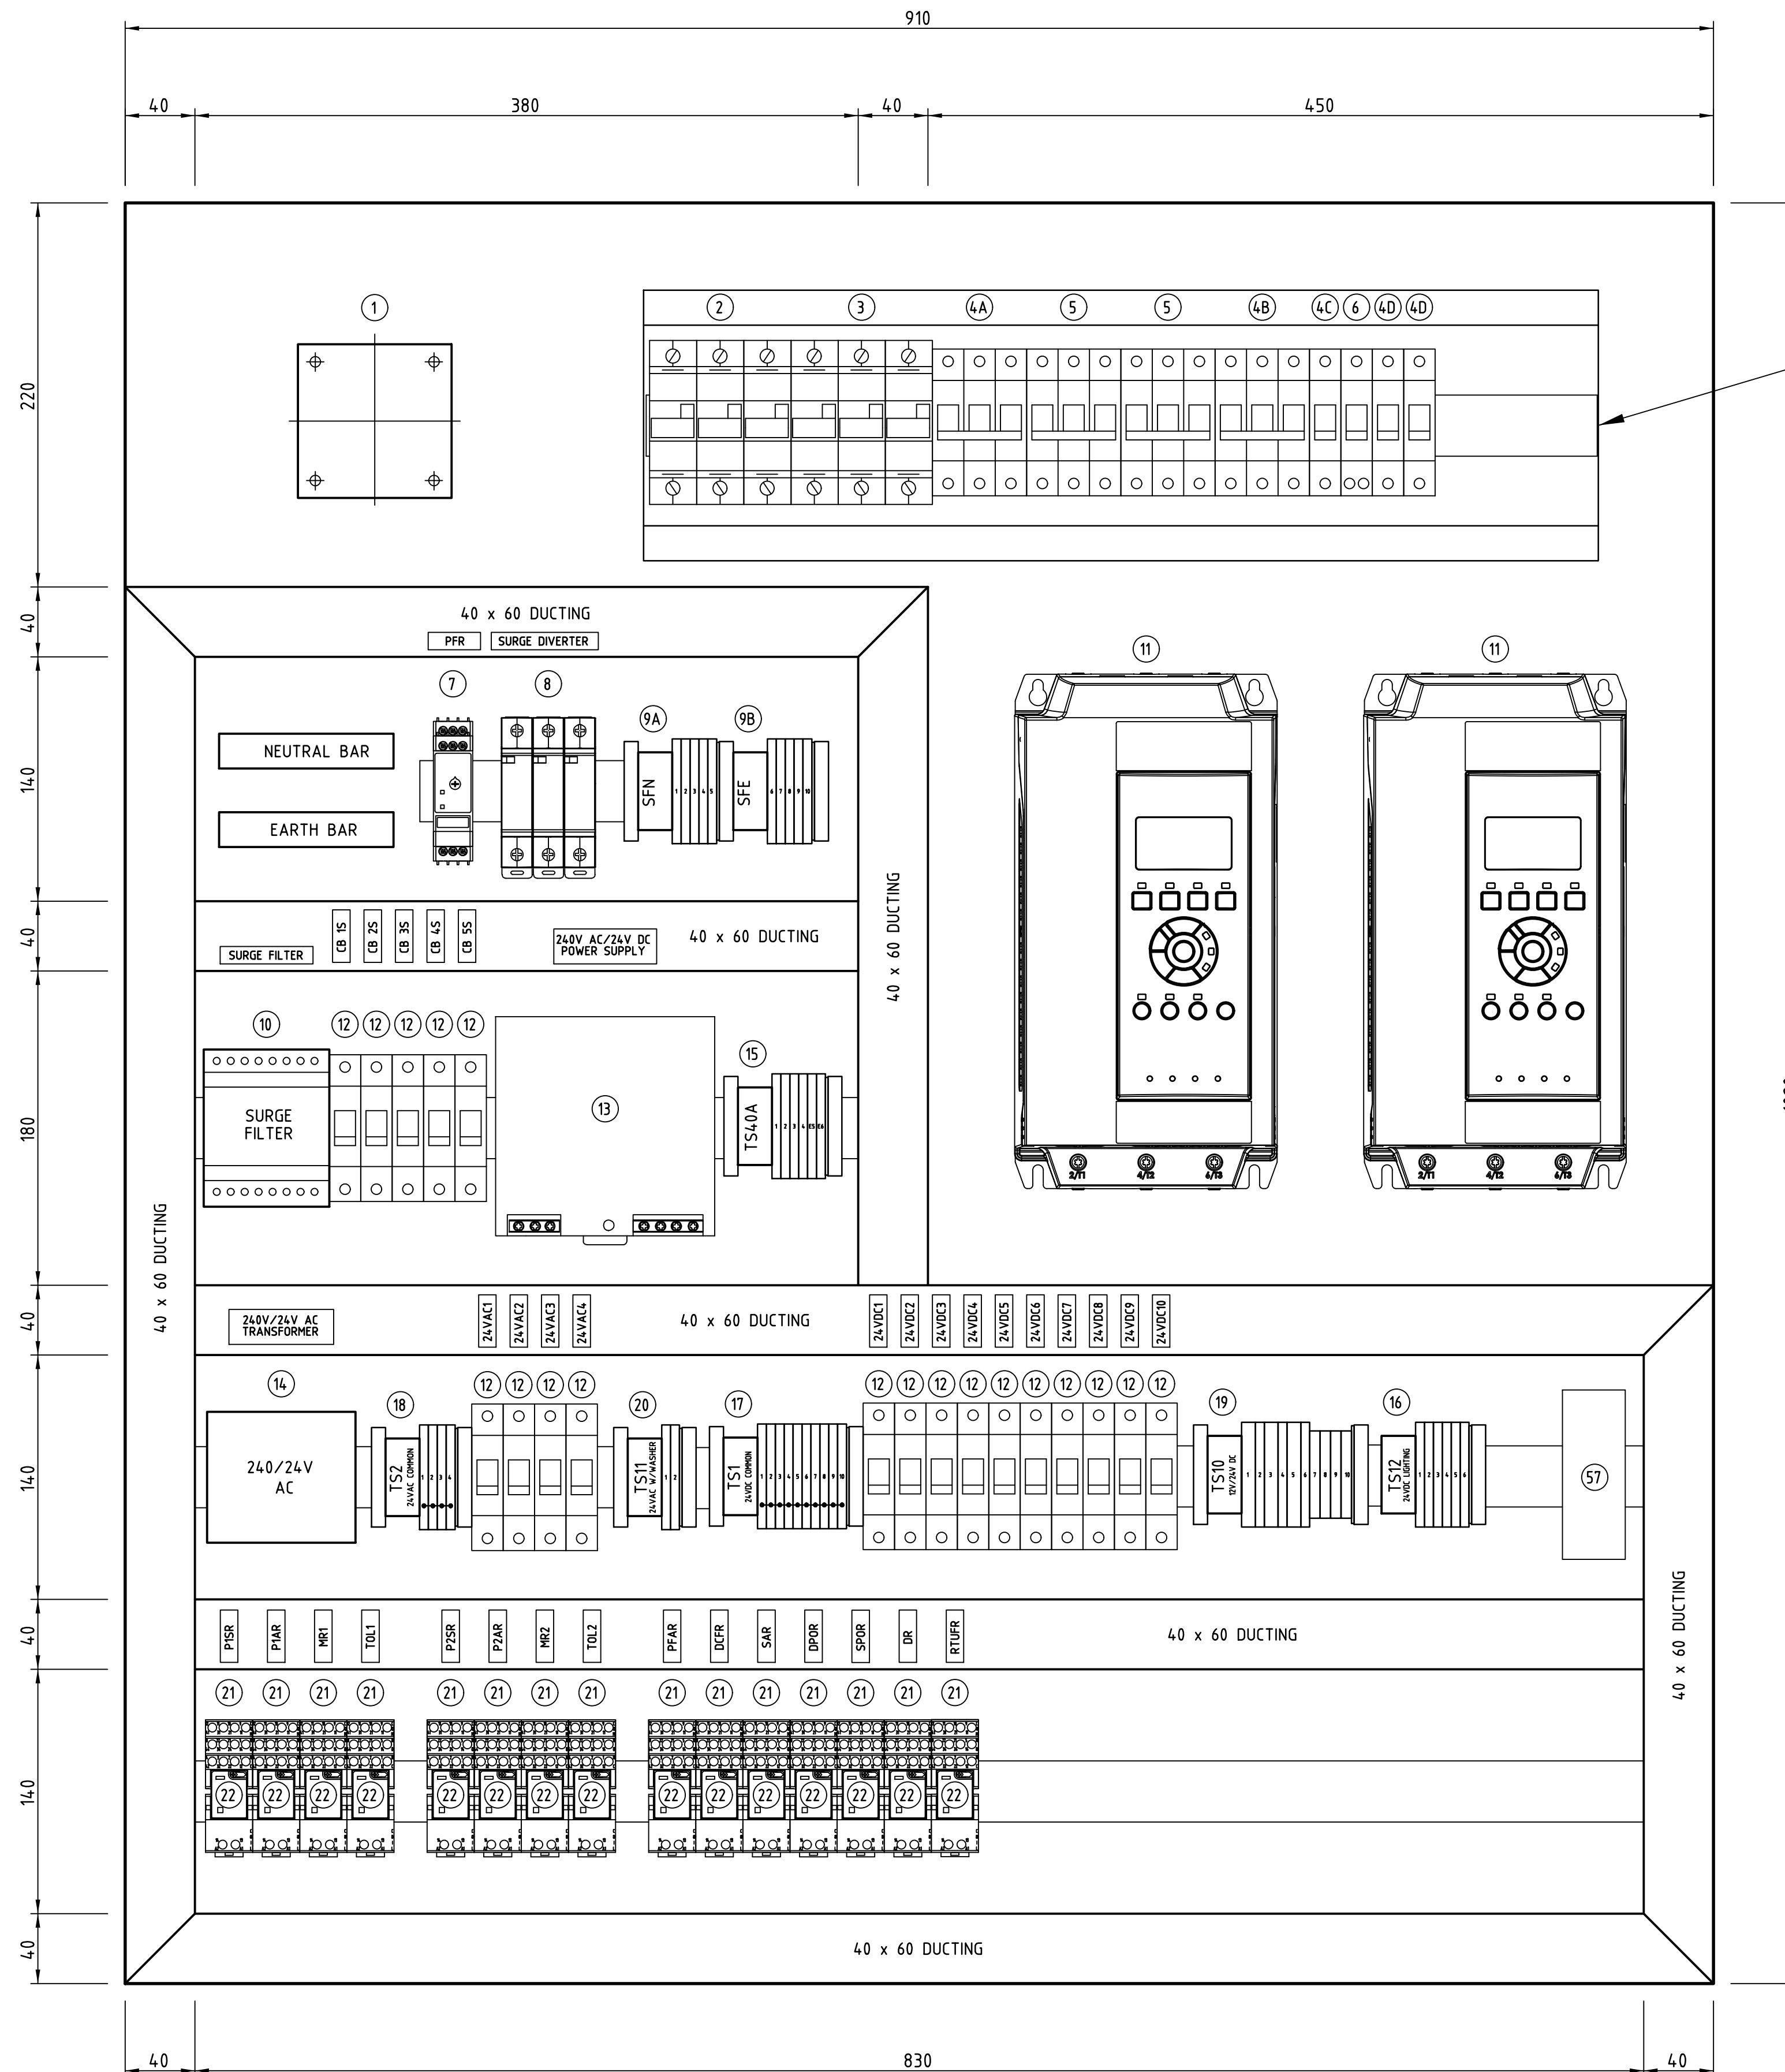

DIN RAIL BOOSTED
FOR ITEMS TO
PROTRUDE
ESCUTCHEON
REFER DRG A1-58875

NOT TO SCALE

No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
4	9/11/18	CHANGED PHASE FAILURE RELAY (PFR) TYPE.	G.F.			
3	19/4/17	ADDED PART NUMBER 57 MEANWELL 12/24V DC CONVERTER.	P.S.			
2	19/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.	M.S.			
1	21/5/15	REVISED PUMP CB TO REFLECT DIN-T6 SERIES.	M.S.			
0	27/3/15	INITIAL ISSUE.	M.S.			

DESIGNED BY:

OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		DRAWING No. A1-58876 REV. 4	
DESIGNED: 25/03/2015 - M SENANAYAKE		STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (SOFT STARTER) CONTROL & DISTRIBUTION COMPARTMENT GEAR TRAY LAYOUT	
DRAWN: 27/03/2015 - OPT/MM			
CHECKED: 01/04/2015 - M SENANAYAKE			