

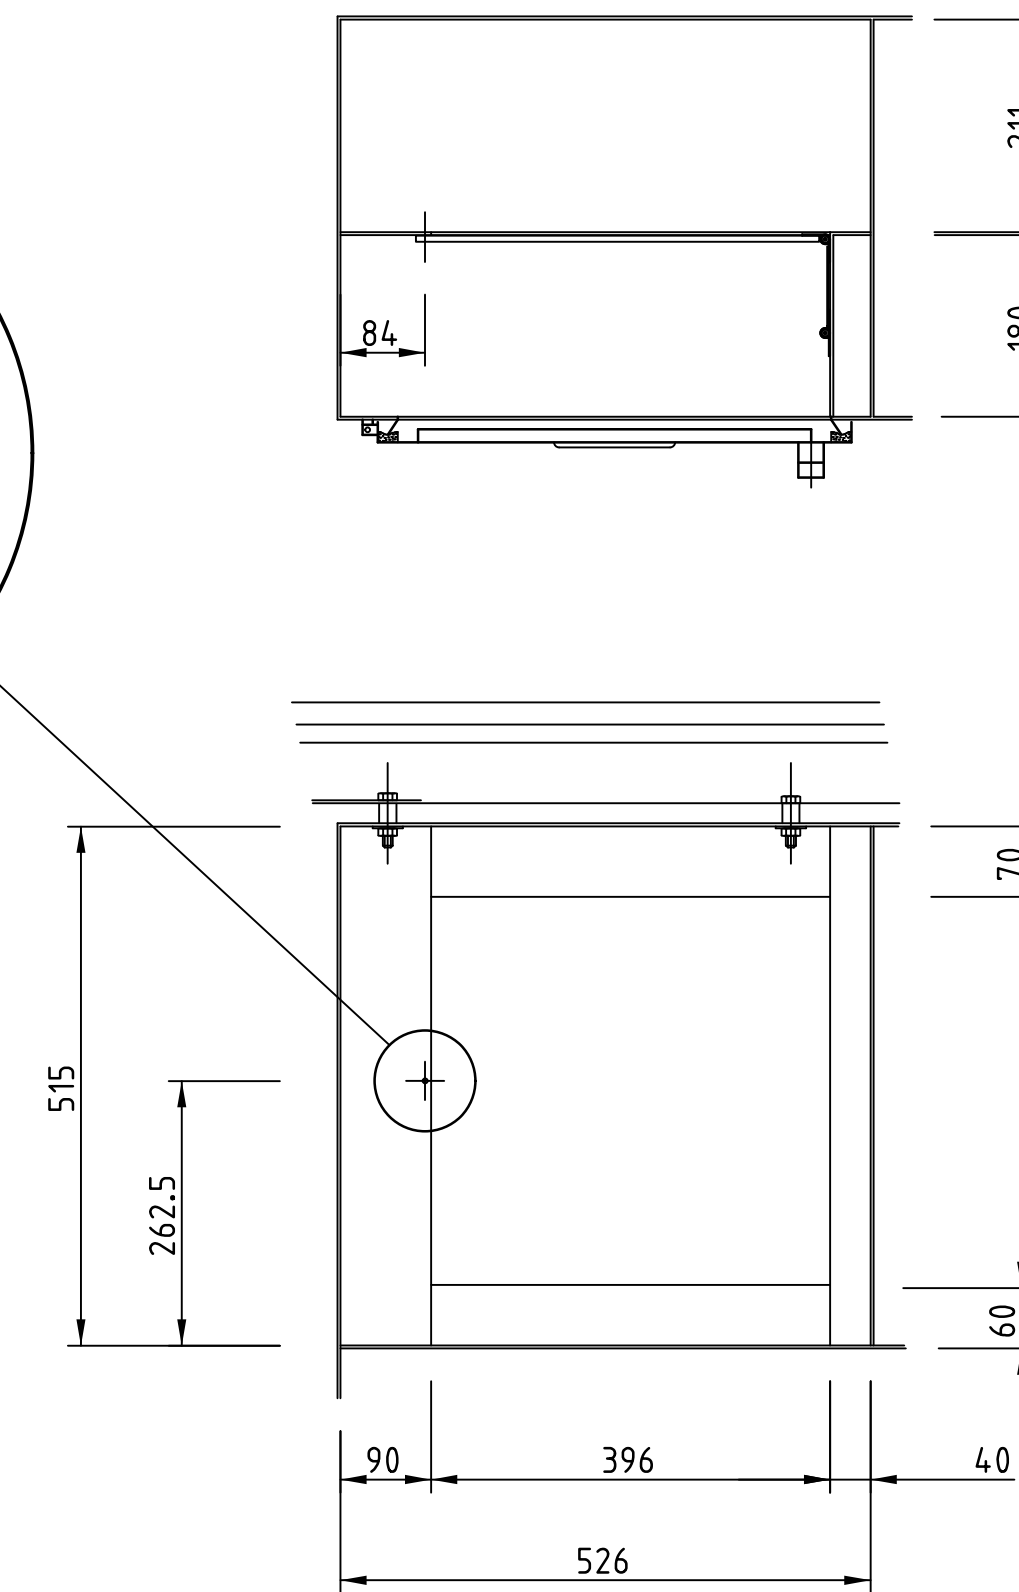
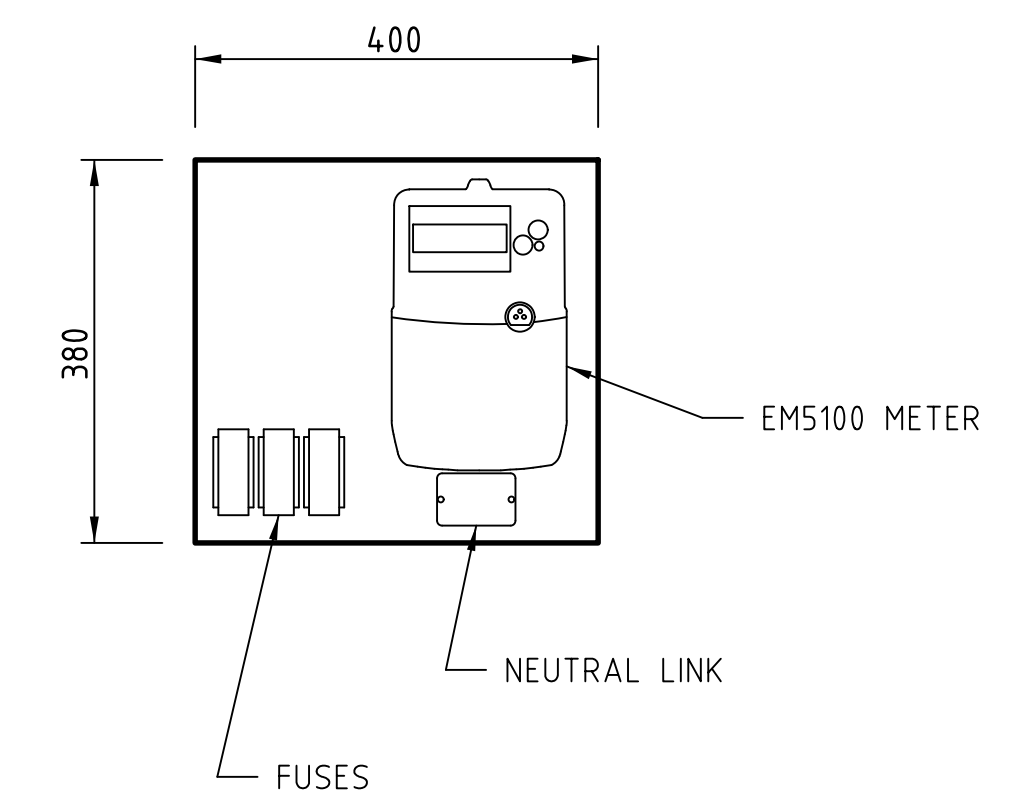
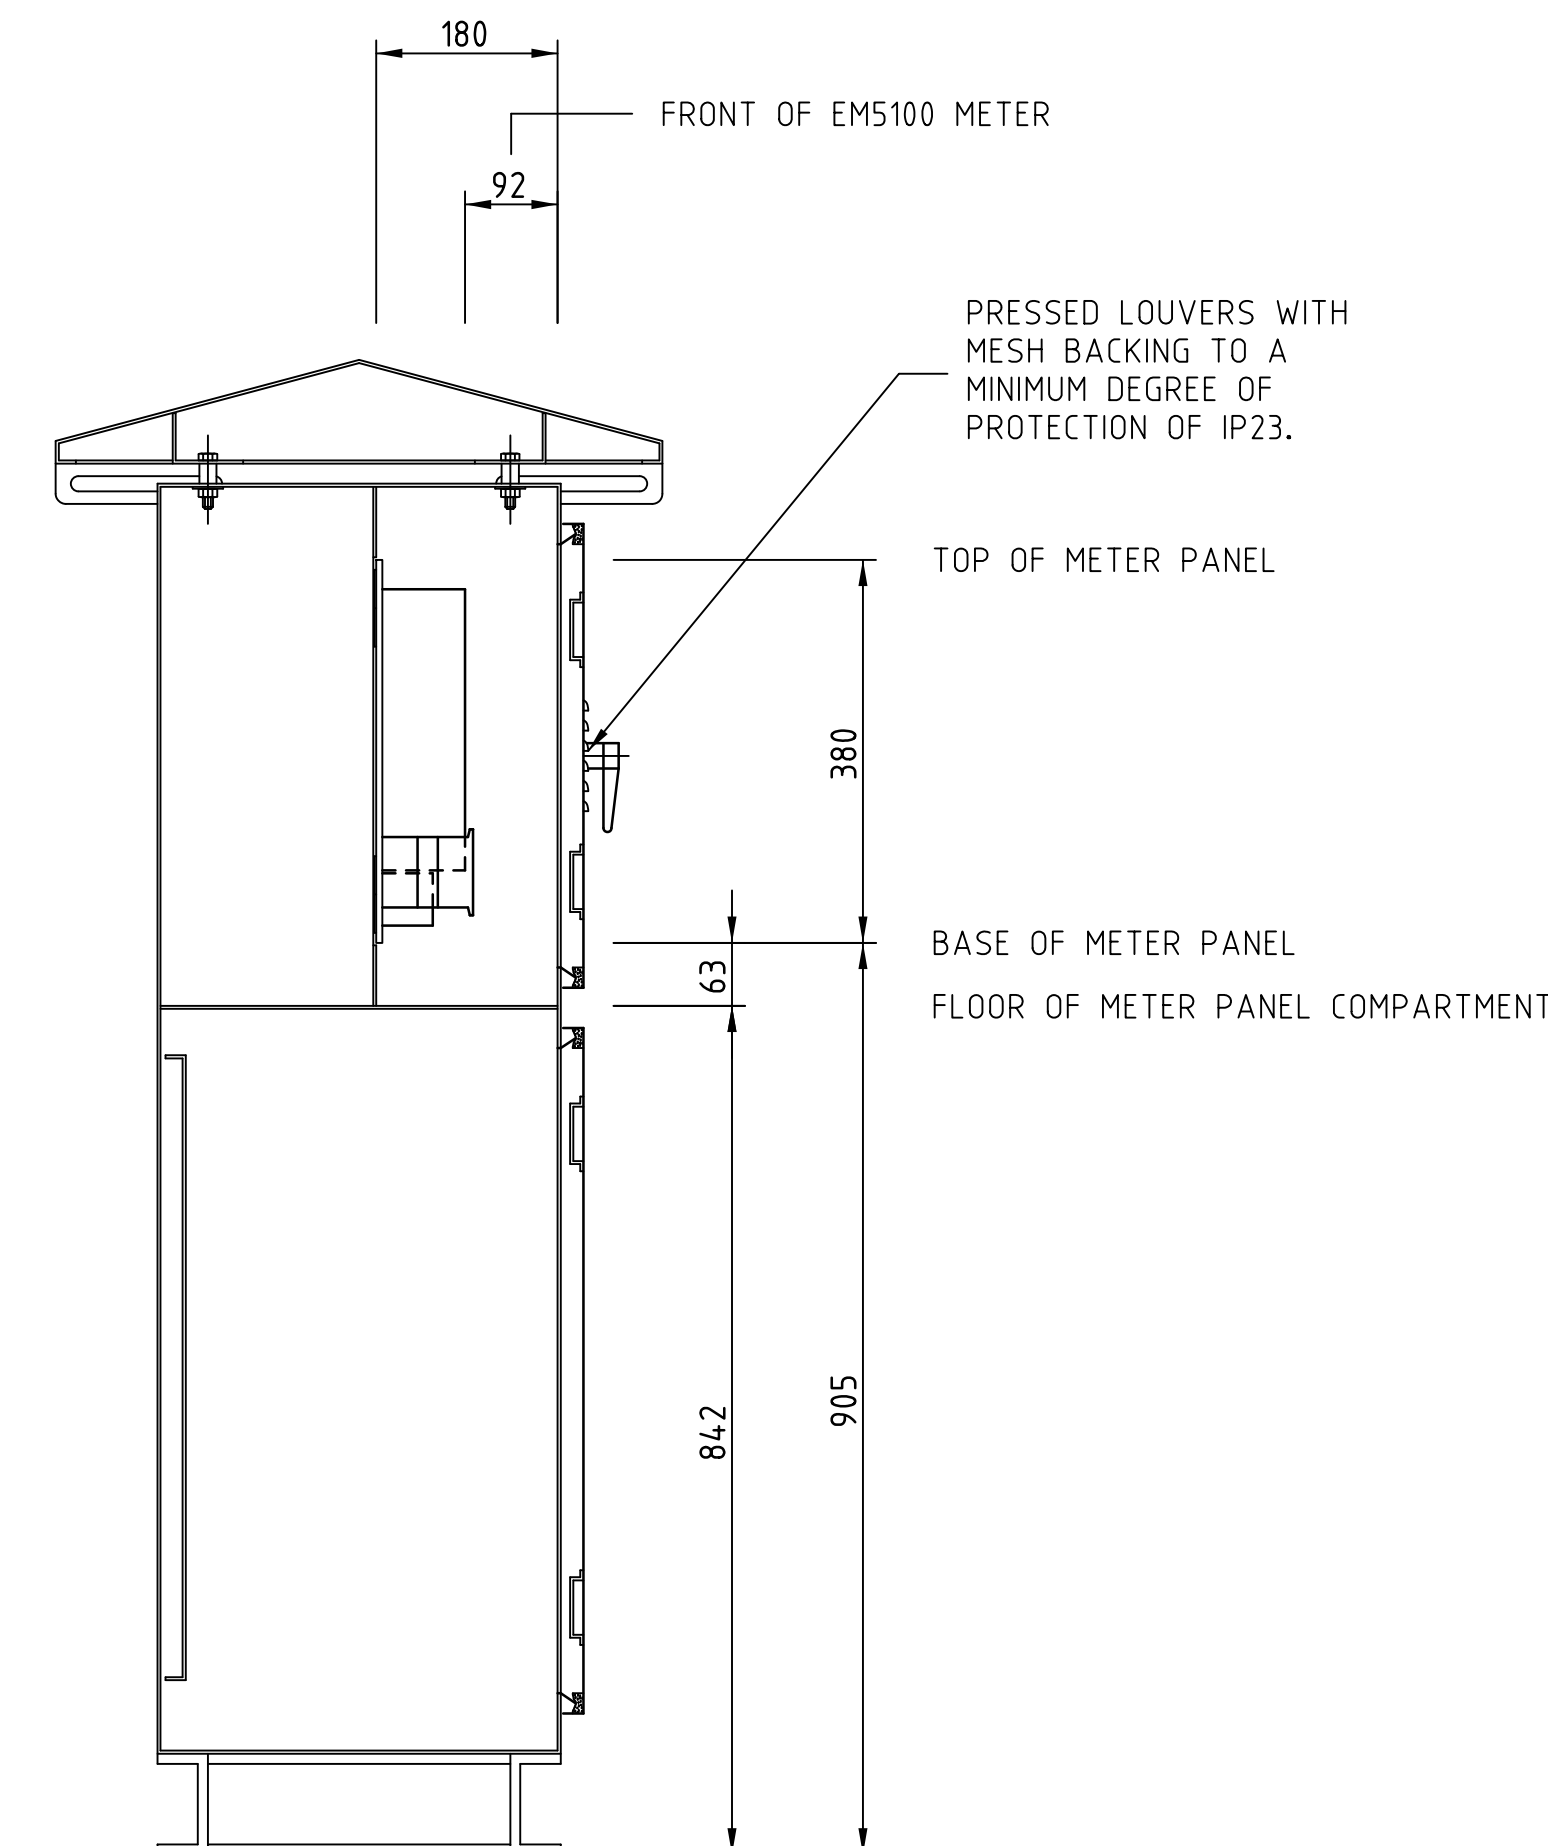


PROVISION FOR
METER PANEL
SEALING STUD

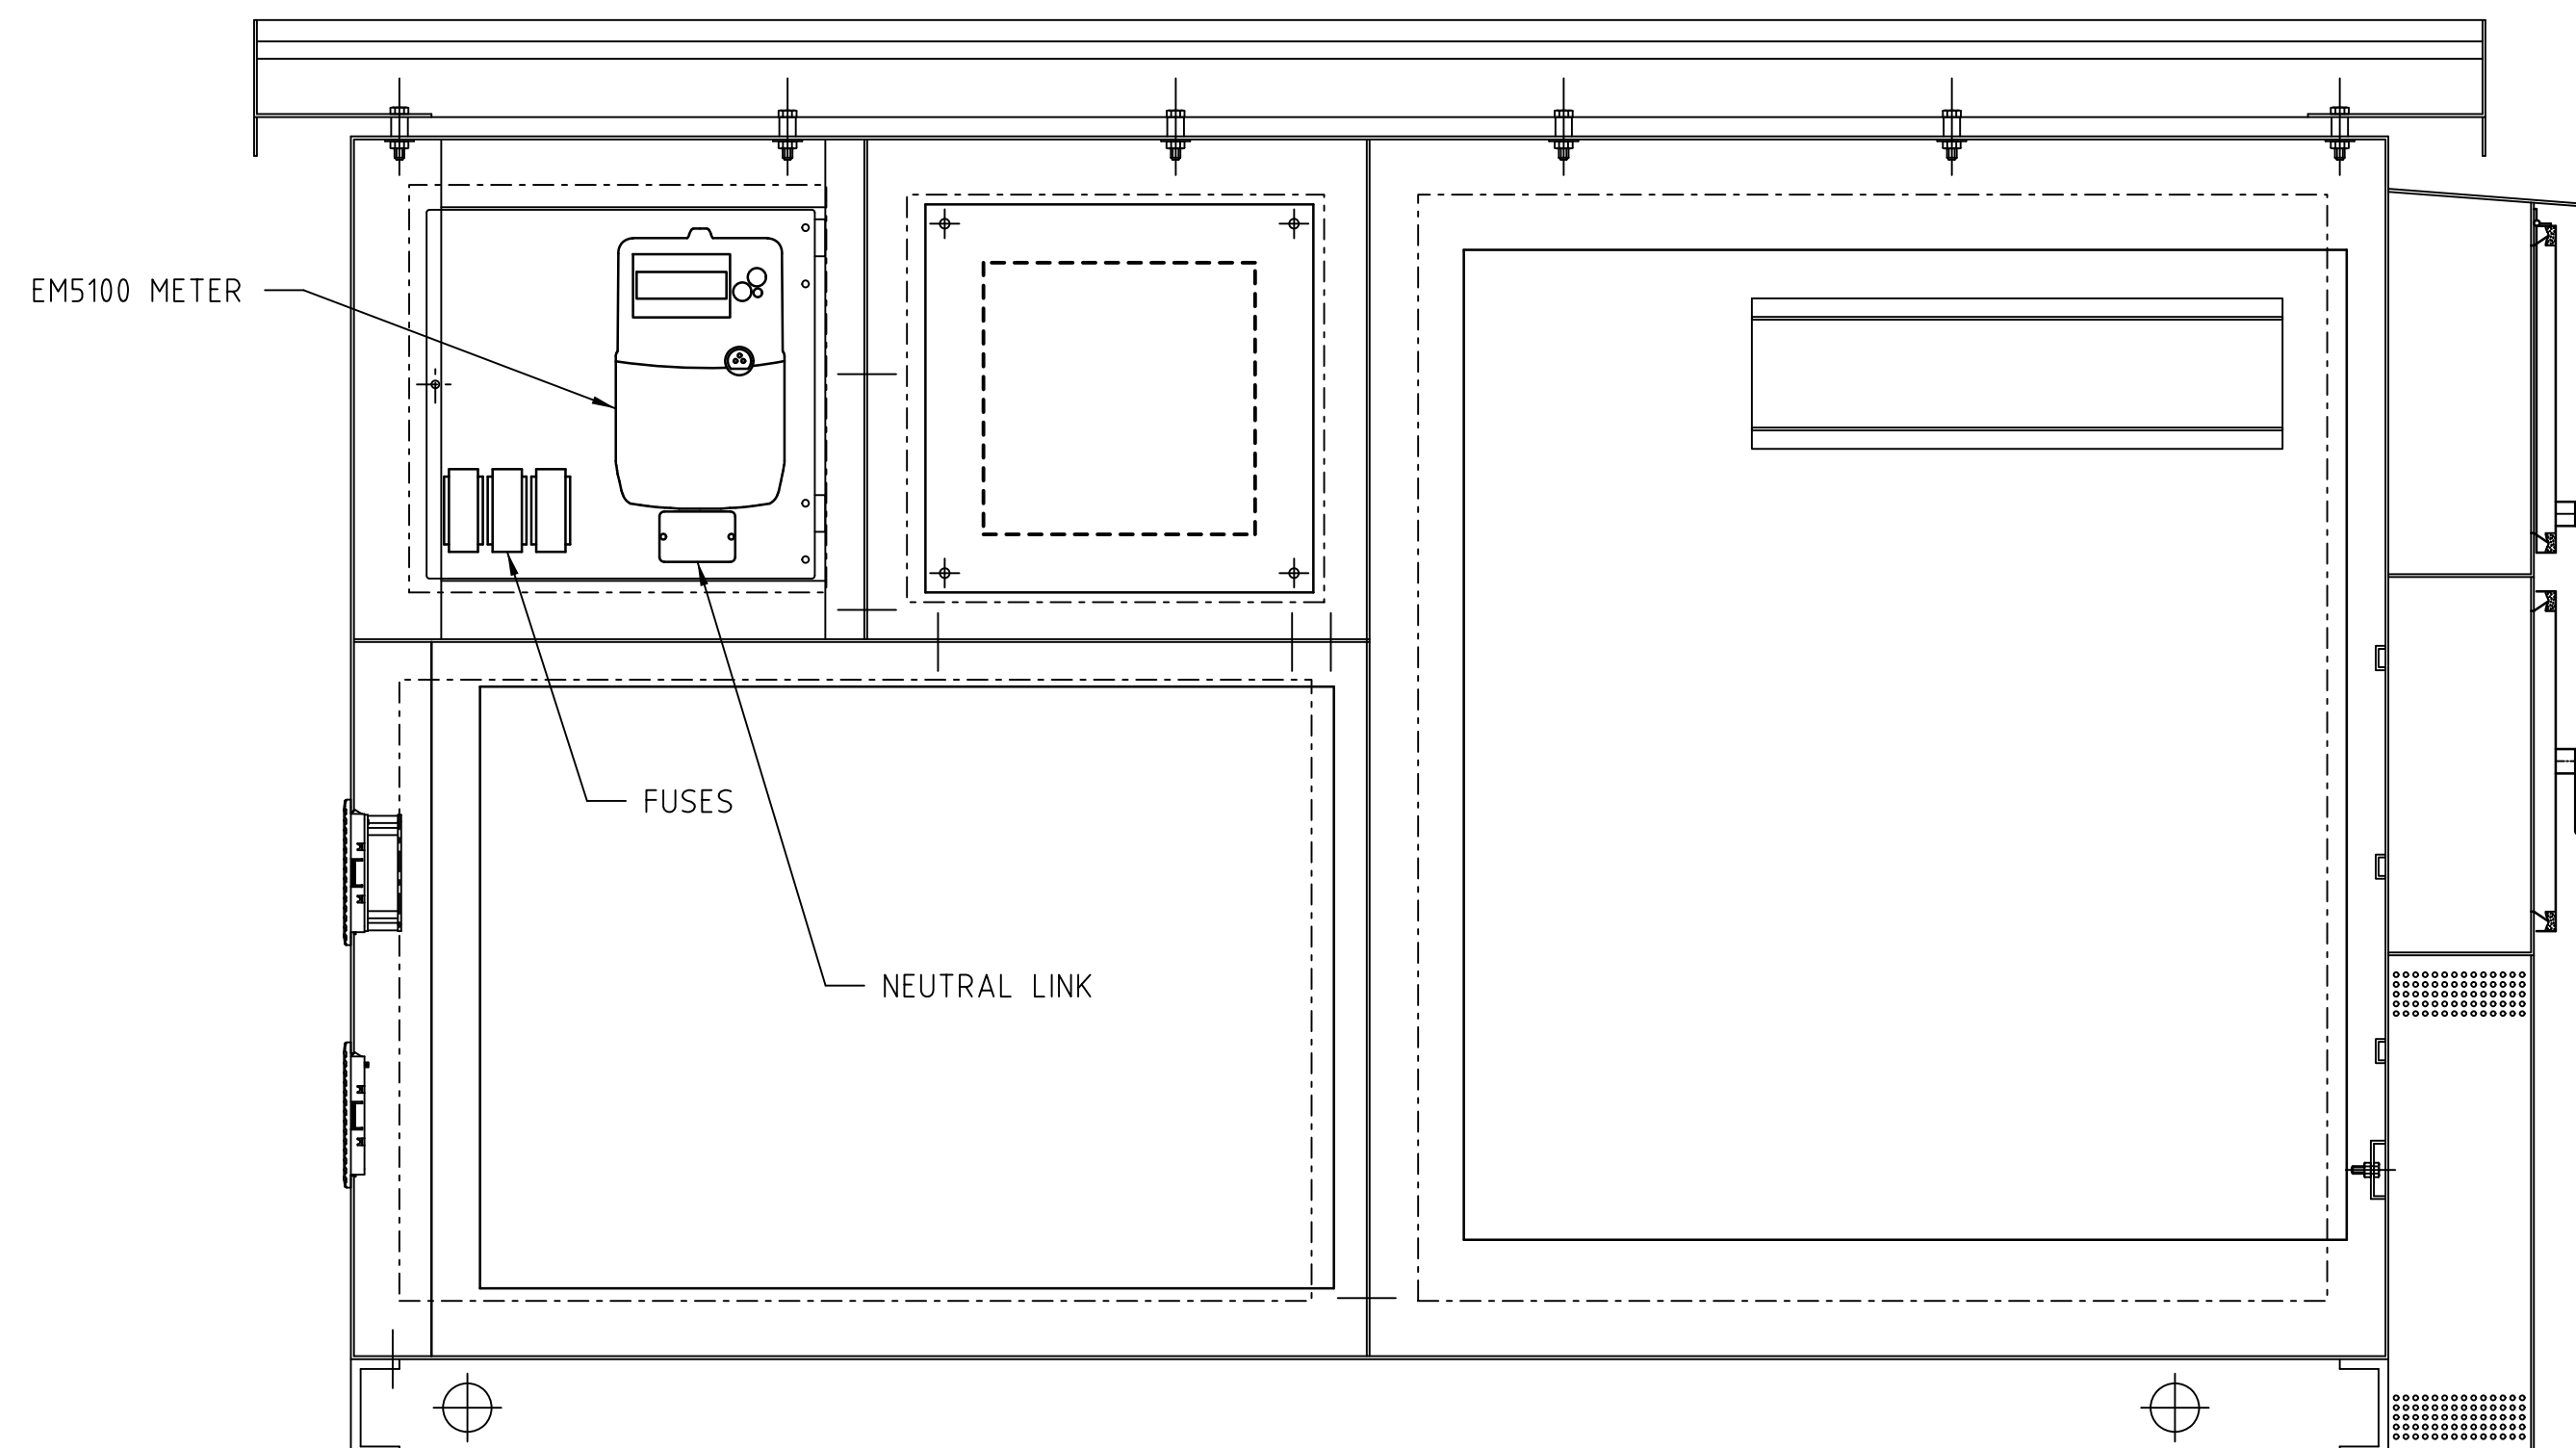

METERING COMPARTMENT DETAILS

SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.
CUBICLE IP RATING: IP55
VENTILATION REQUIRMENTS FOR METERING COMPARTMENT:
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF
PROTECTION OF IP23.

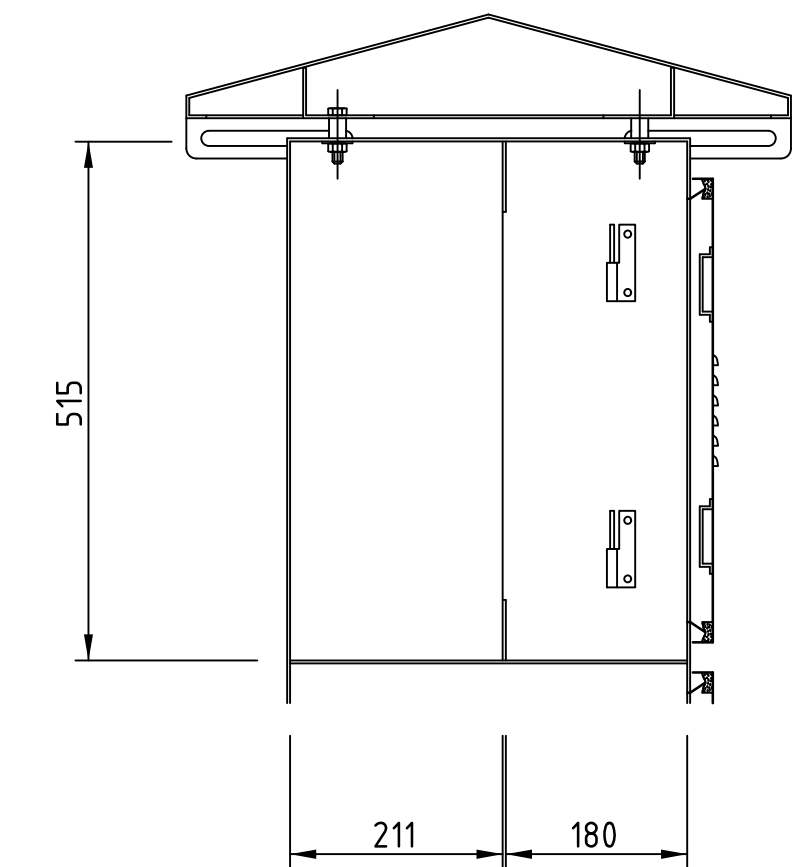

NOT TO SCALE

No.	DATE	DESCRIPTION	APP'D	PLAN No.	TITLE
2	19/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.	M.S.		
1	21/5/15	ADDED HANDLE TO GENERATOR CONNECTION BOX.	M.S.		
0	27/3/15	INITIAL ISSUE.	M.S.		

DESIGNED BY:

OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 25/03/2015 - M SENANAYAKE DRAWN: 27/03/2015 - OPT/MM CHECKED: 01/04/2015 - M SENANAYAKE		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (SOFT STARTER) SIDE BY SIDE - PUMP STATION CUBICLE METERING COMPARTMENT DETAILS	
DRAWING No.		REV.	
A1-58874		2	