DESCRIPTION	FIELD DEVICE	J/BOX	SEWERAGE PUMP STATION — CONTROL COMPARTMENT	CONTROL COMPT ESCUTCHEON DOOR	TELEMETRY COMPARTMENT

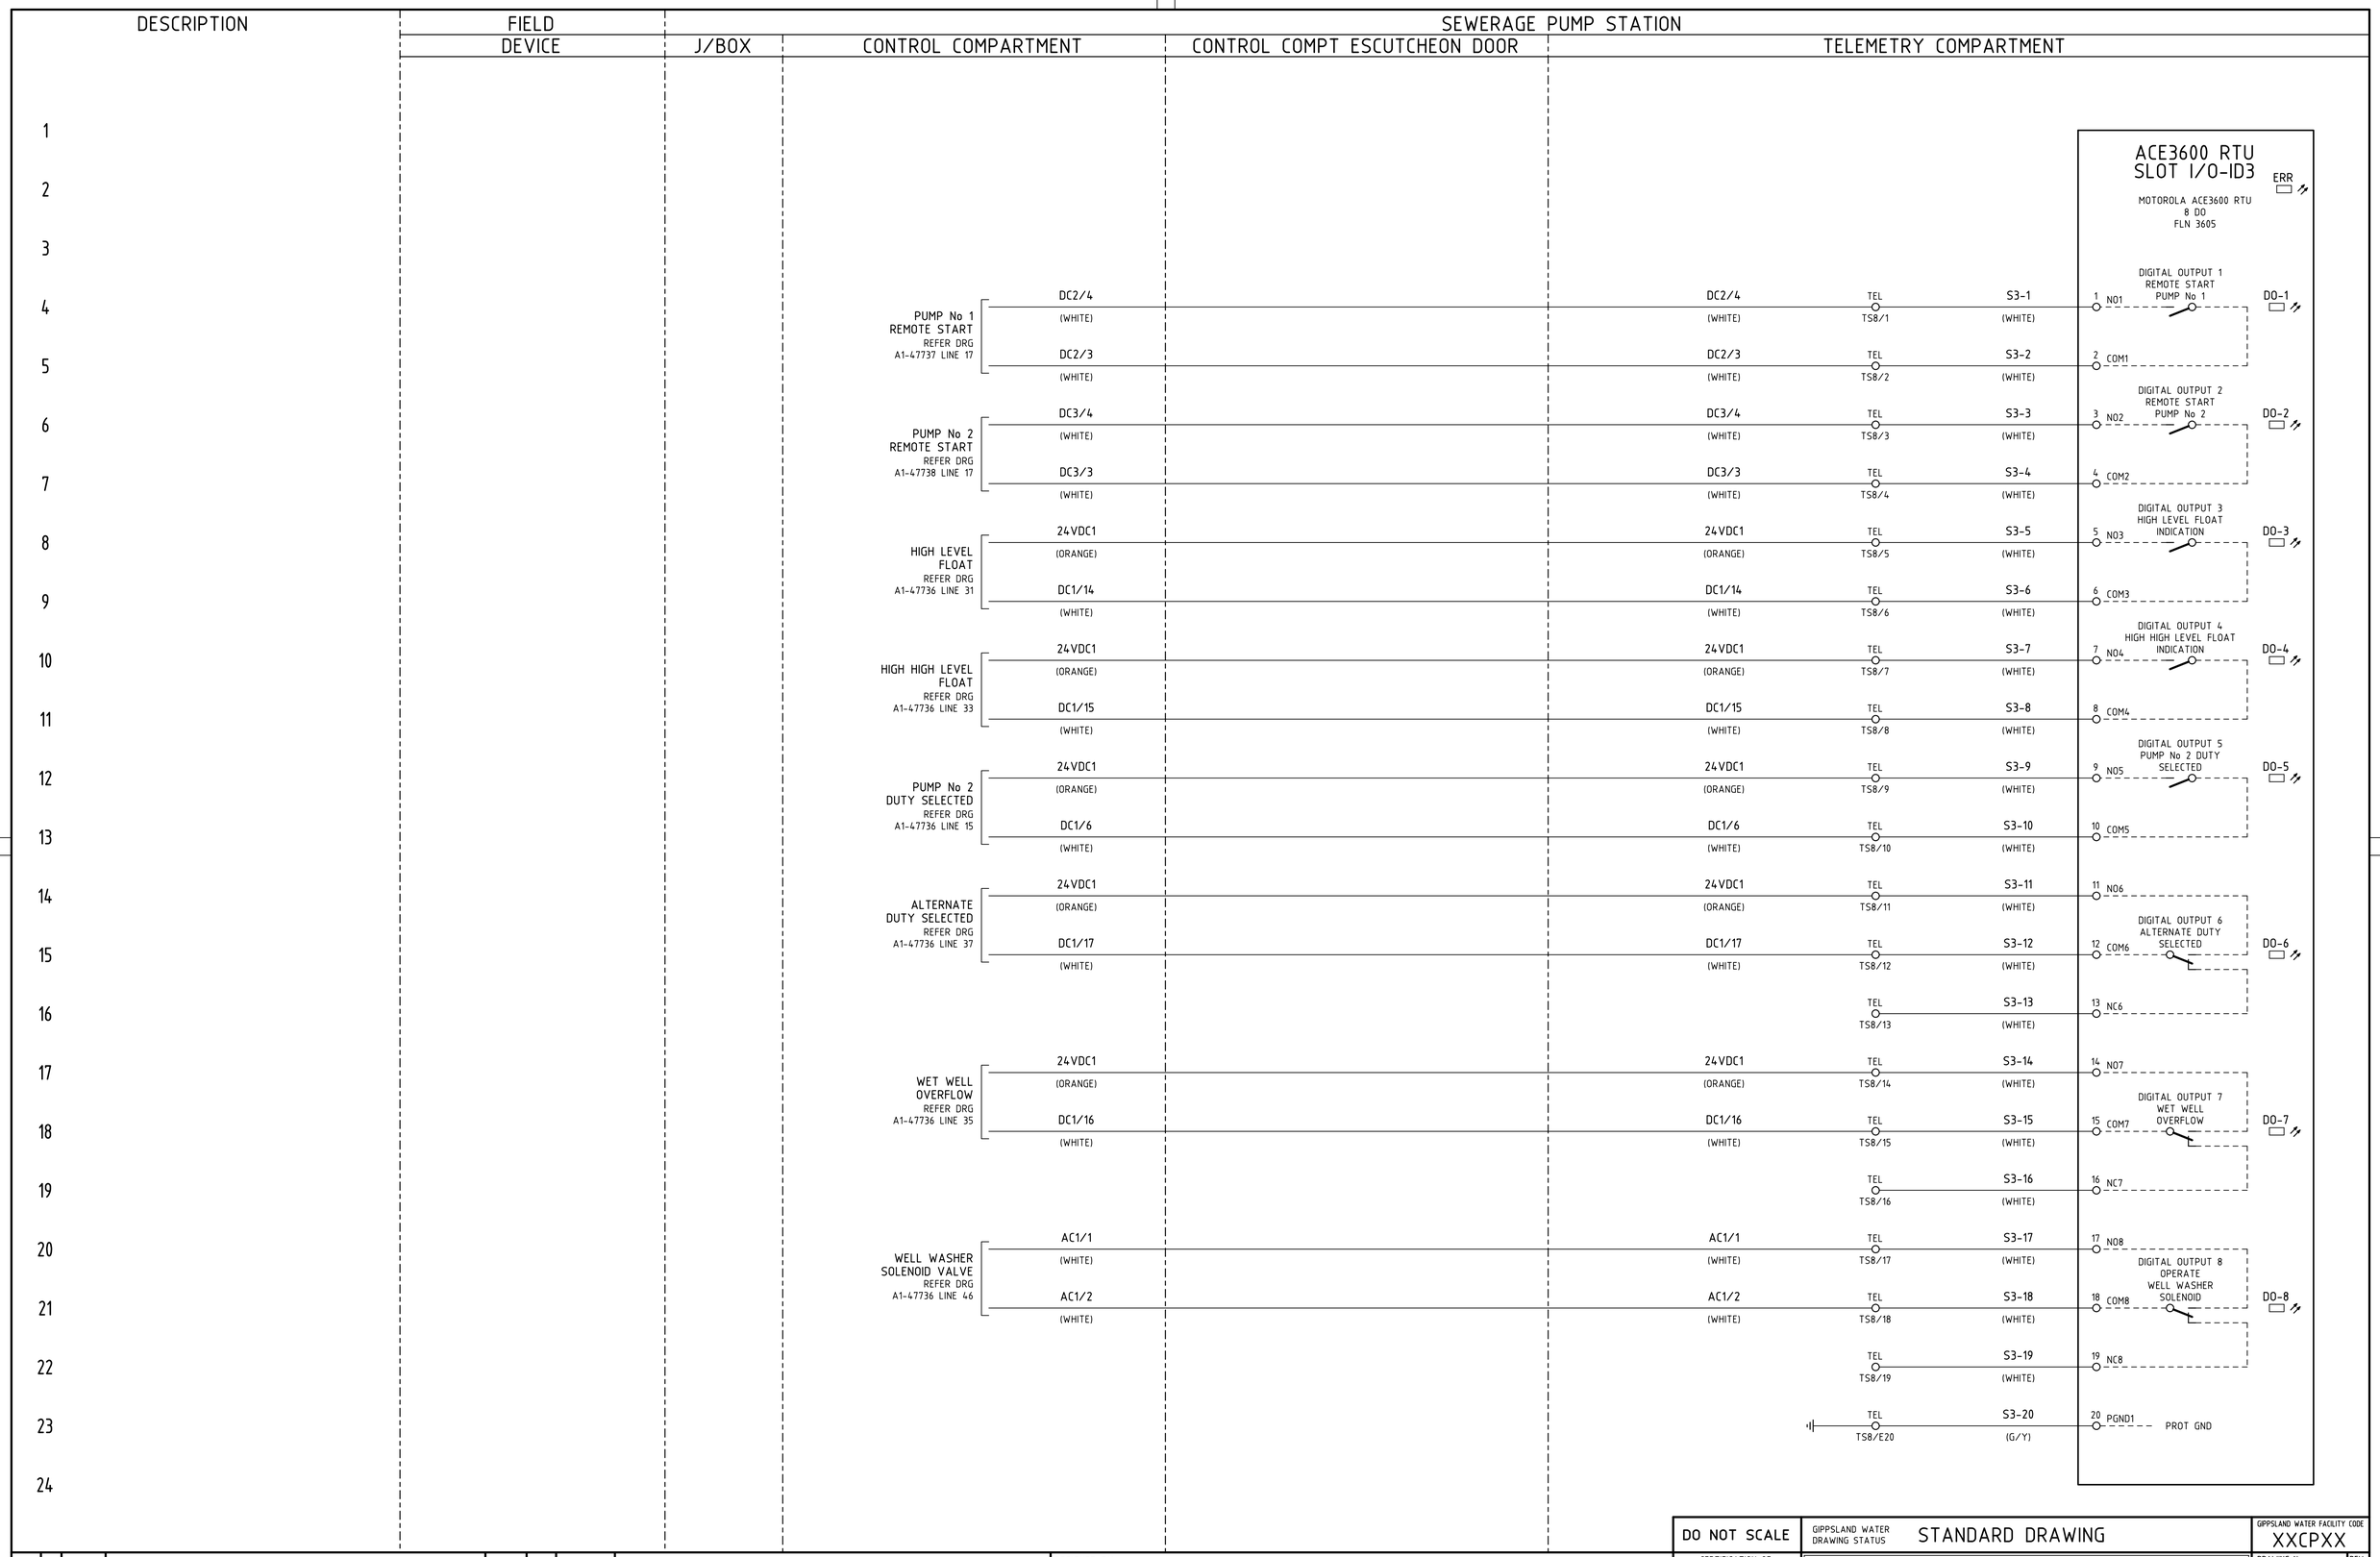

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 12/07/2017 - STD DRG
DRAWN: 22/07/2010 - OPT/RJ
CHECKED: 19/07/2017 - P STEWART

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-47743 REV. 11

STANDARD SEWERAGE PUMP STATION
PUMP STATION UP TO 5.5kW (DOL)
'ACE3600' TELEMETRY SLOT 3 - 8 DO CARD
ELECTRICAL SCHEMATIC DIAGRAM

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

REVISIONS

No.	DATE	DESCRIPTION	APP'D
11	10/11/20	REVISED WELL WASHER SOLENOID VALVE CROSS REFERENCE.	P.S.
10	17/7/17	REDRAWN IN DGN & GENERAL REVISION.	P.S.

REFERENCES

PLAN No.	TITLE
A1-47731	STANDARD SPS PUMP STATION UP TO 5.5kW (DOL) - I & C - DRAWING INDEX