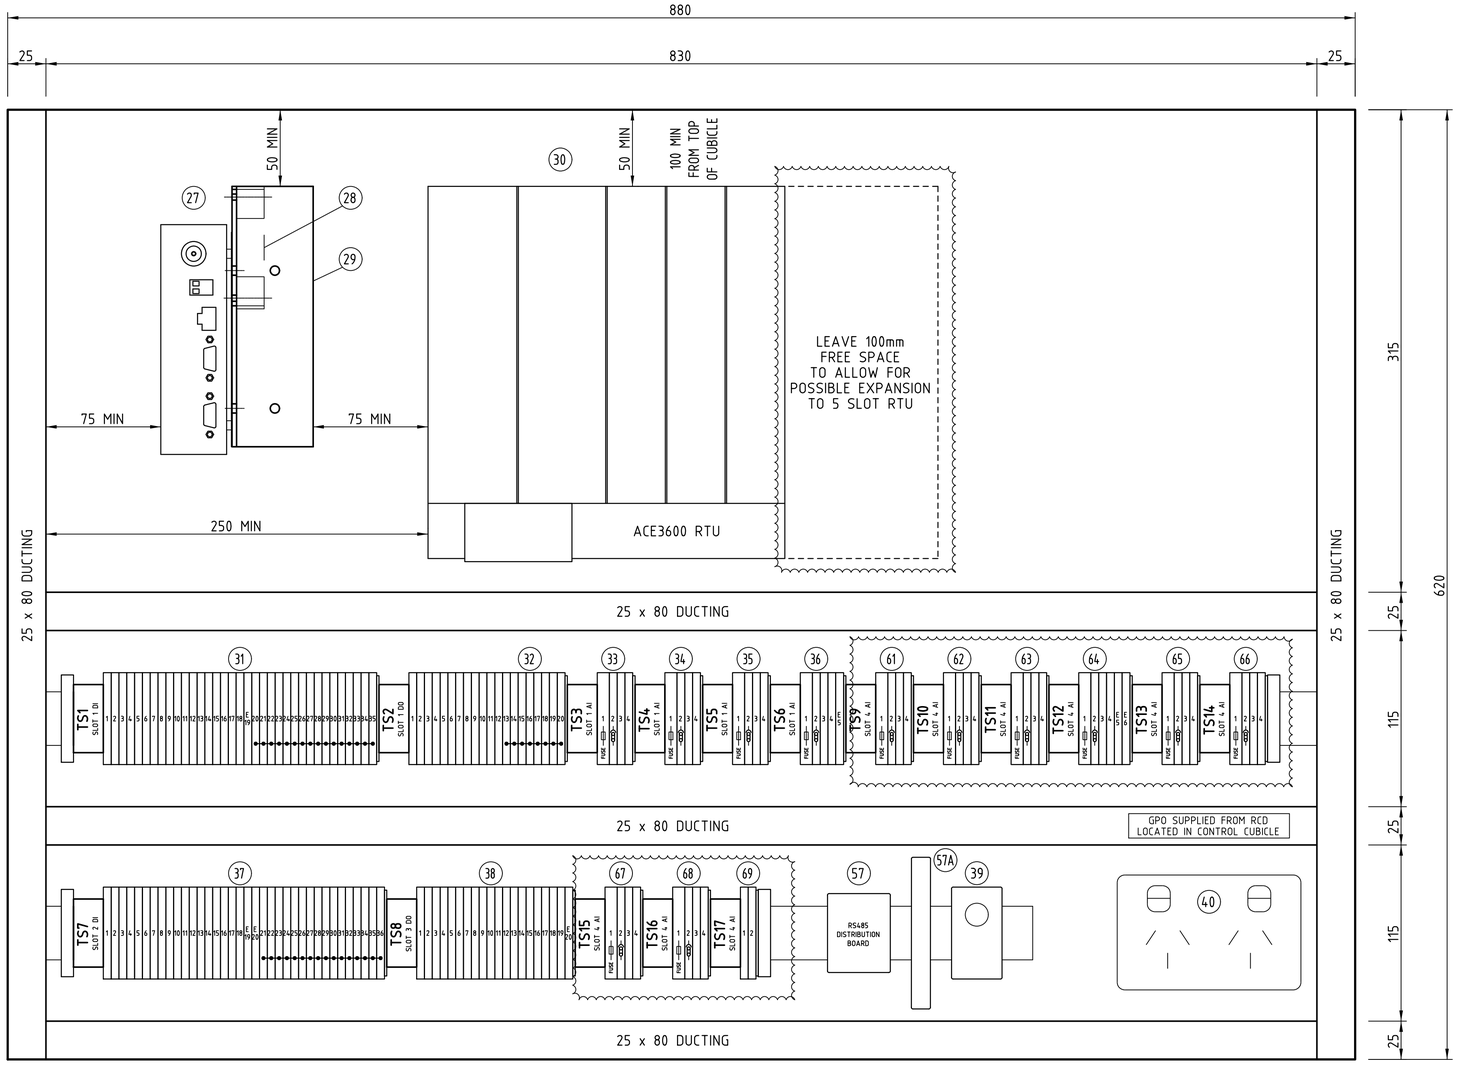

EQUIPMENT IN INVERT CLOUD ONLY REQUIRED IF 8 AI CARD IS INSTALLED FOR EMERGENCY STORAGE LEVEL TRANSMITTER

NOTE:
UNLESS OTHERWISE INDICATED
ALL DIN RAIL TO BE STOOD OFF FROM
GEAR TRAY BY A NOMINAL 40mm.

REVISIONS

No.	DATE	DESCRIPTION	APP'D
14	10/11/20	ADDED TS9 TO TS17 FOR EXTRA ANALOG CARD.	P.S.
13	16/11/17	ADDED KTA-299 MEMORY MODULE ITEM 57A.	G.F.
12	12/7/17	REDRAWN IN DGN & REVISED DRG TITLE.	P.S.

REFERENCES

PLAN No.	TITLE
A1-47731	STANDARD SPS PUMP STATION UP TO 5.5kW (DOL) - I & C - DRAWING INDEX

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 12/07/2017 - STD DRG
DRAWN: 12/07/2017 - OPT/RJ
CHECKED: 19/07/2017 - P STEWART

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-47751 REV. 14

STANDARD SEWERAGE PUMP STATION
PUMP STATION UP TO 5.5kW (DOL)
TELEMETRY COMPARTMENT (PF1EC02)
GEAR TRAY LAYOUT