METERING COMPARTMENT DETAILS

SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.
CUBICLE IP RATING: IP55
VENTILATION REQUIRMENTS FOR METERING COMPARTMENT:
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF PROTECTION OF IP23.

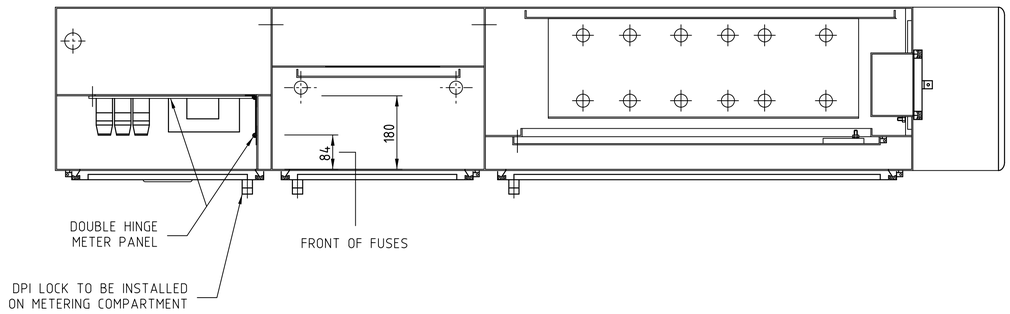

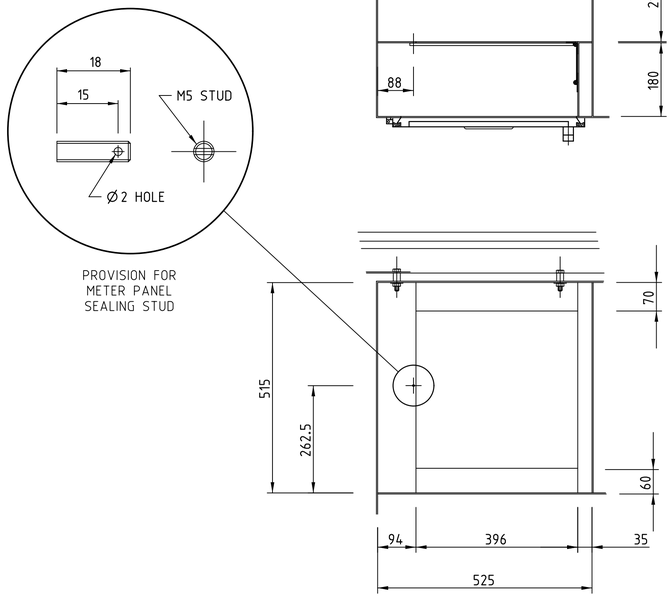

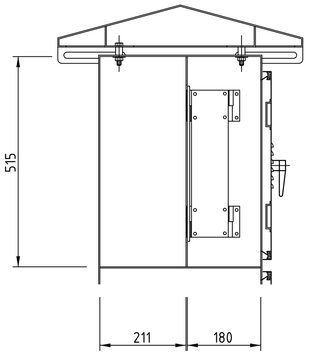

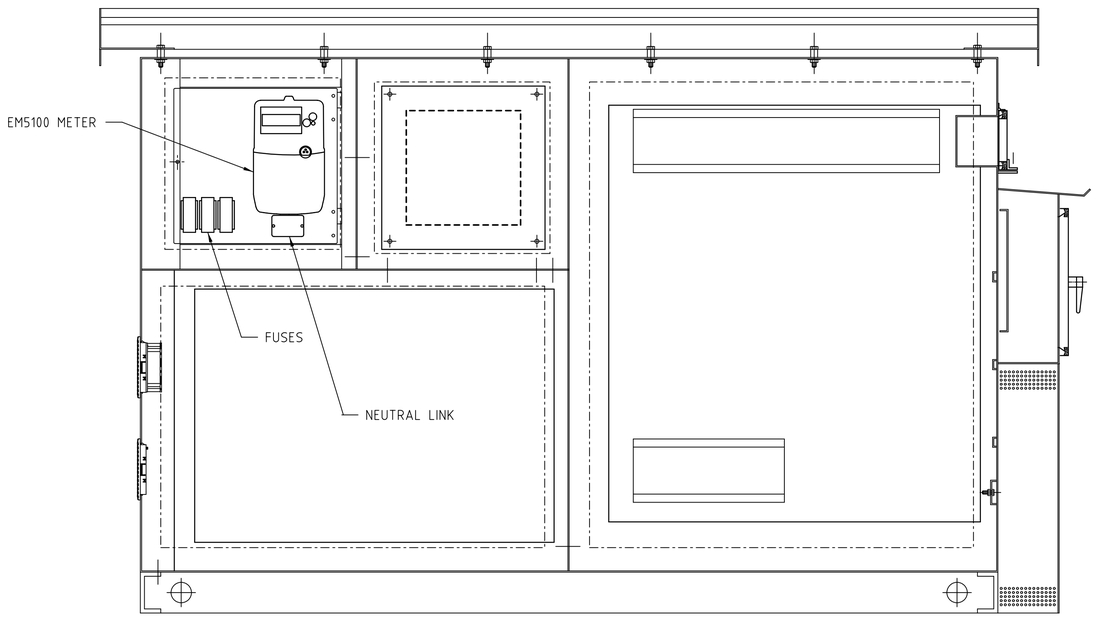

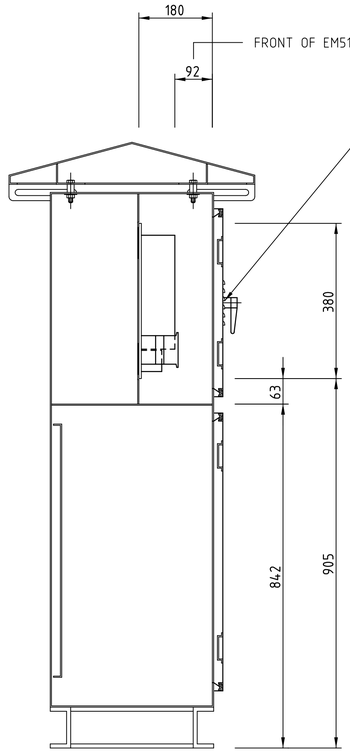

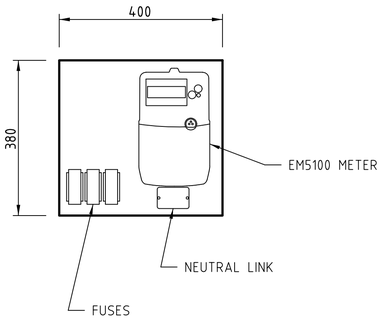

REVISIONS				
No.	DATE	DESCRIPTION	APP'D	
9	10/11/20	REVISED METERING COMPARTMENT INTERNAL DIMENSIONS.	P.S.	
8	16/11/17	ADDED TOP HAT FOR 24VAC/DC CIRCUIT BREAKERS.	G.F.	
7	12/7/17	REDRAWN IN DGN & GENERAL REVISIONS.	P.S.	

REFERENCES	
PLAN No.	TITLE
A1-47731	STANDARD SPS PUMP STATION UP TO 5.5kW (DOL) - I & C - DRAWING INDEX

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 12/07/2017 - GW STD DRG
DRAWN: 12/07/2017 - OPT/RJ
CHECKED: 19/07/2017 - P STEWART

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-49216 REV. 9

STANDARD SEWERAGE PUMP STATION
PUMP STATION UP TO 5.5kW (DOL)
SIDE BY SIDE CUBICLE
METERING COMPARTMENT DETAILS